




Bartels Rotation 2359 – Daily Averages
Leakage Current – M1A – Ground Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

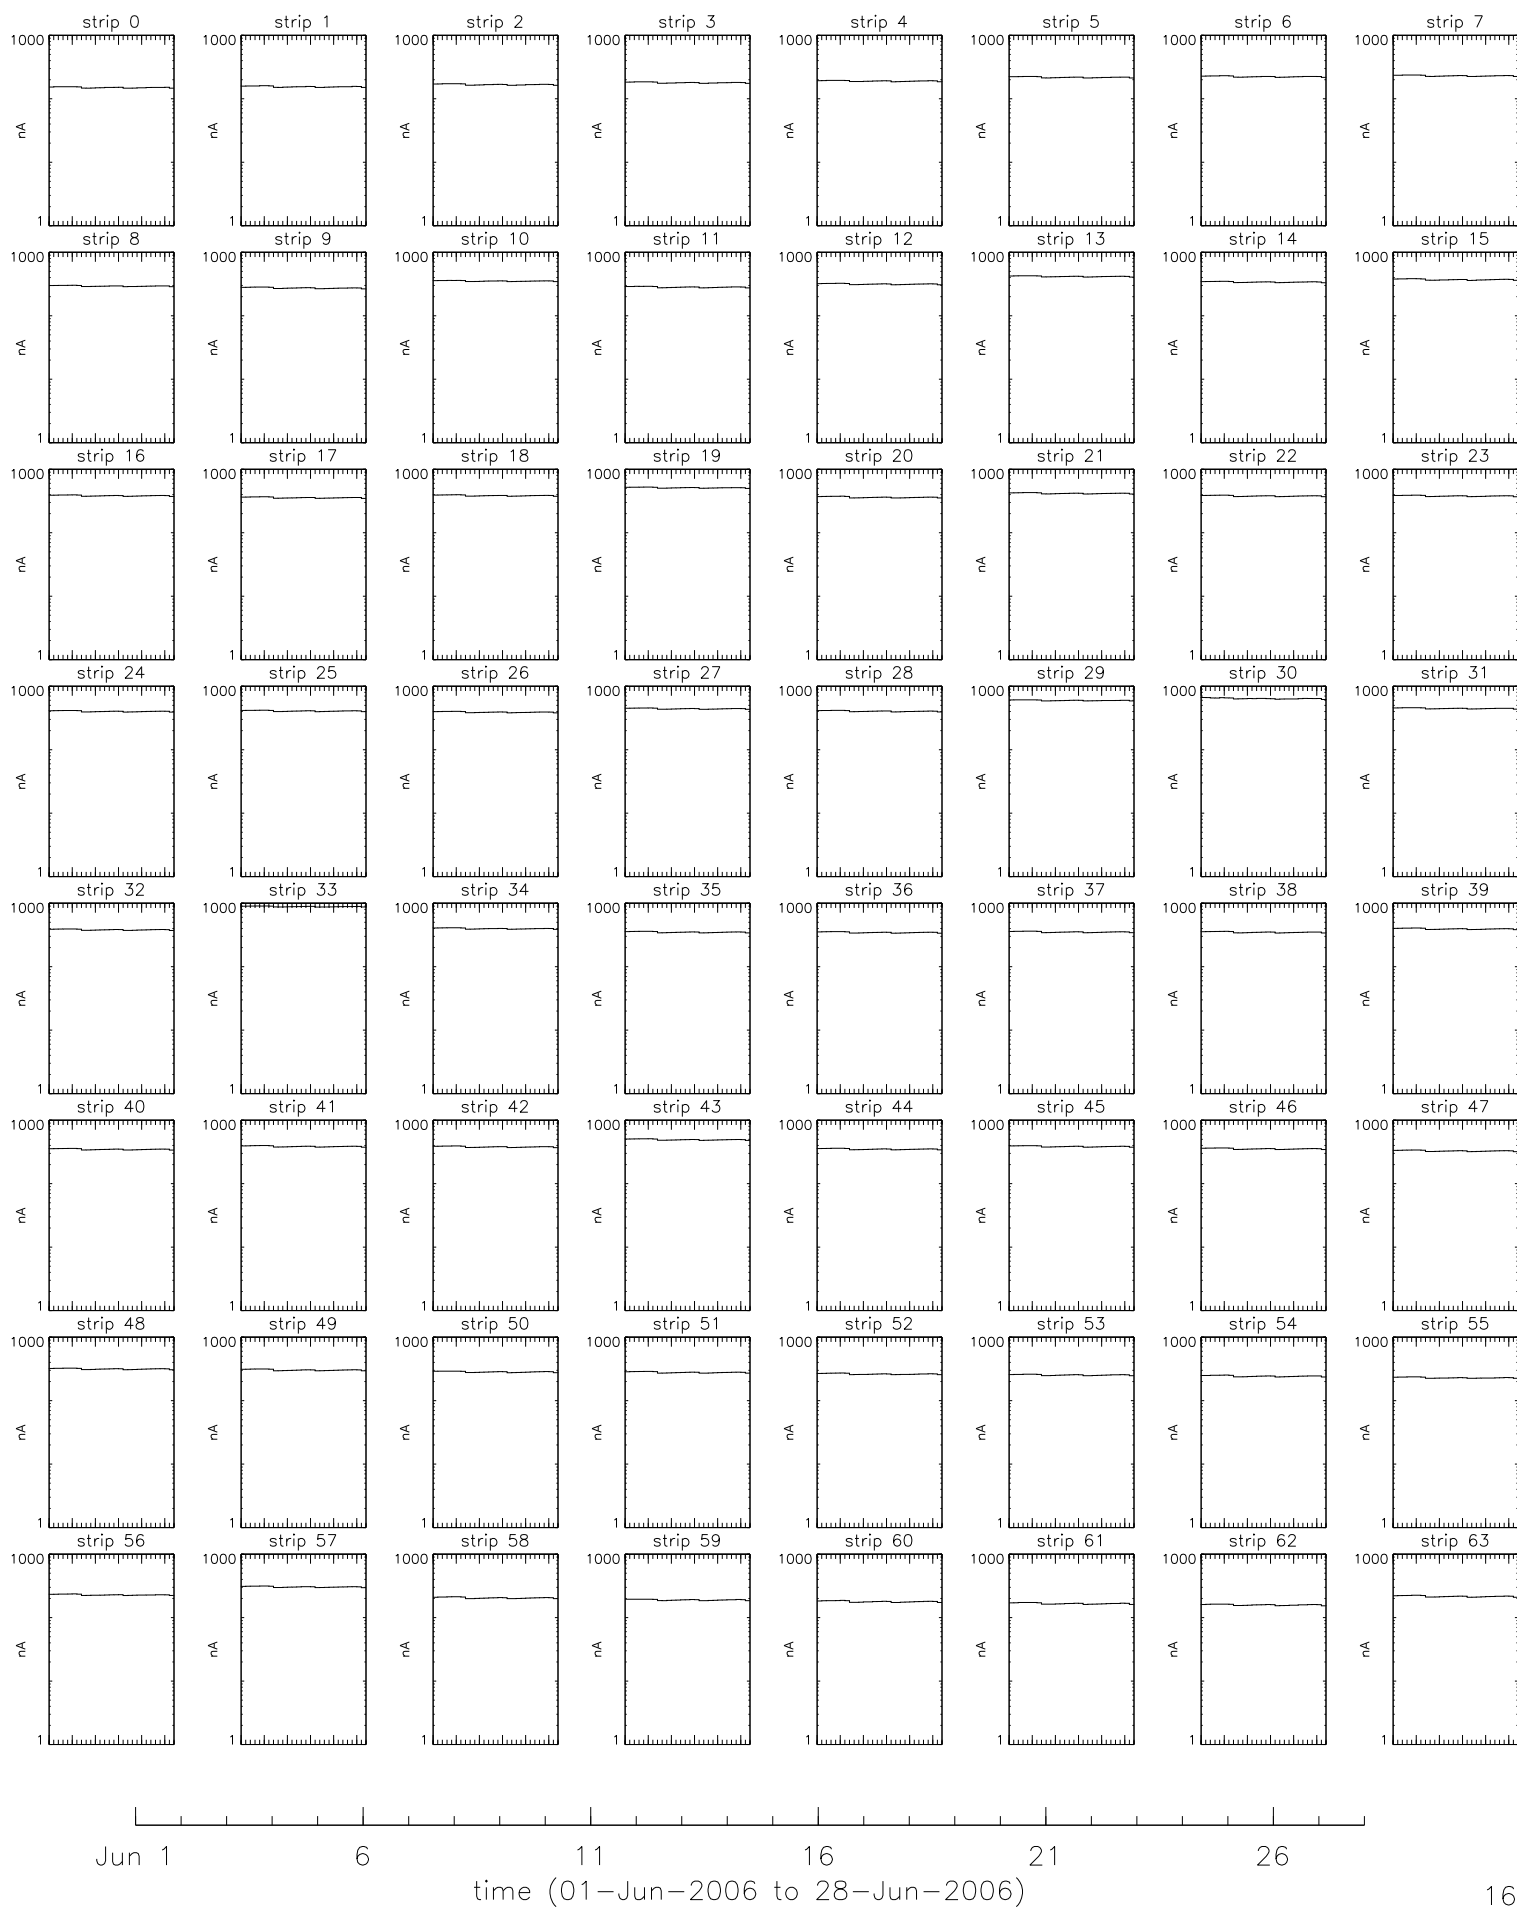


Bartels Rotation 2359 – Daily Averages
Leakage Current – M1A – High Voltage Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

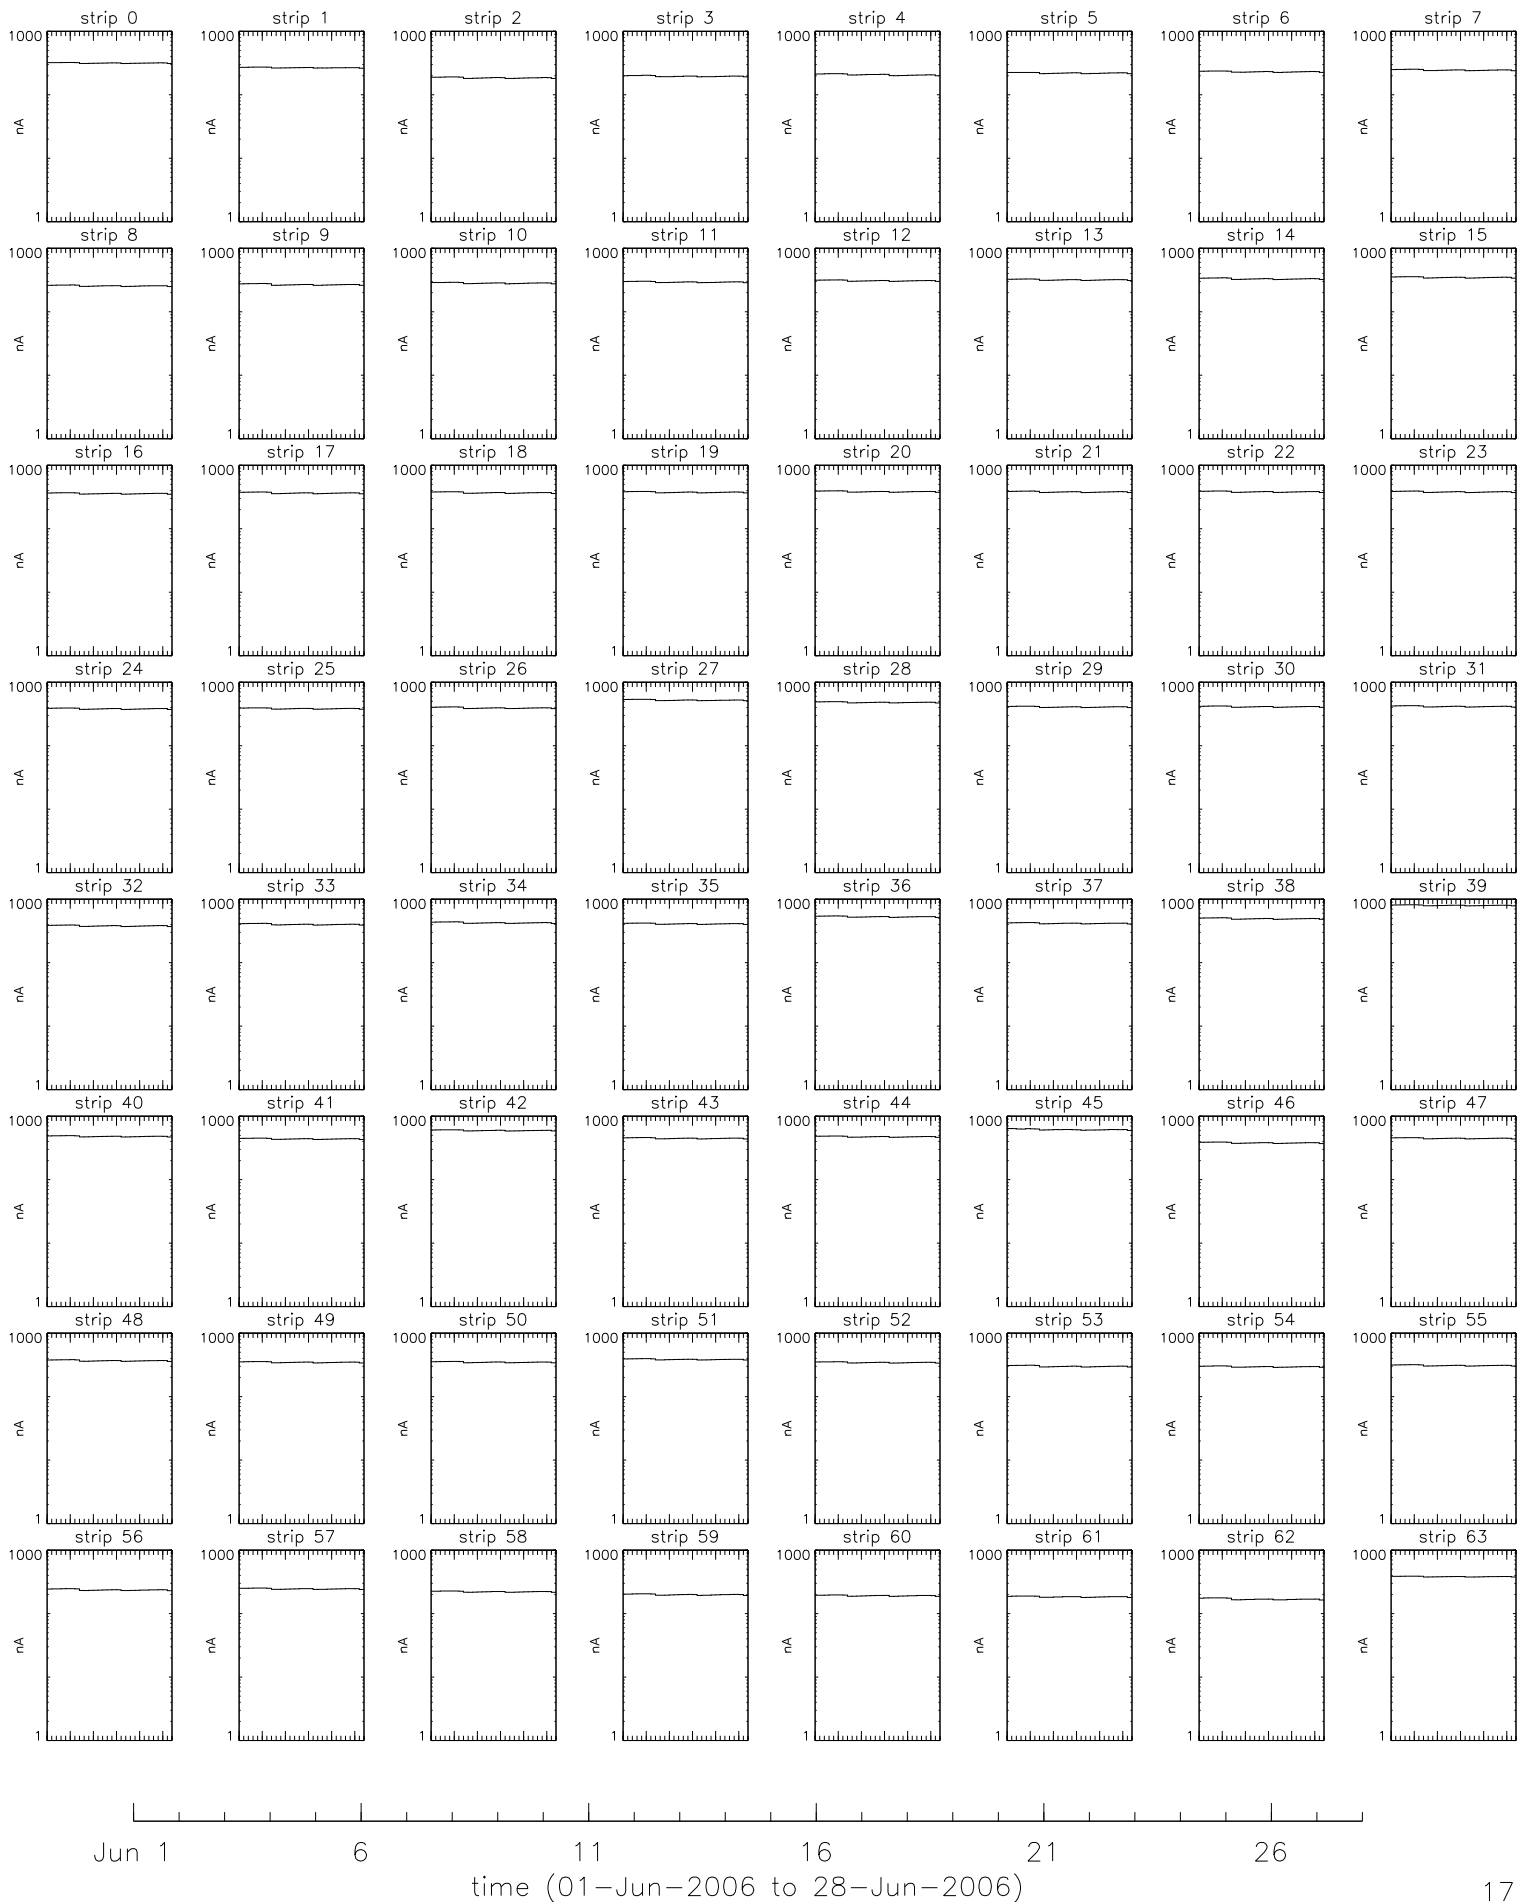


Bartels Rotation 2359 – Daily Averages
Leakage Current – M2A – Ground Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

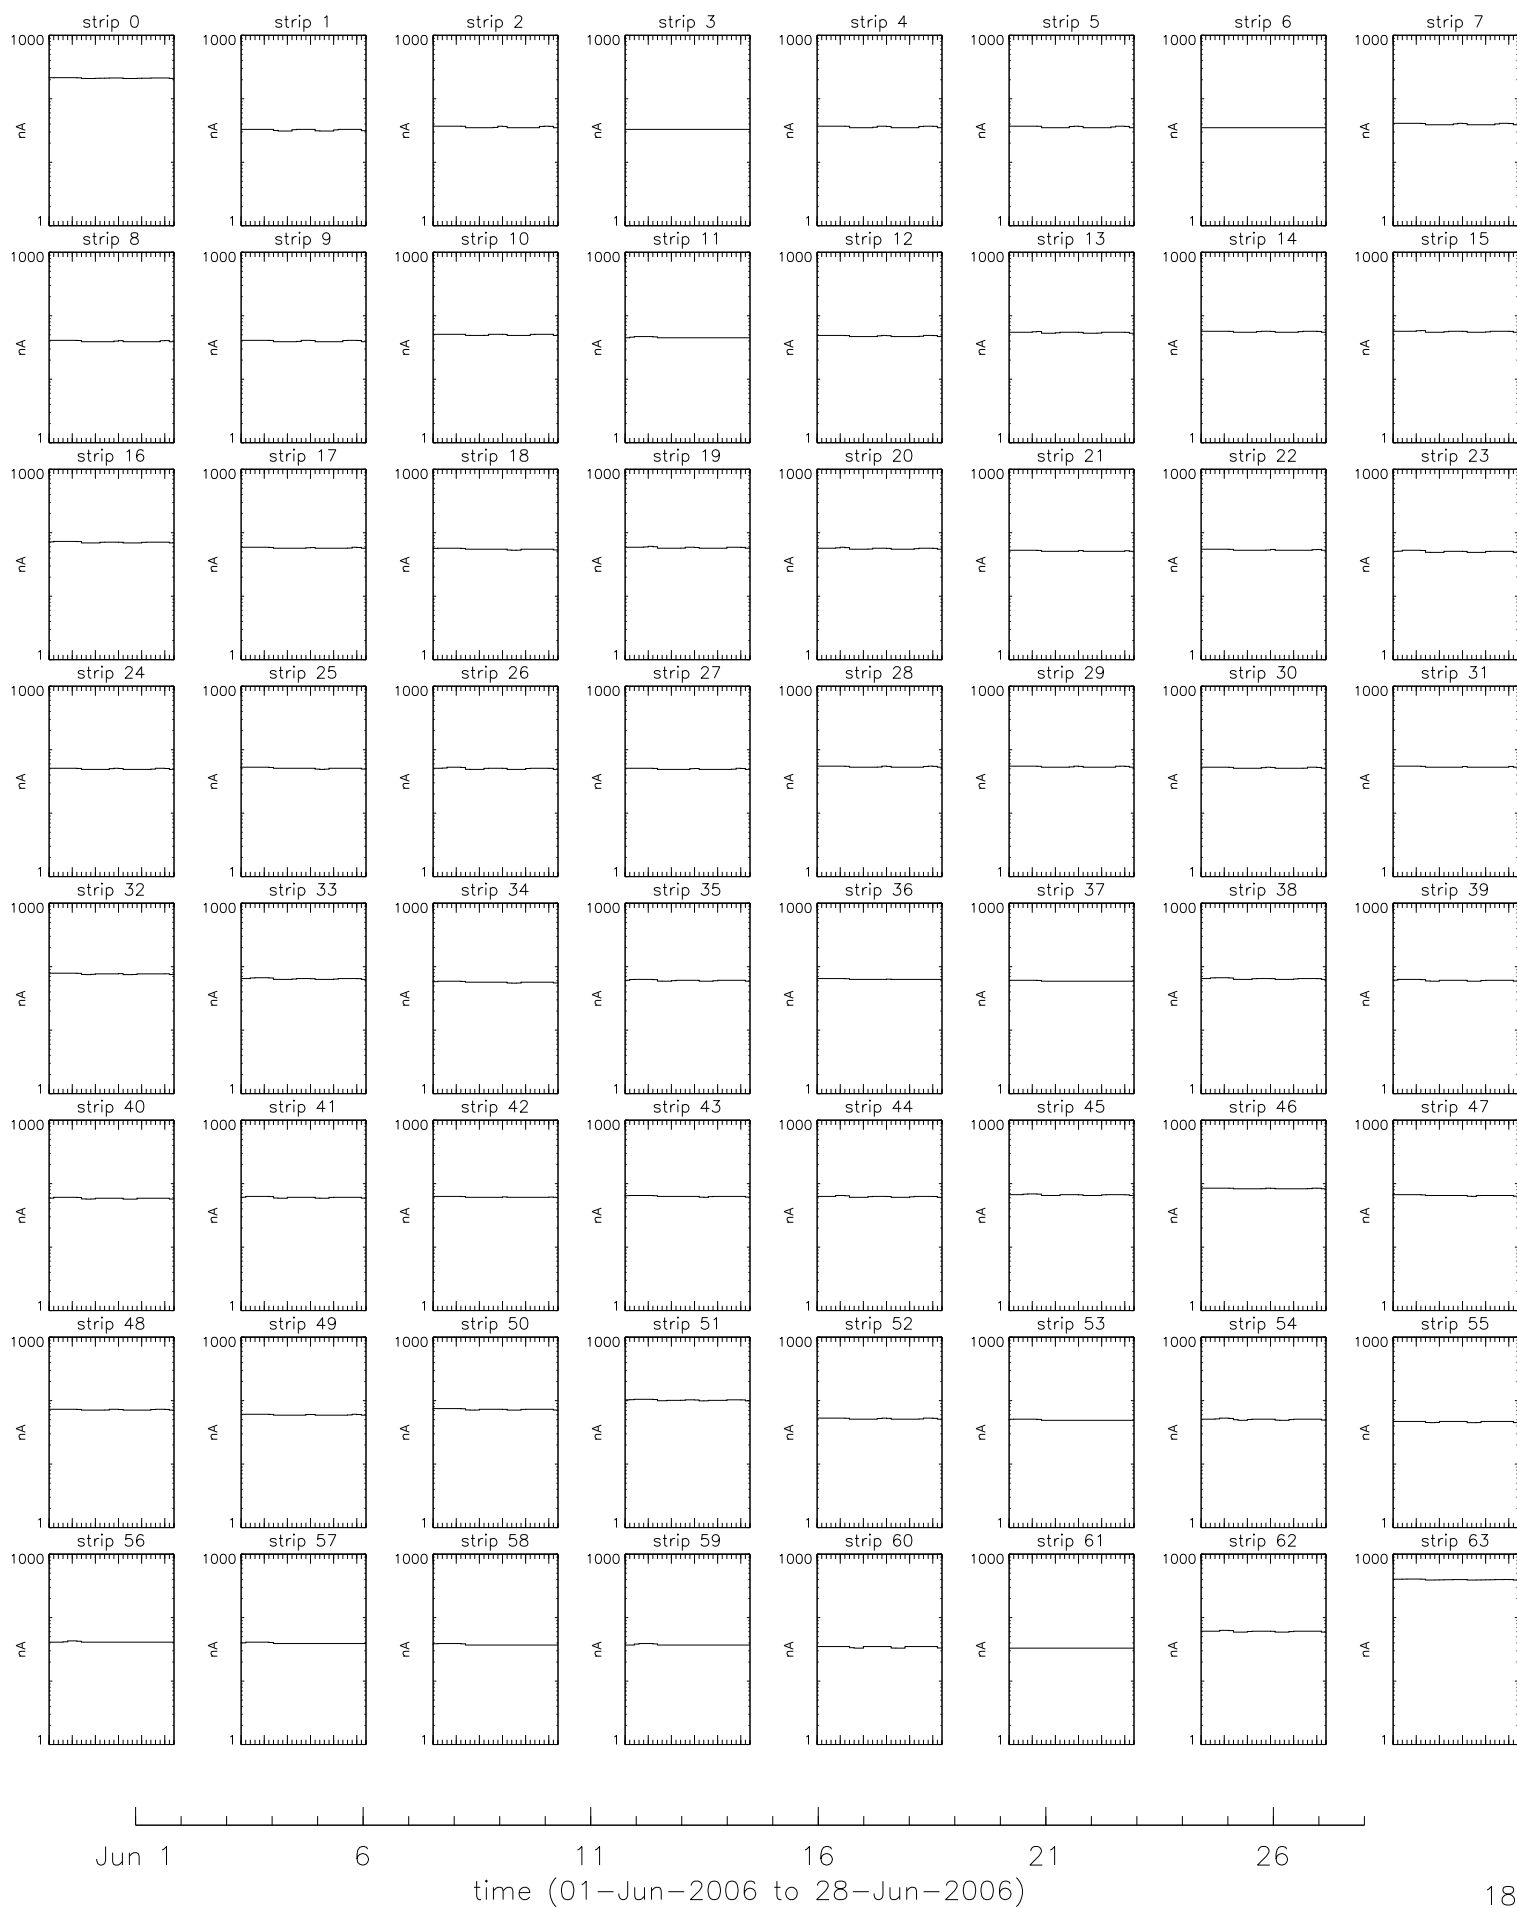

Bartels Rotation 2359 – Daily Averages
Leakage Current – M2A – High Voltage Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

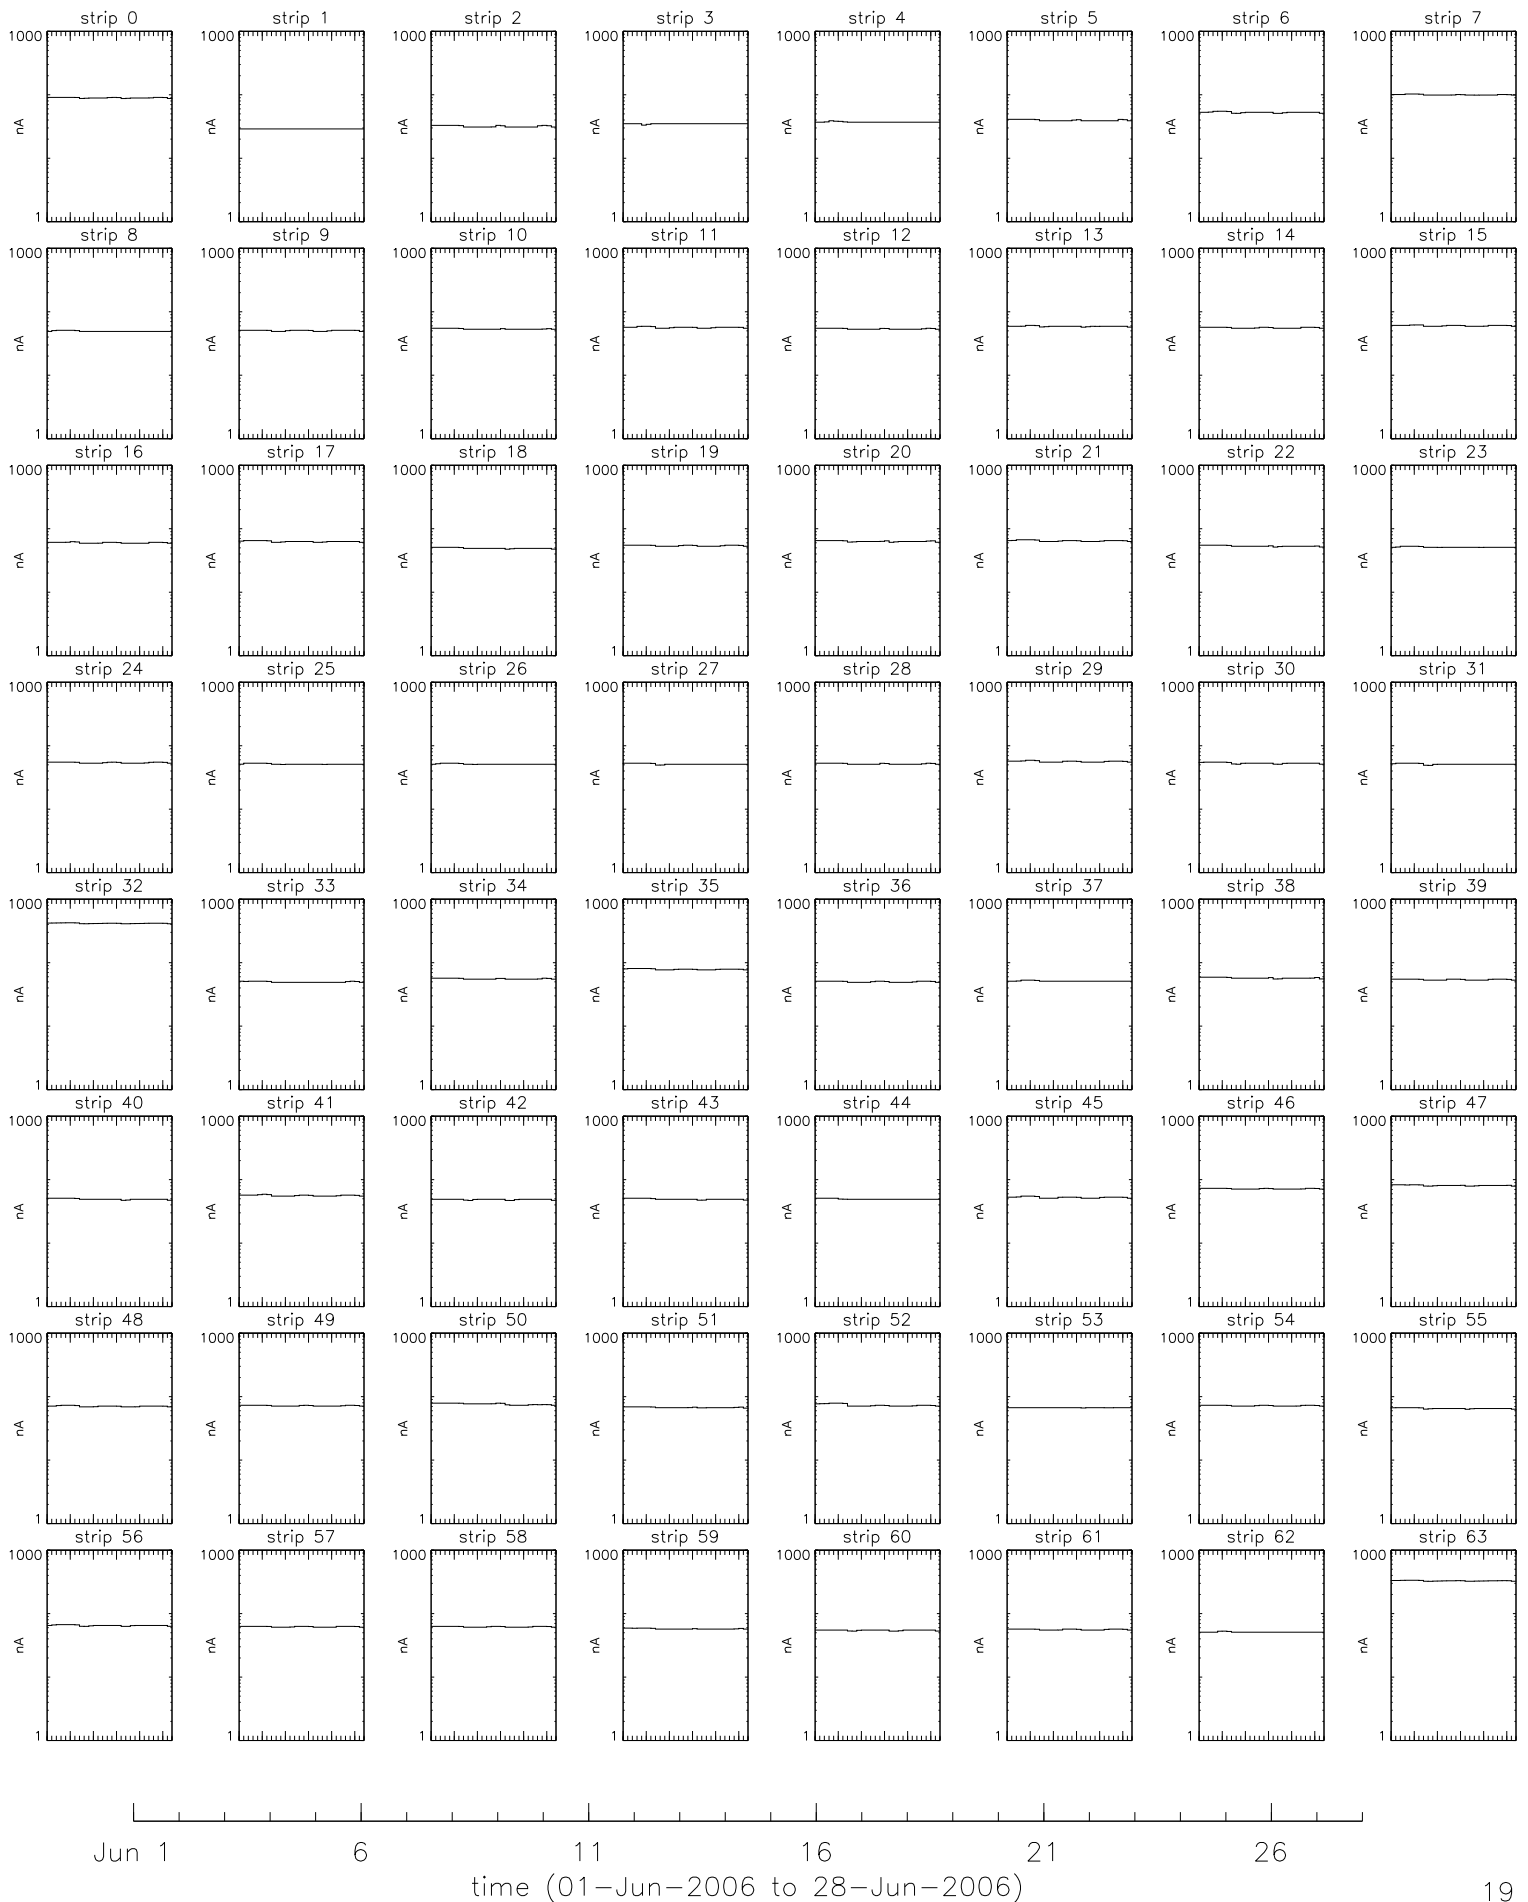


Bartels Rotation 2359 – Daily Averages
Leakage Current – M1B – Ground Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

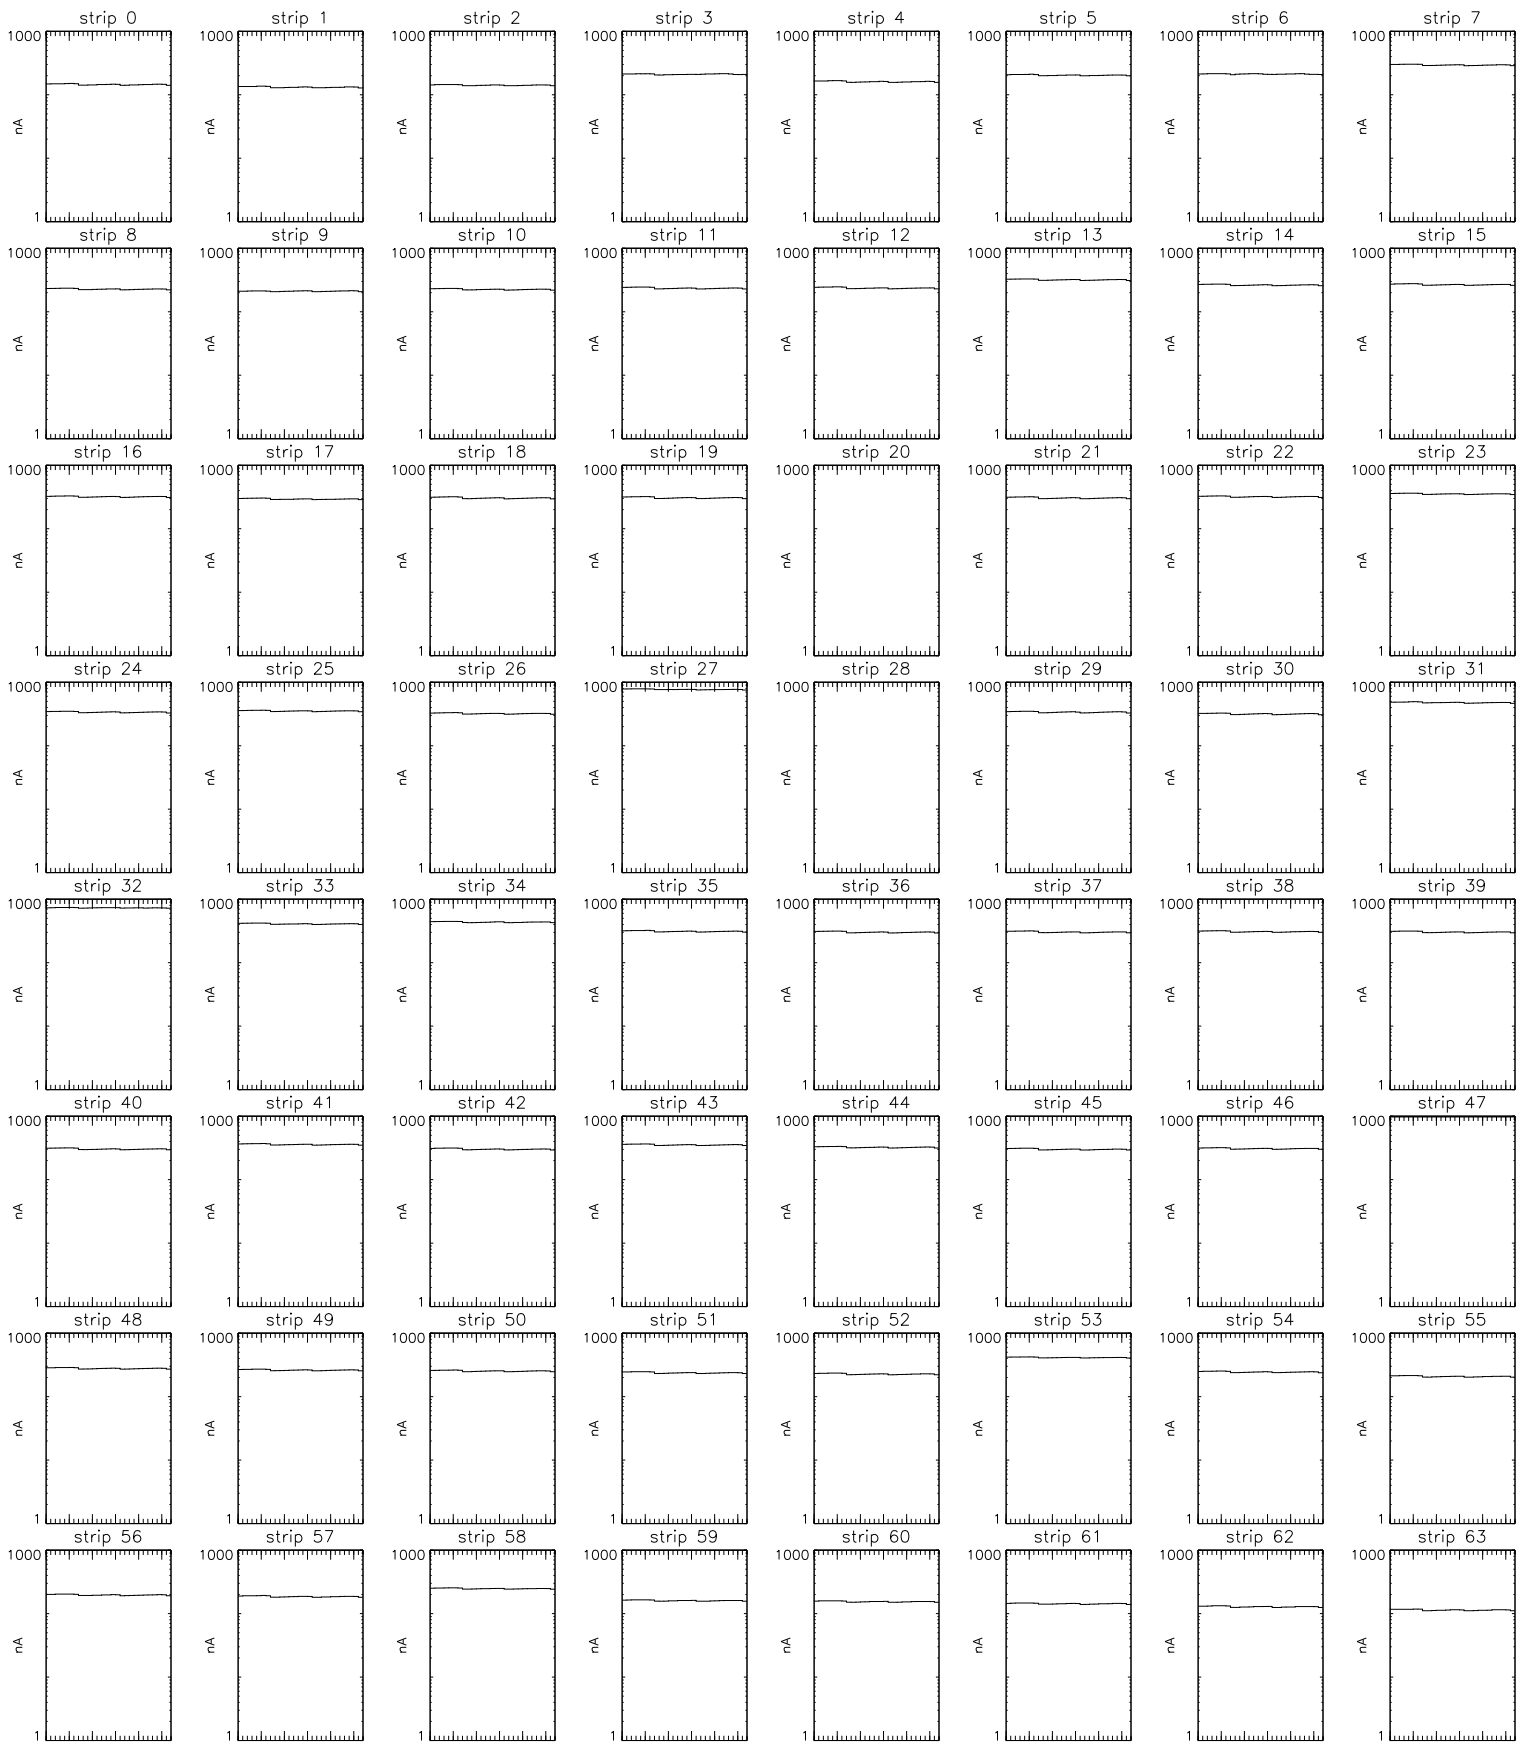


Jun 1 6 11 16 21 26

time (01-Jun-2006 to 28-Jun-2006)


Bartels Rotation 2359 – Daily Averages
Leakage Current – M1B – High Voltage Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

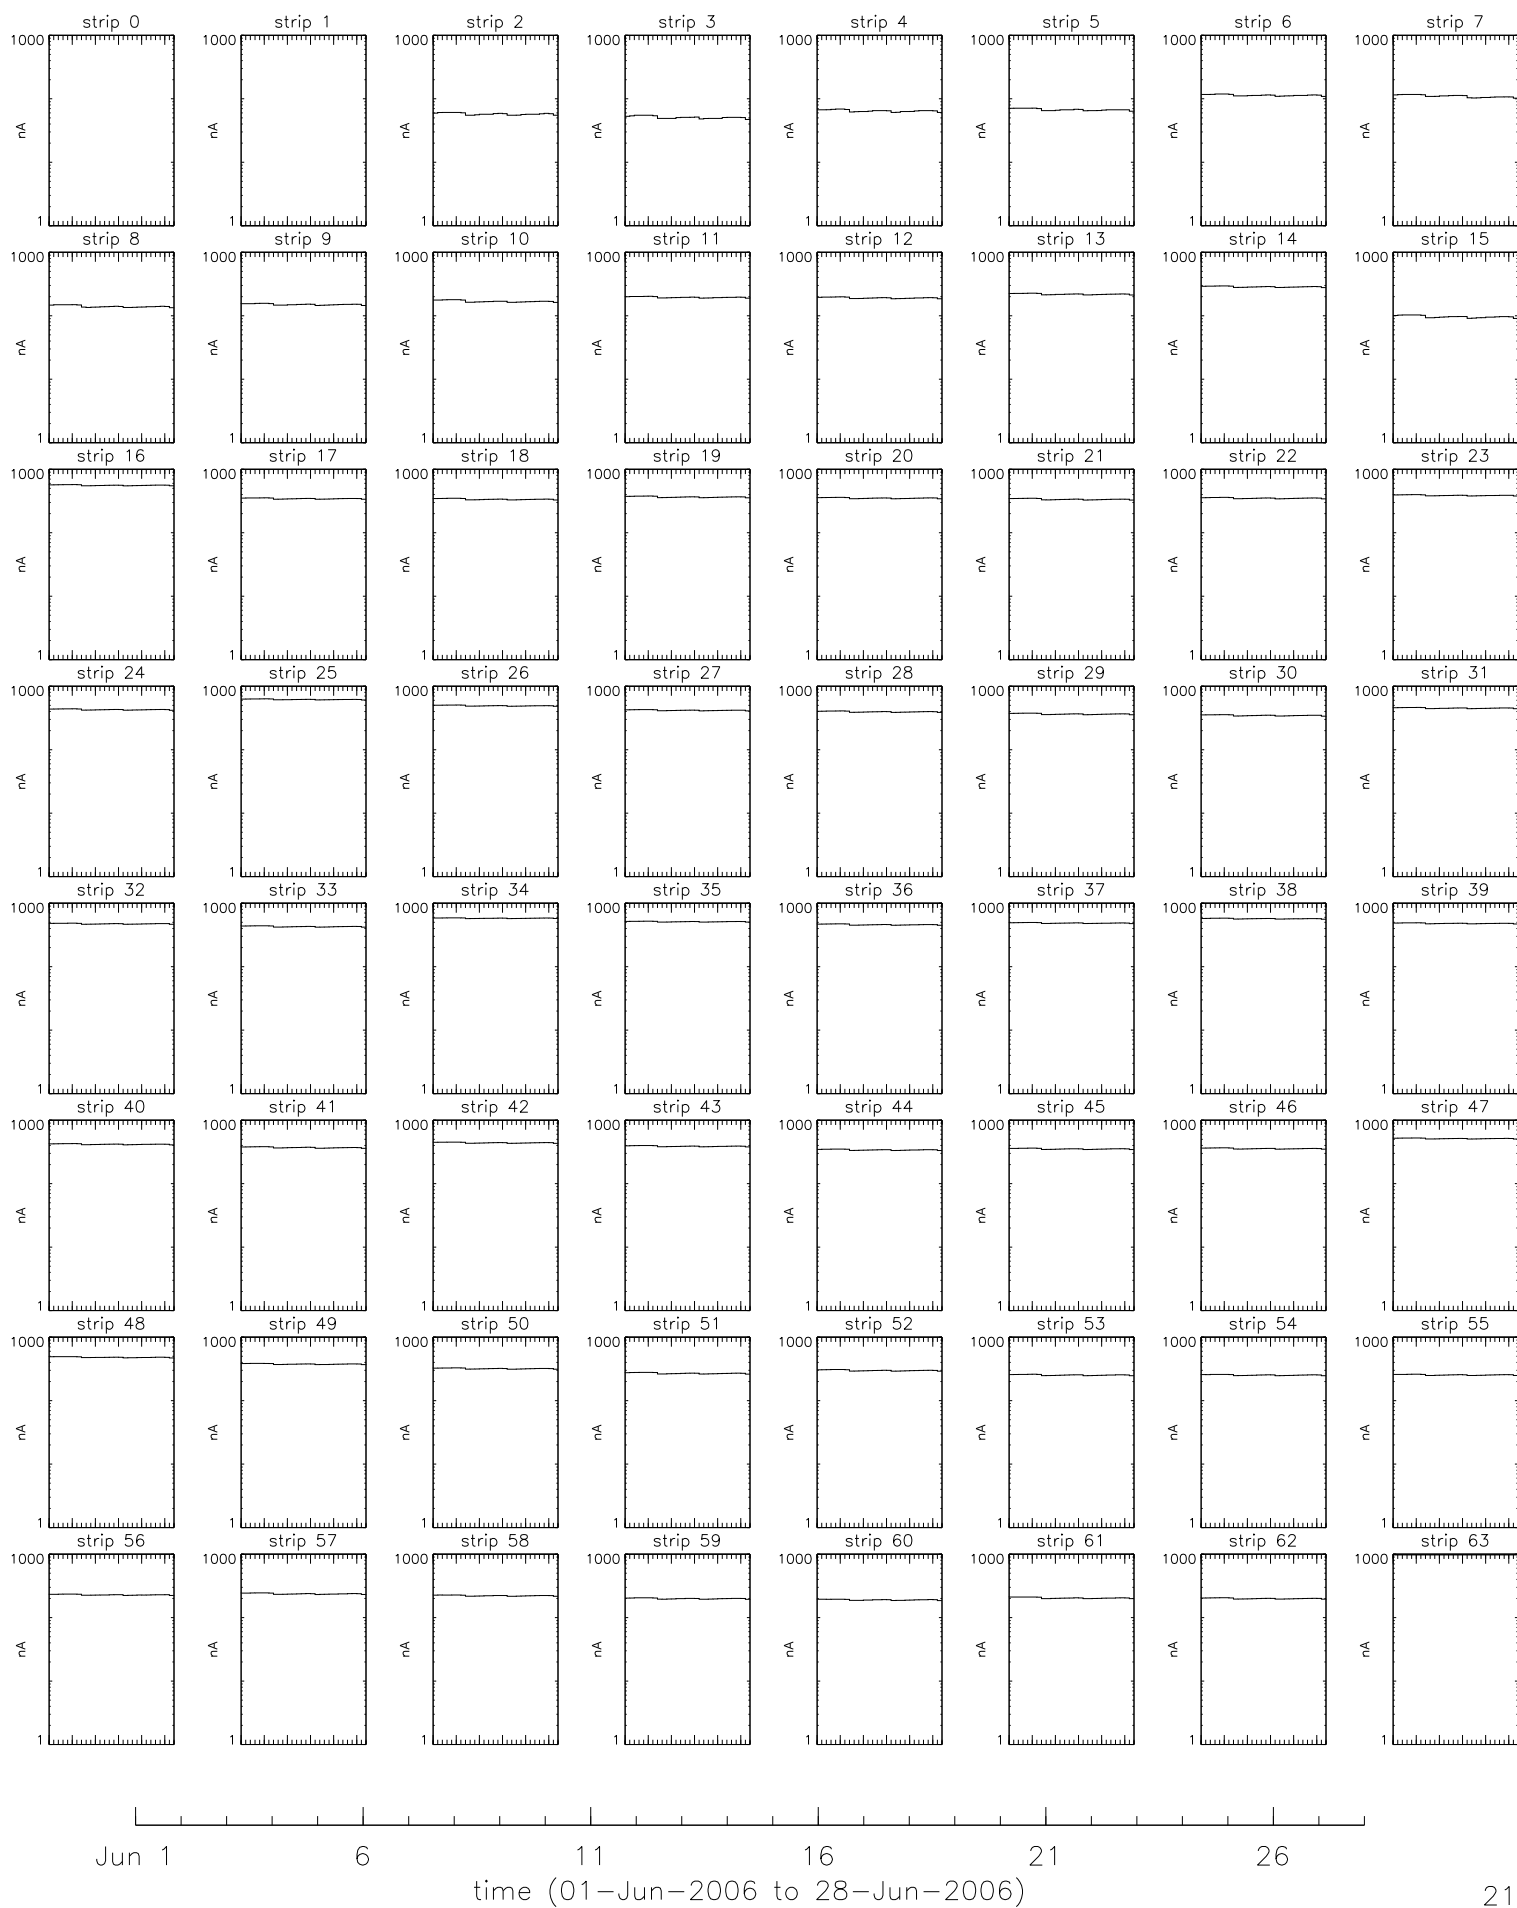

Bartels Rotation 2359 – Daily Averages
Leakage Current – M2B – Ground Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

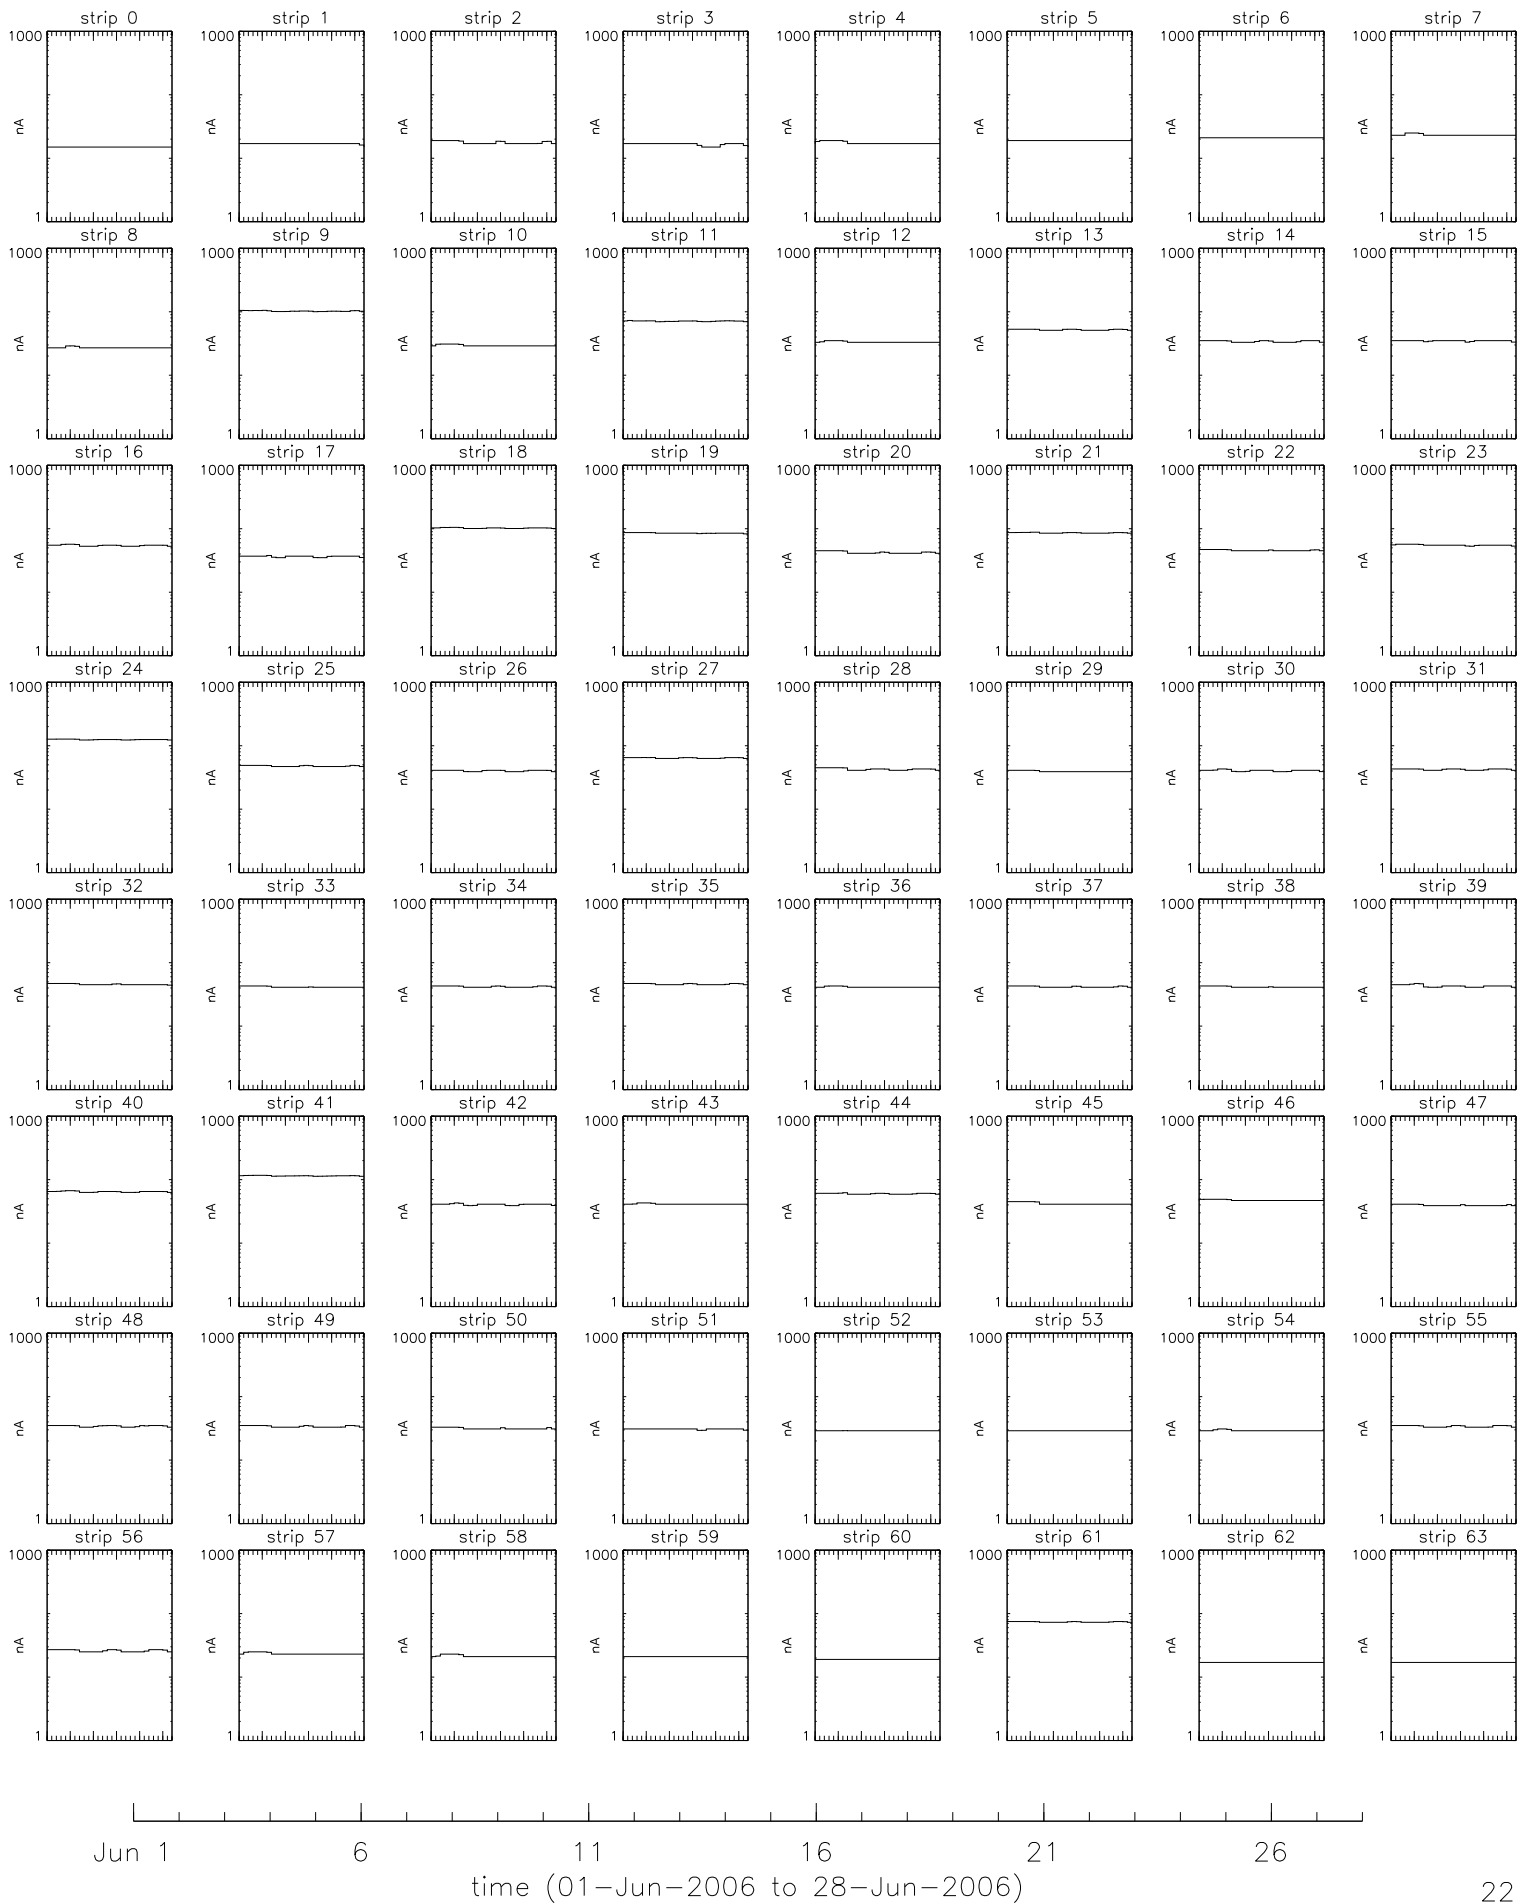

Bartels Rotation 2359 – Daily Averages
Leakage Current – M2B – High Voltage Side
(01-Jun-2006 thru 27-Jun-2006) (152/2006 thru 178/2006)

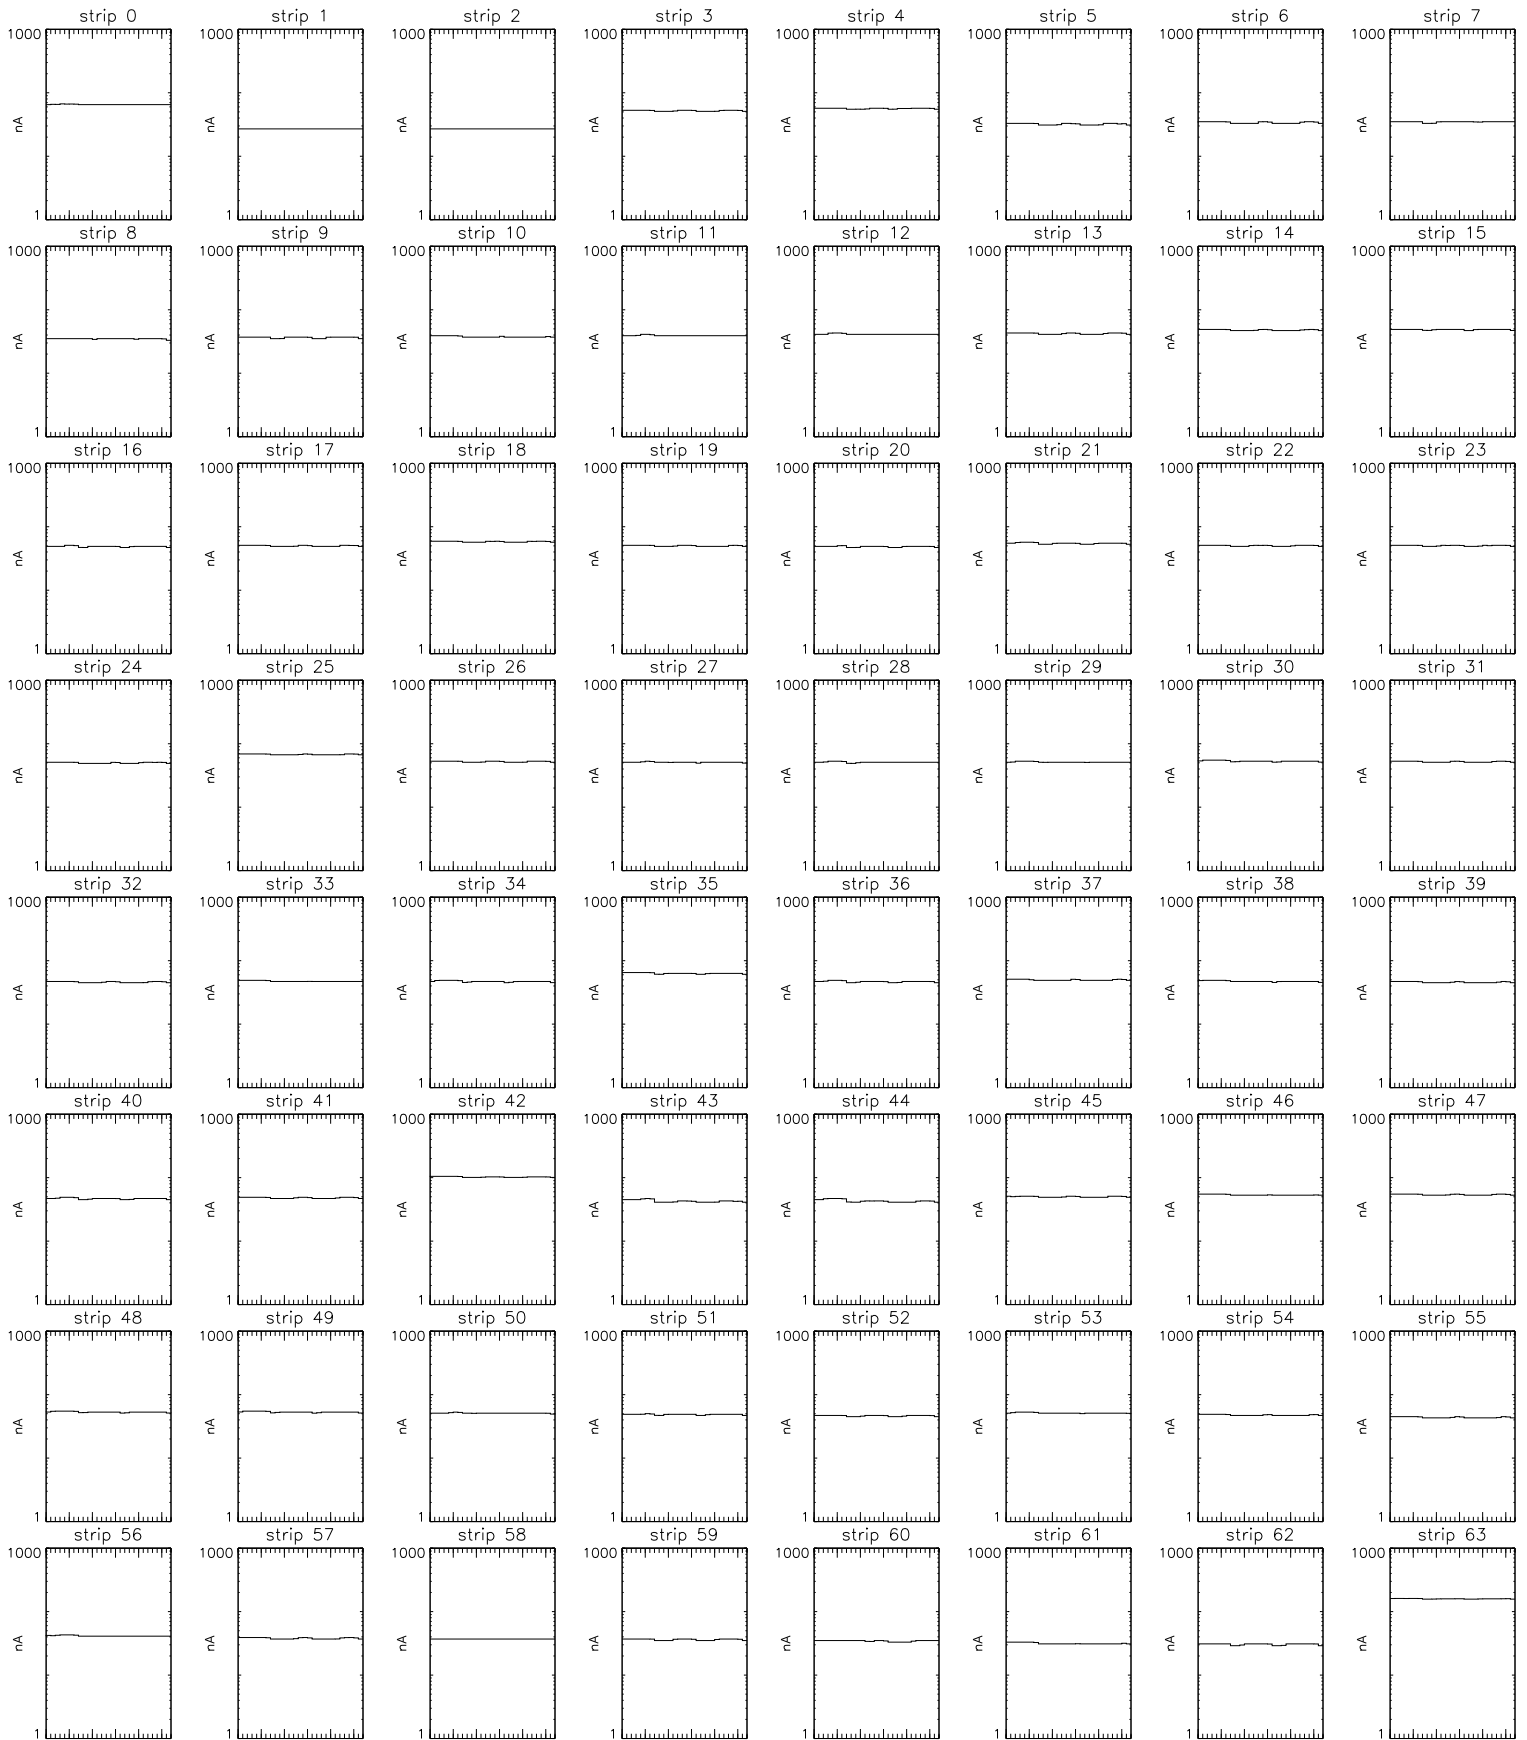

Jun 1 6 11 16 21 26

time (01-Jun-2006 to 28-Jun-2006)