



Bartels Rotation 2399 – Daily Averages
Leakage Current – M1A – Ground Side
(16–May–2009 thru 11–Jun–2009) (136/2009 thru 162/2009)

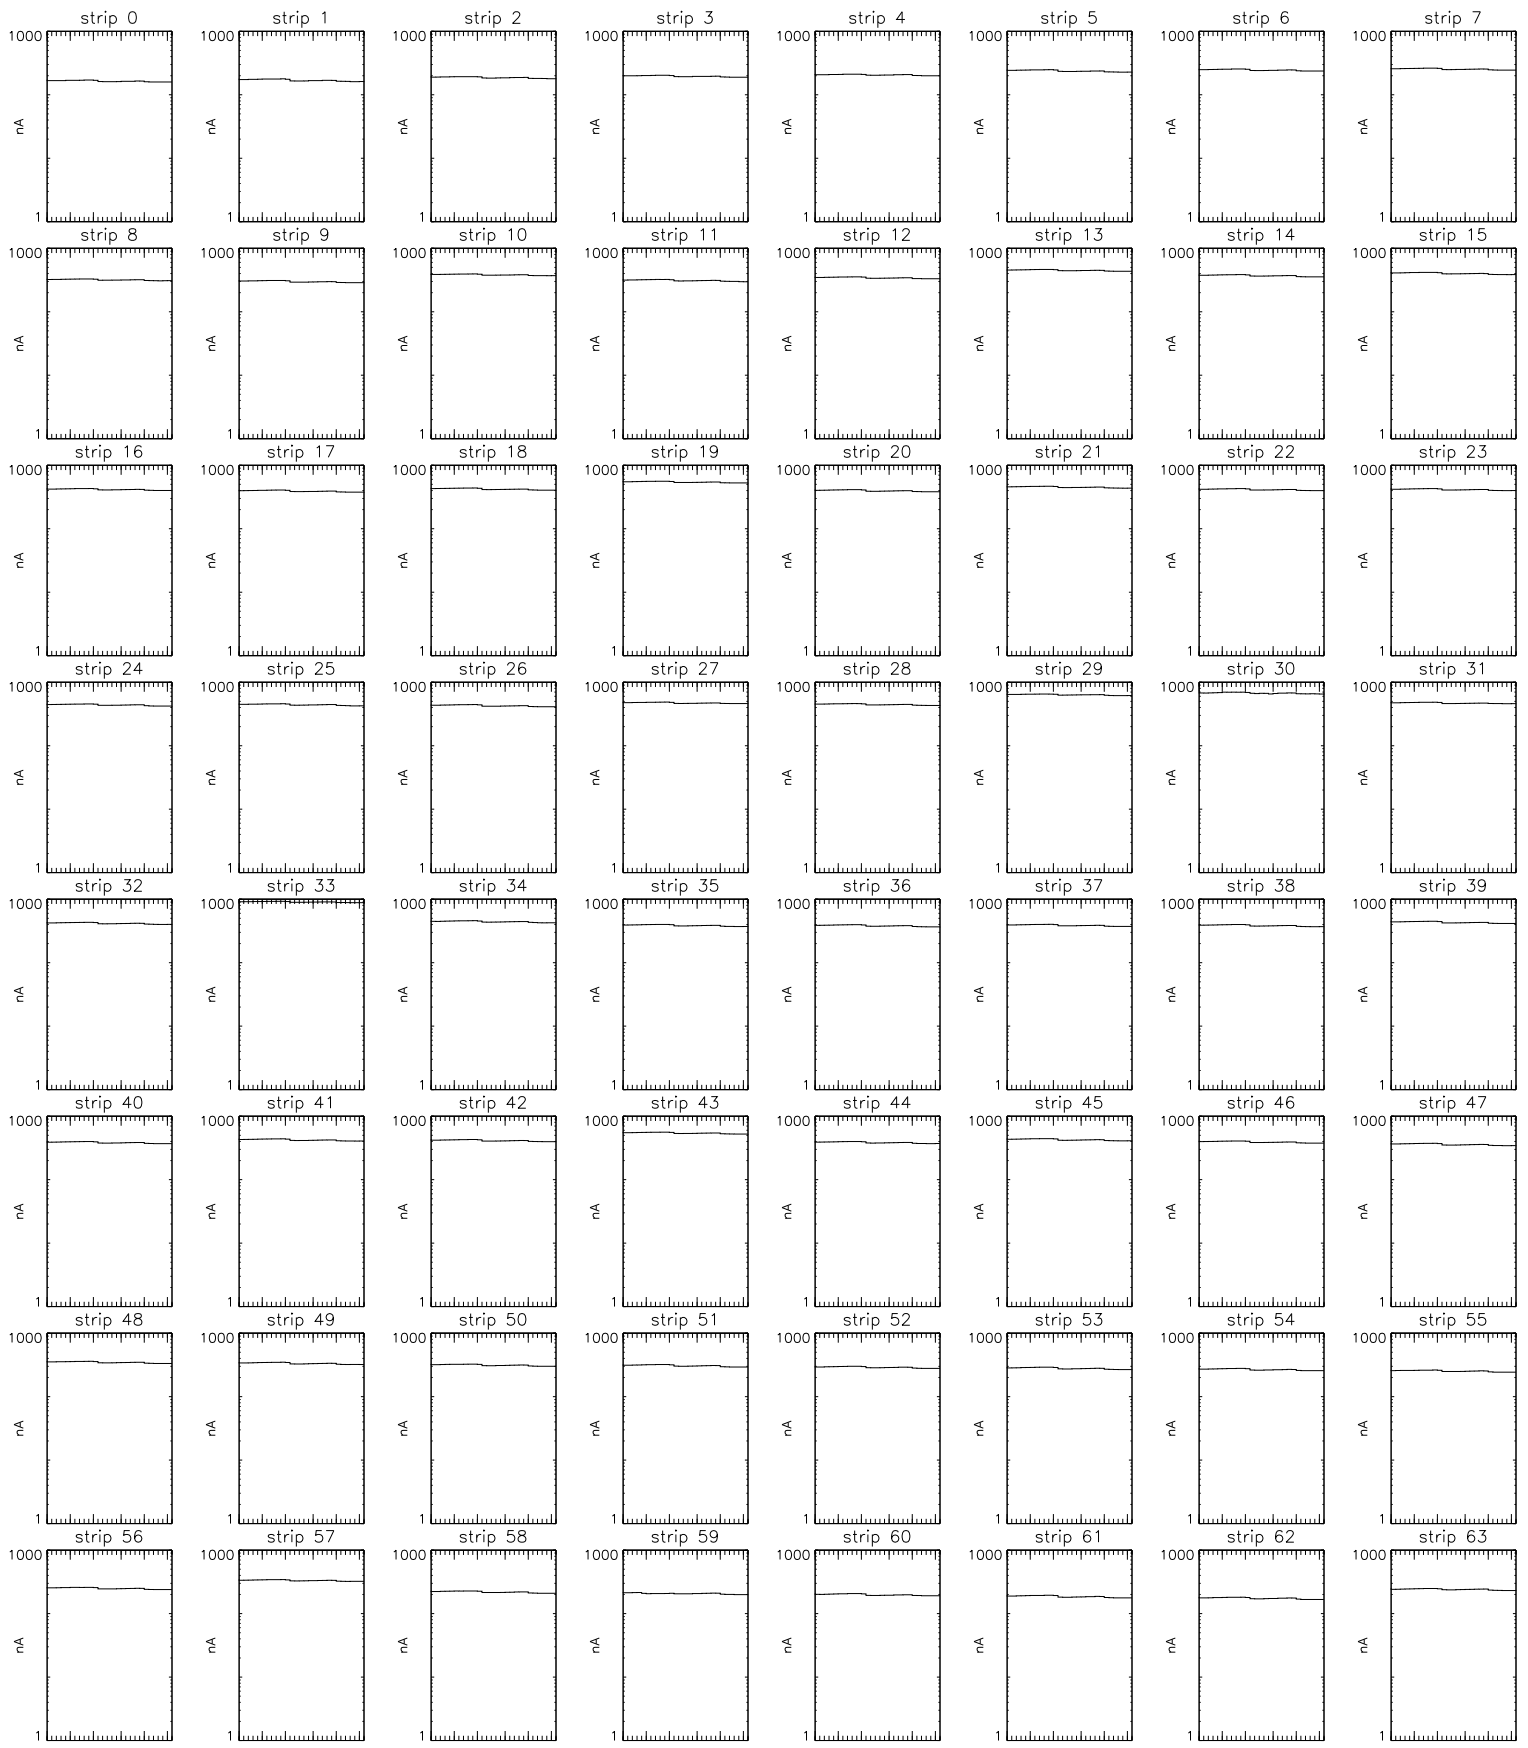


16 21 26 Jun 1 6 11
time (16–May–2009 to 12–Jun–2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M1A – High Voltage Side
(16-May-2009 thru 11-Jun-2009) (136/2009 thru 162/2009)

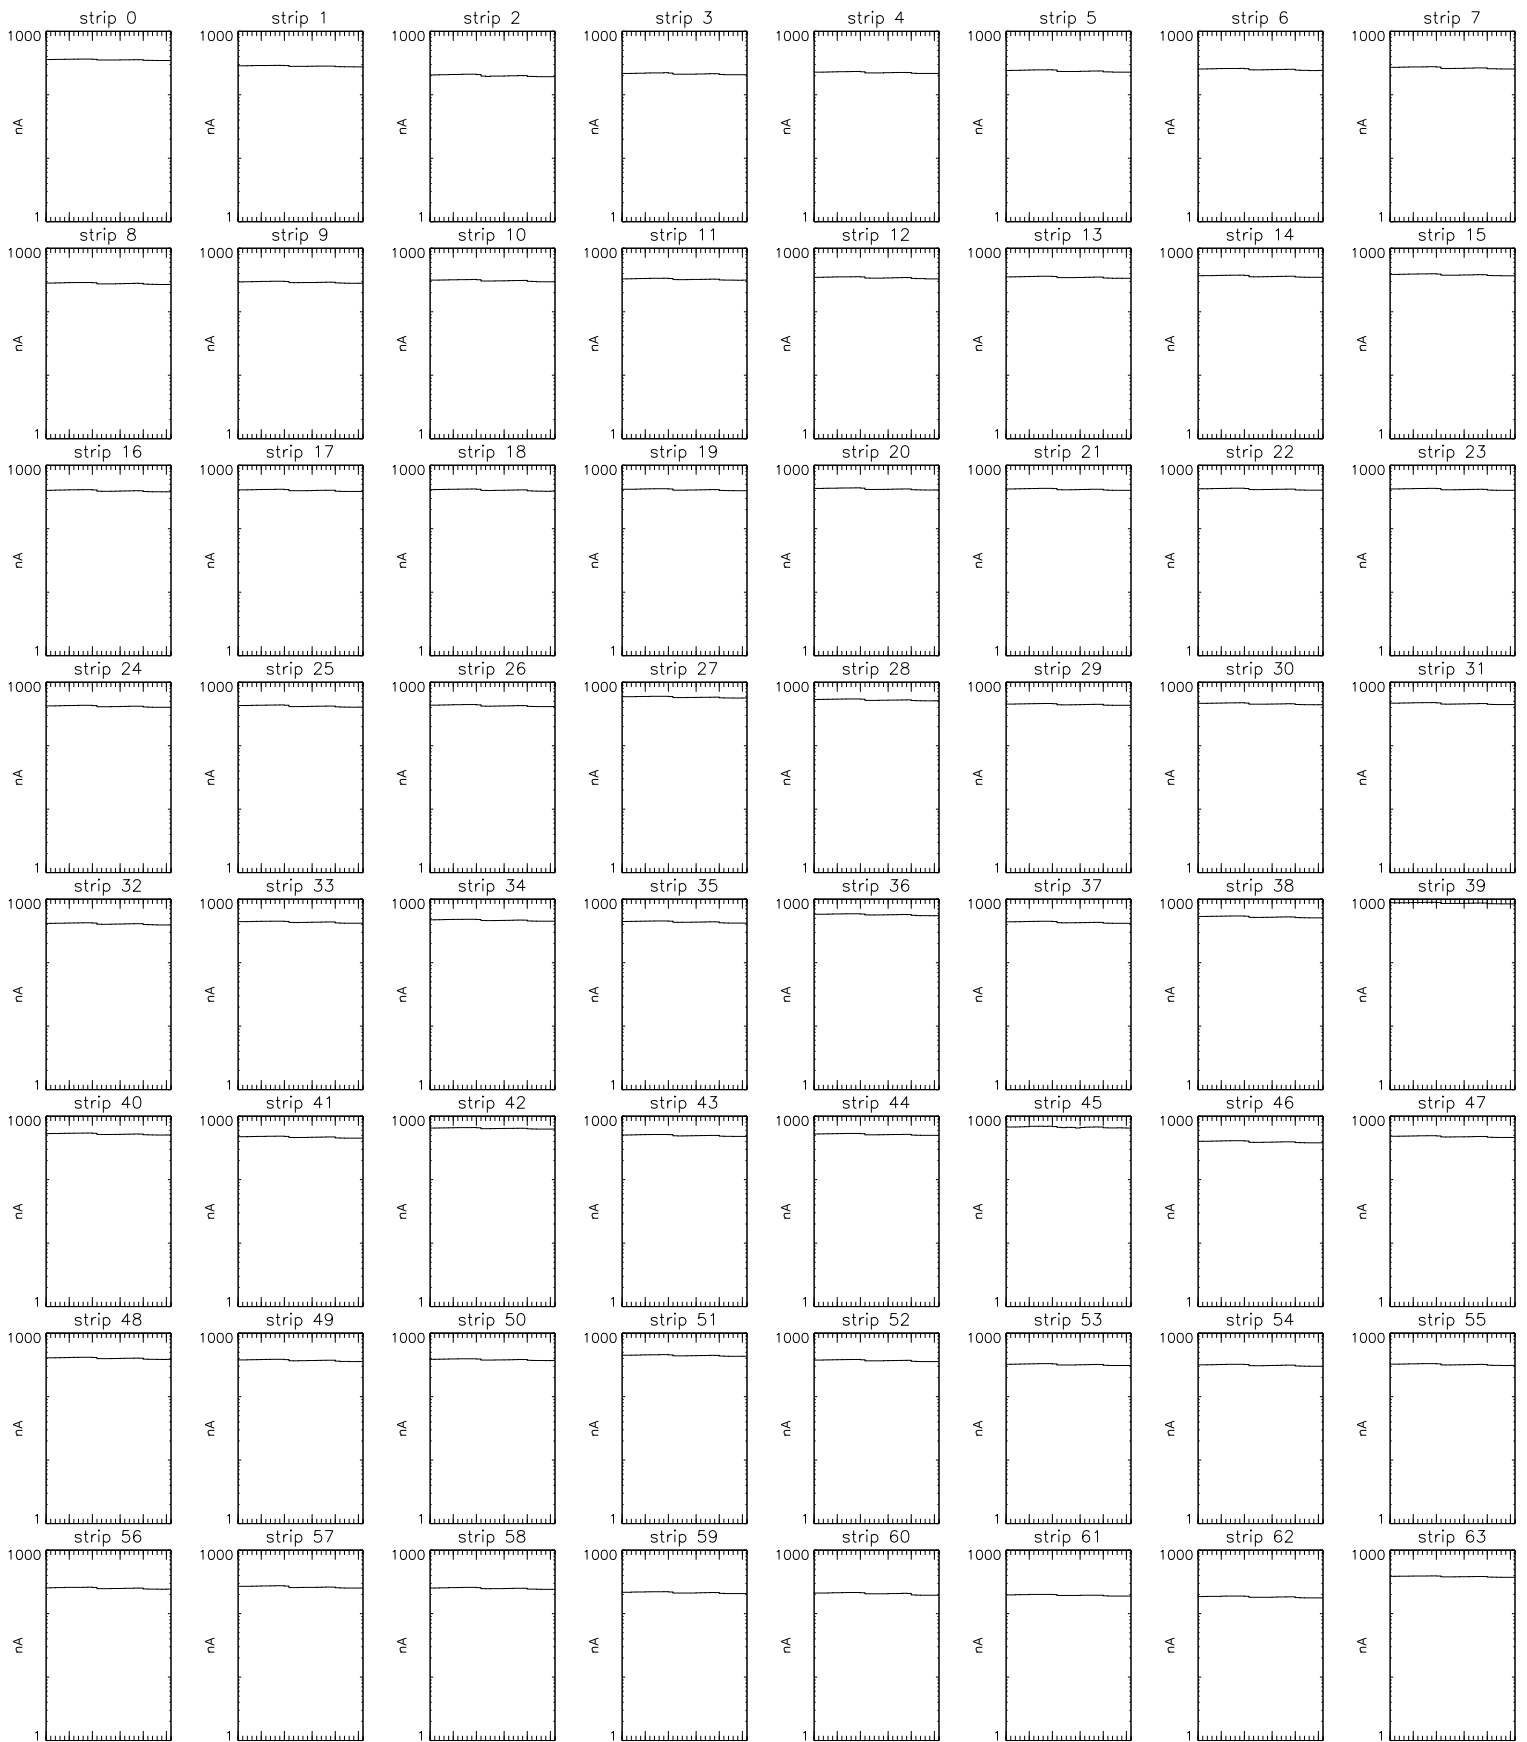


16 21 26 Jun 1 6 11
time (16-May-2009 to 12-Jun-2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M2A – Ground Side
(16-May-2009 thru 11-Jun-2009) (136/2009 thru 162/2009)

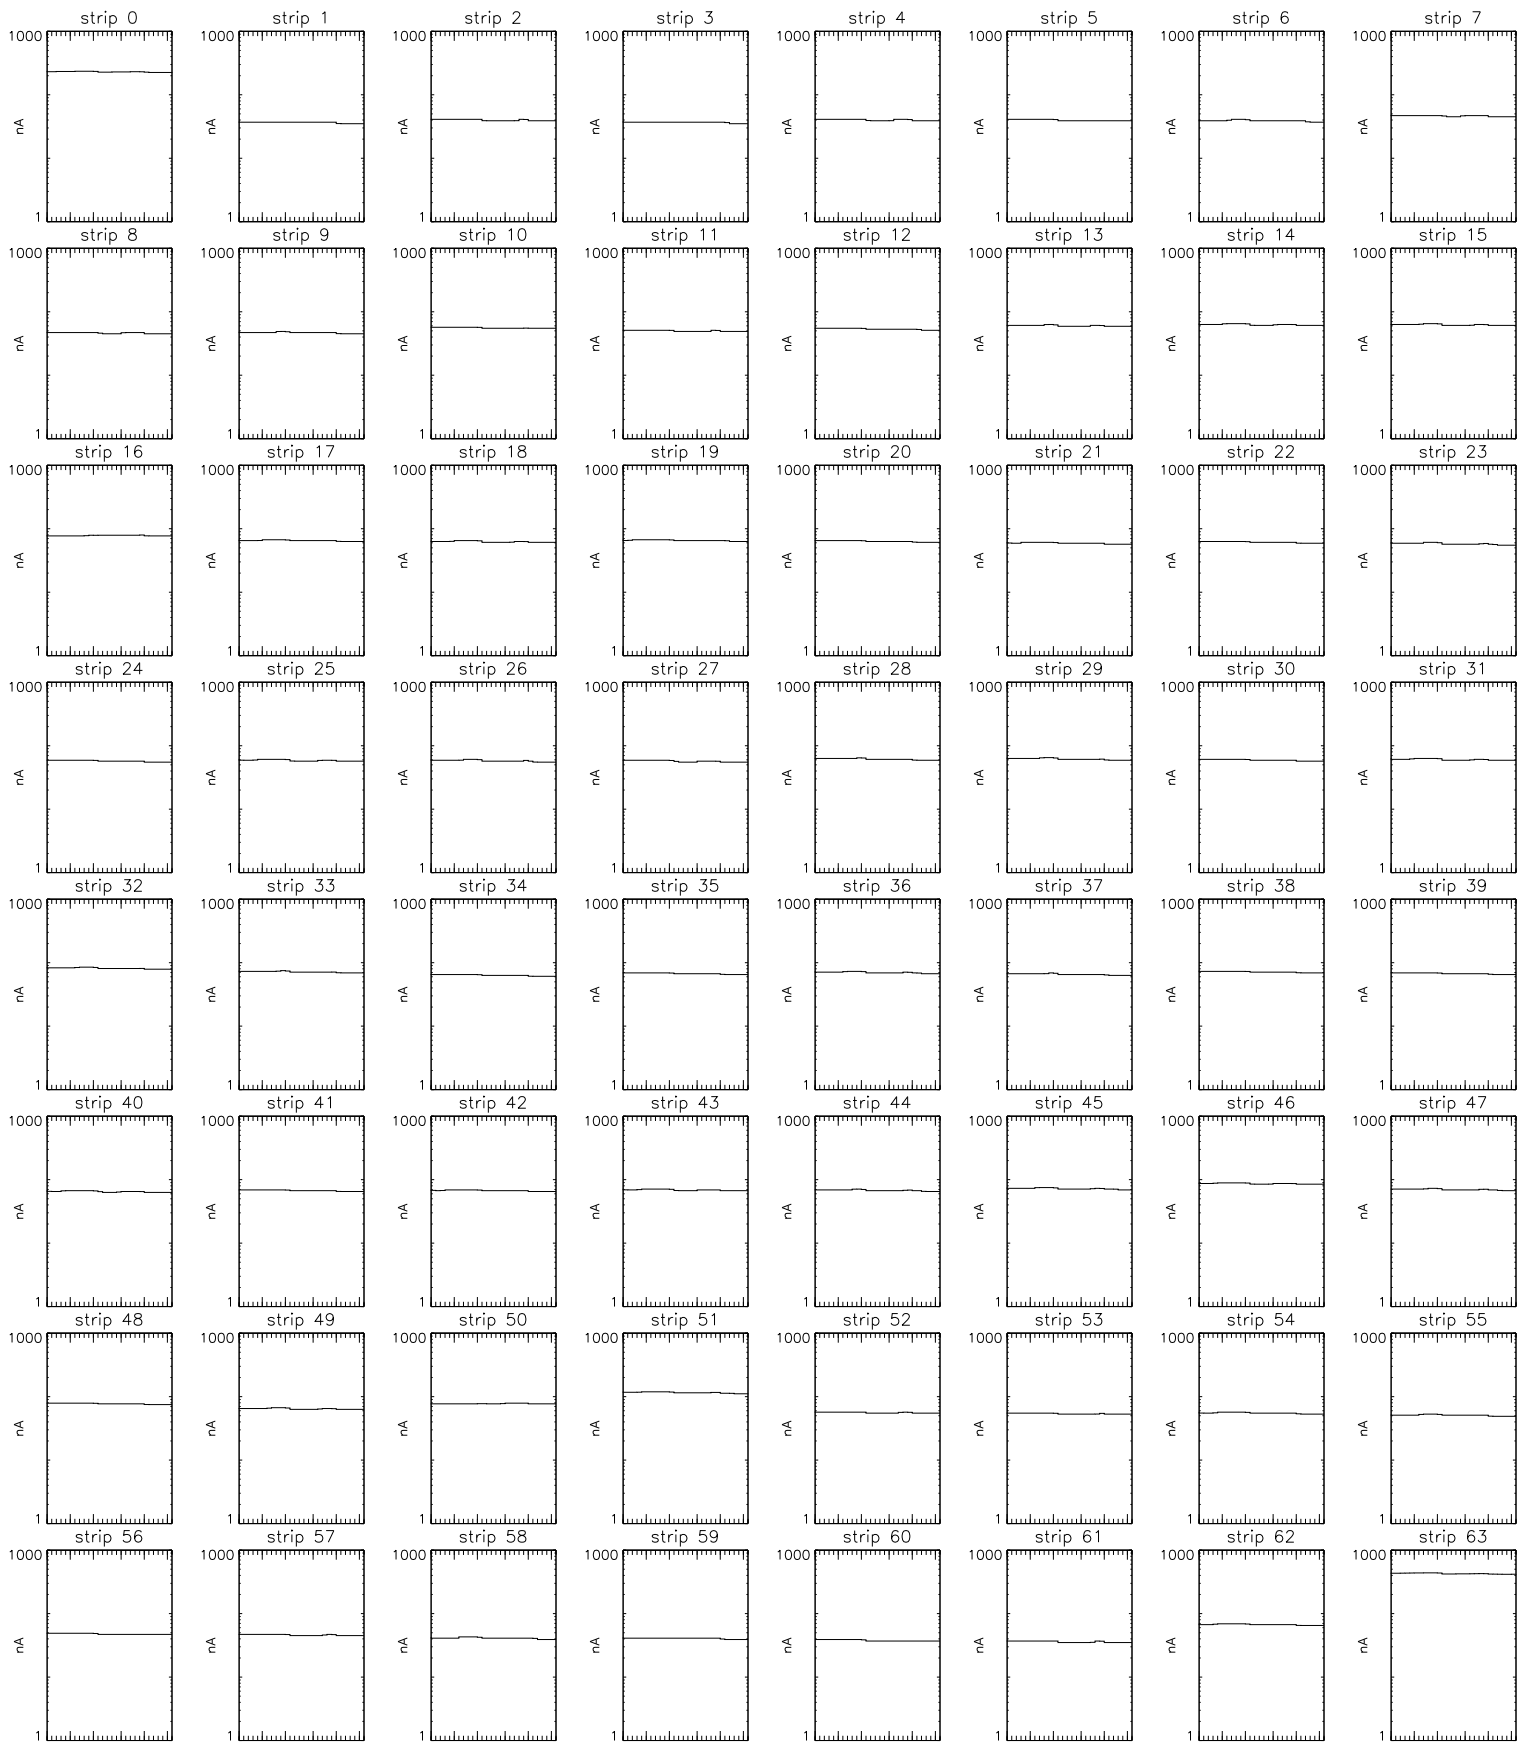


16 21 26 Jun 1 6 11
time (16-May-2009 to 12-Jun-2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M2A – High Voltage Side
(16-May-2009 thru 11-Jun-2009) (136/2009 thru 162/2009)

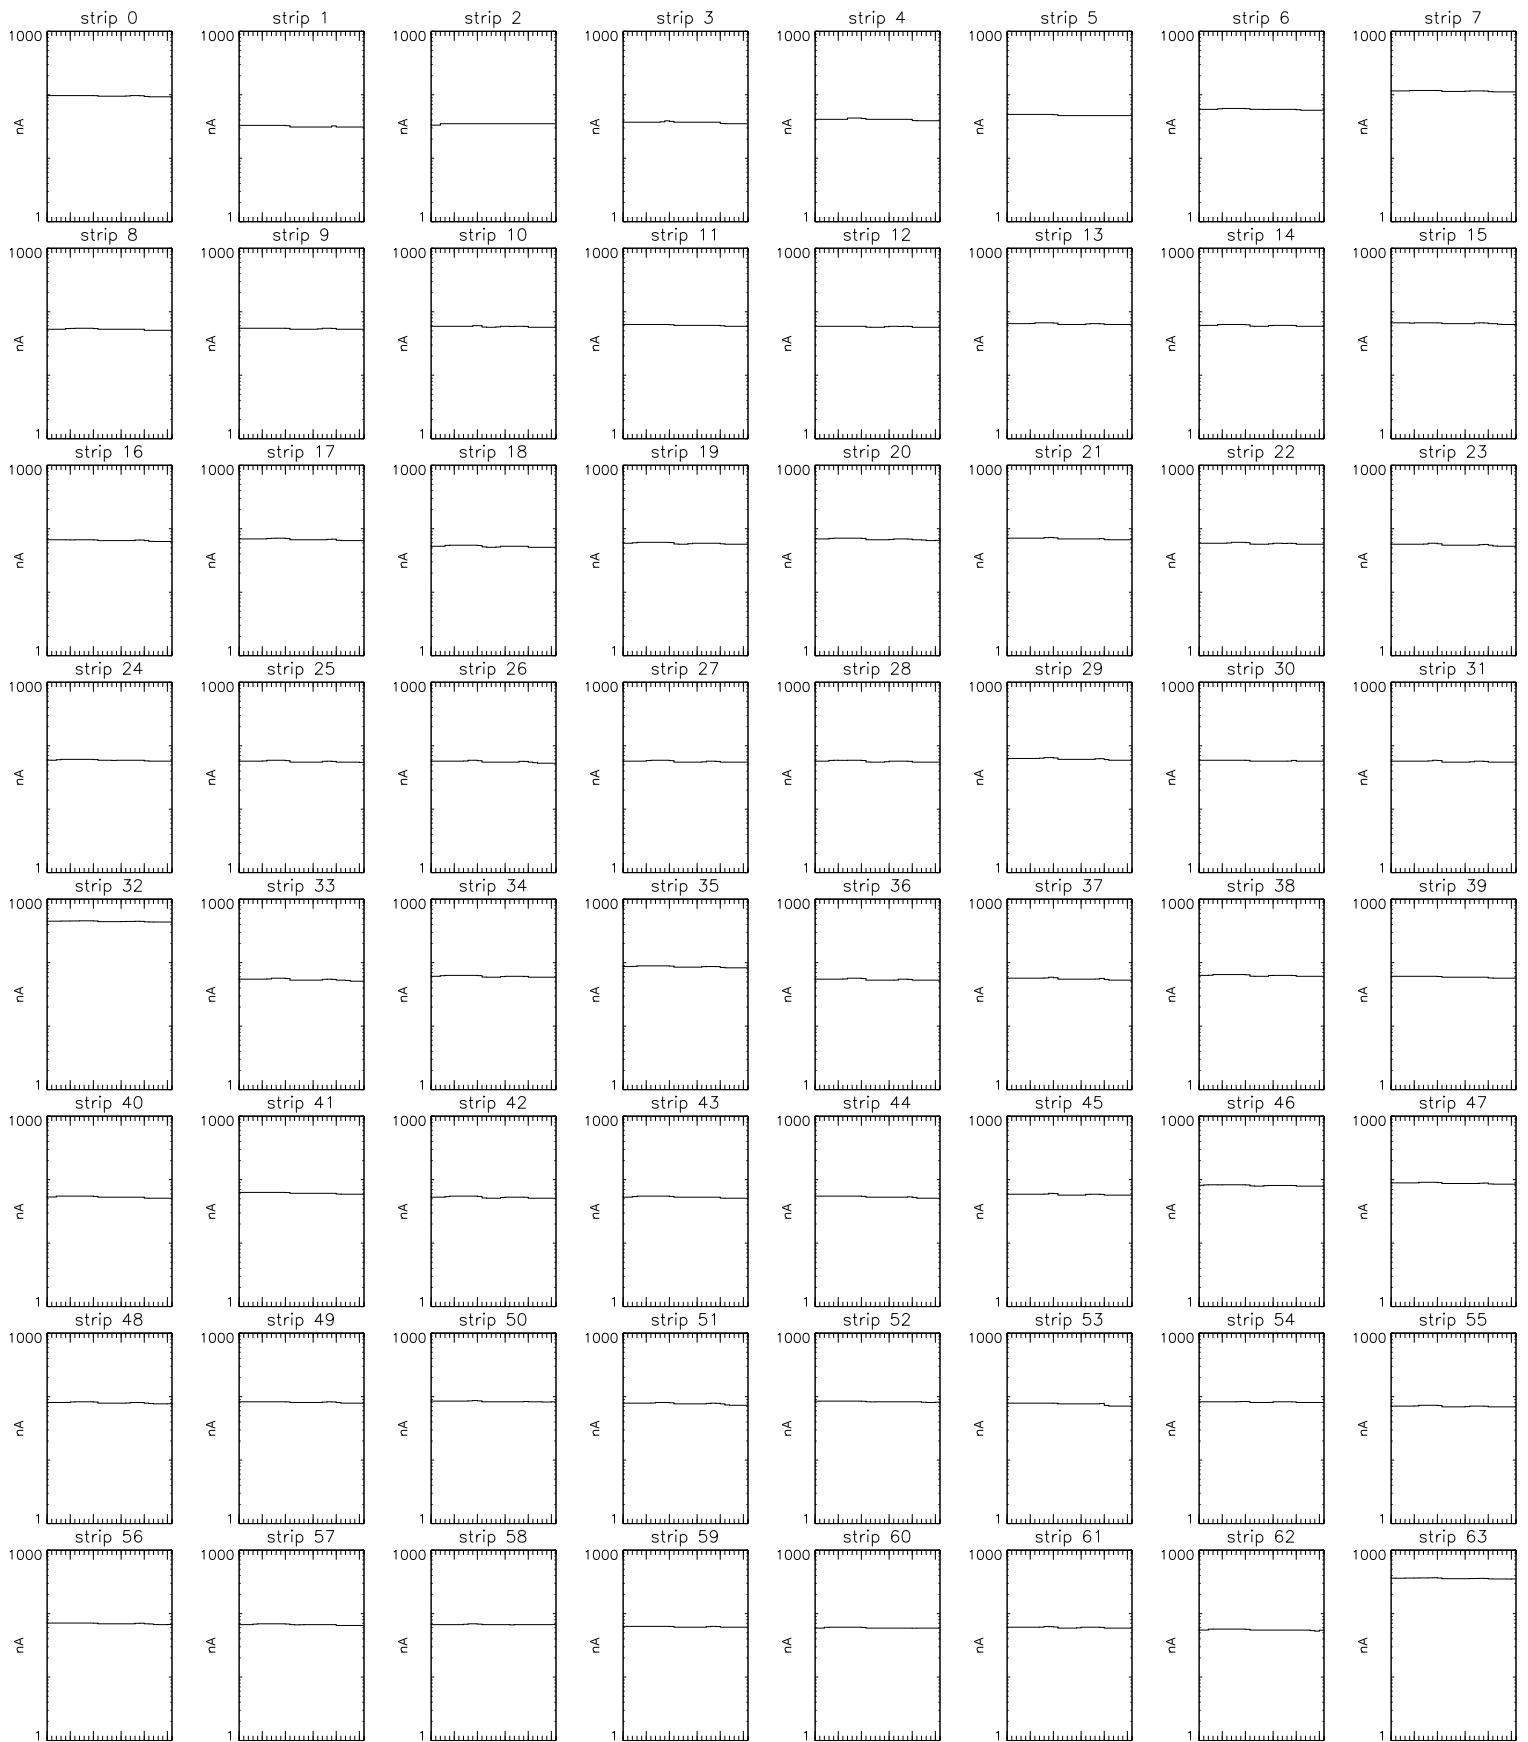


16 21 26 Jun 1 6 11
time (16-May-2009 to 12-Jun-2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M1B – Ground Side
(16–May–2009 thru 11–Jun–2009) (136/2009 thru 162/2009)

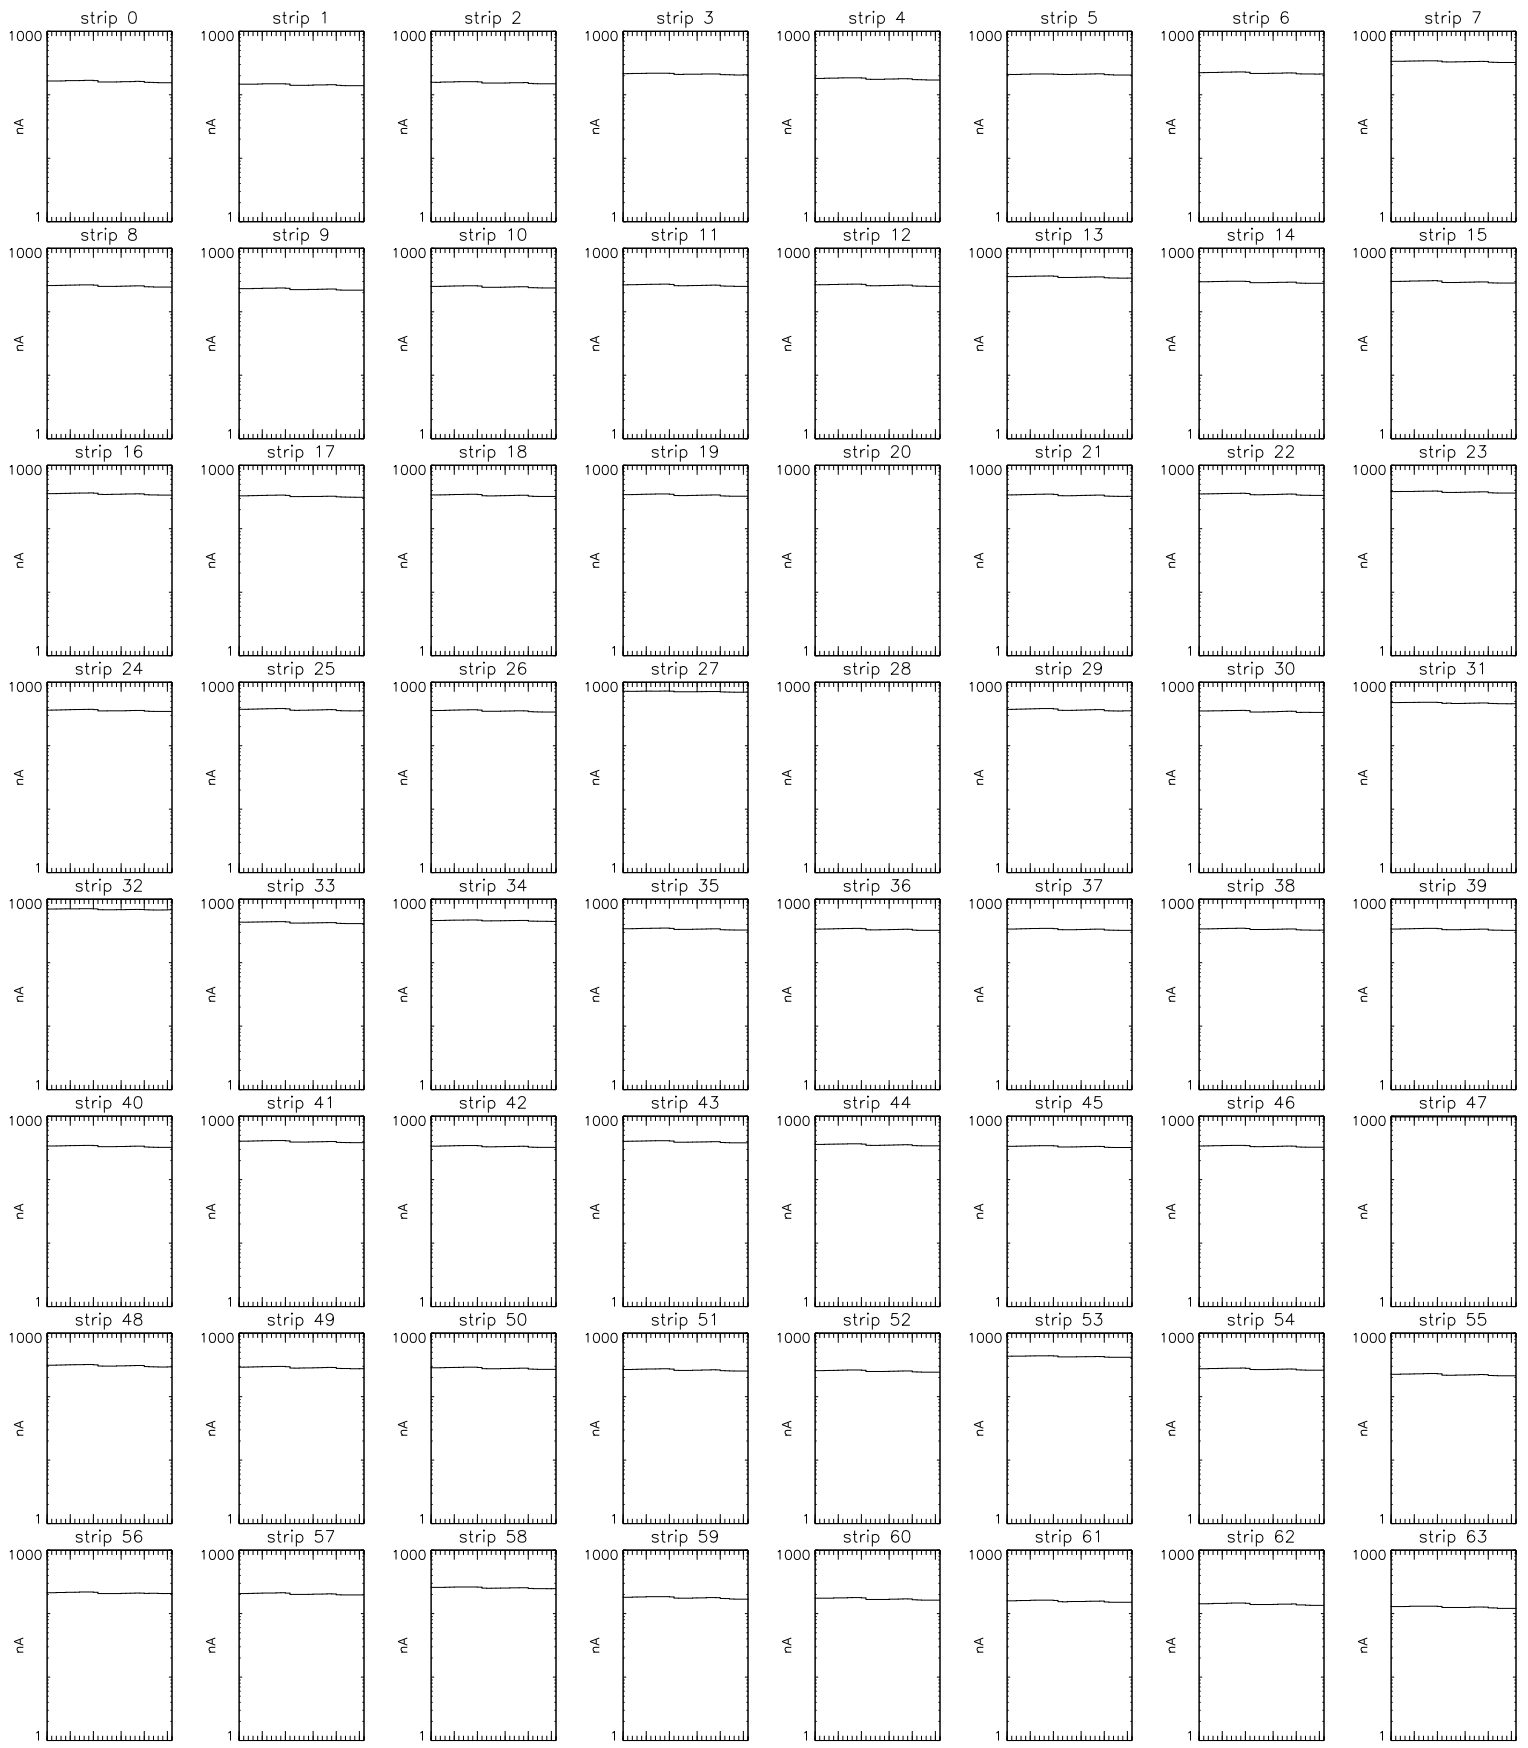


16 21 26 Jun 1 6 11
time (16–May–2009 to 12–Jun–2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M1B – High Voltage Side
(16-May-2009 thru 11-Jun-2009) (136/2009 thru 162/2009)

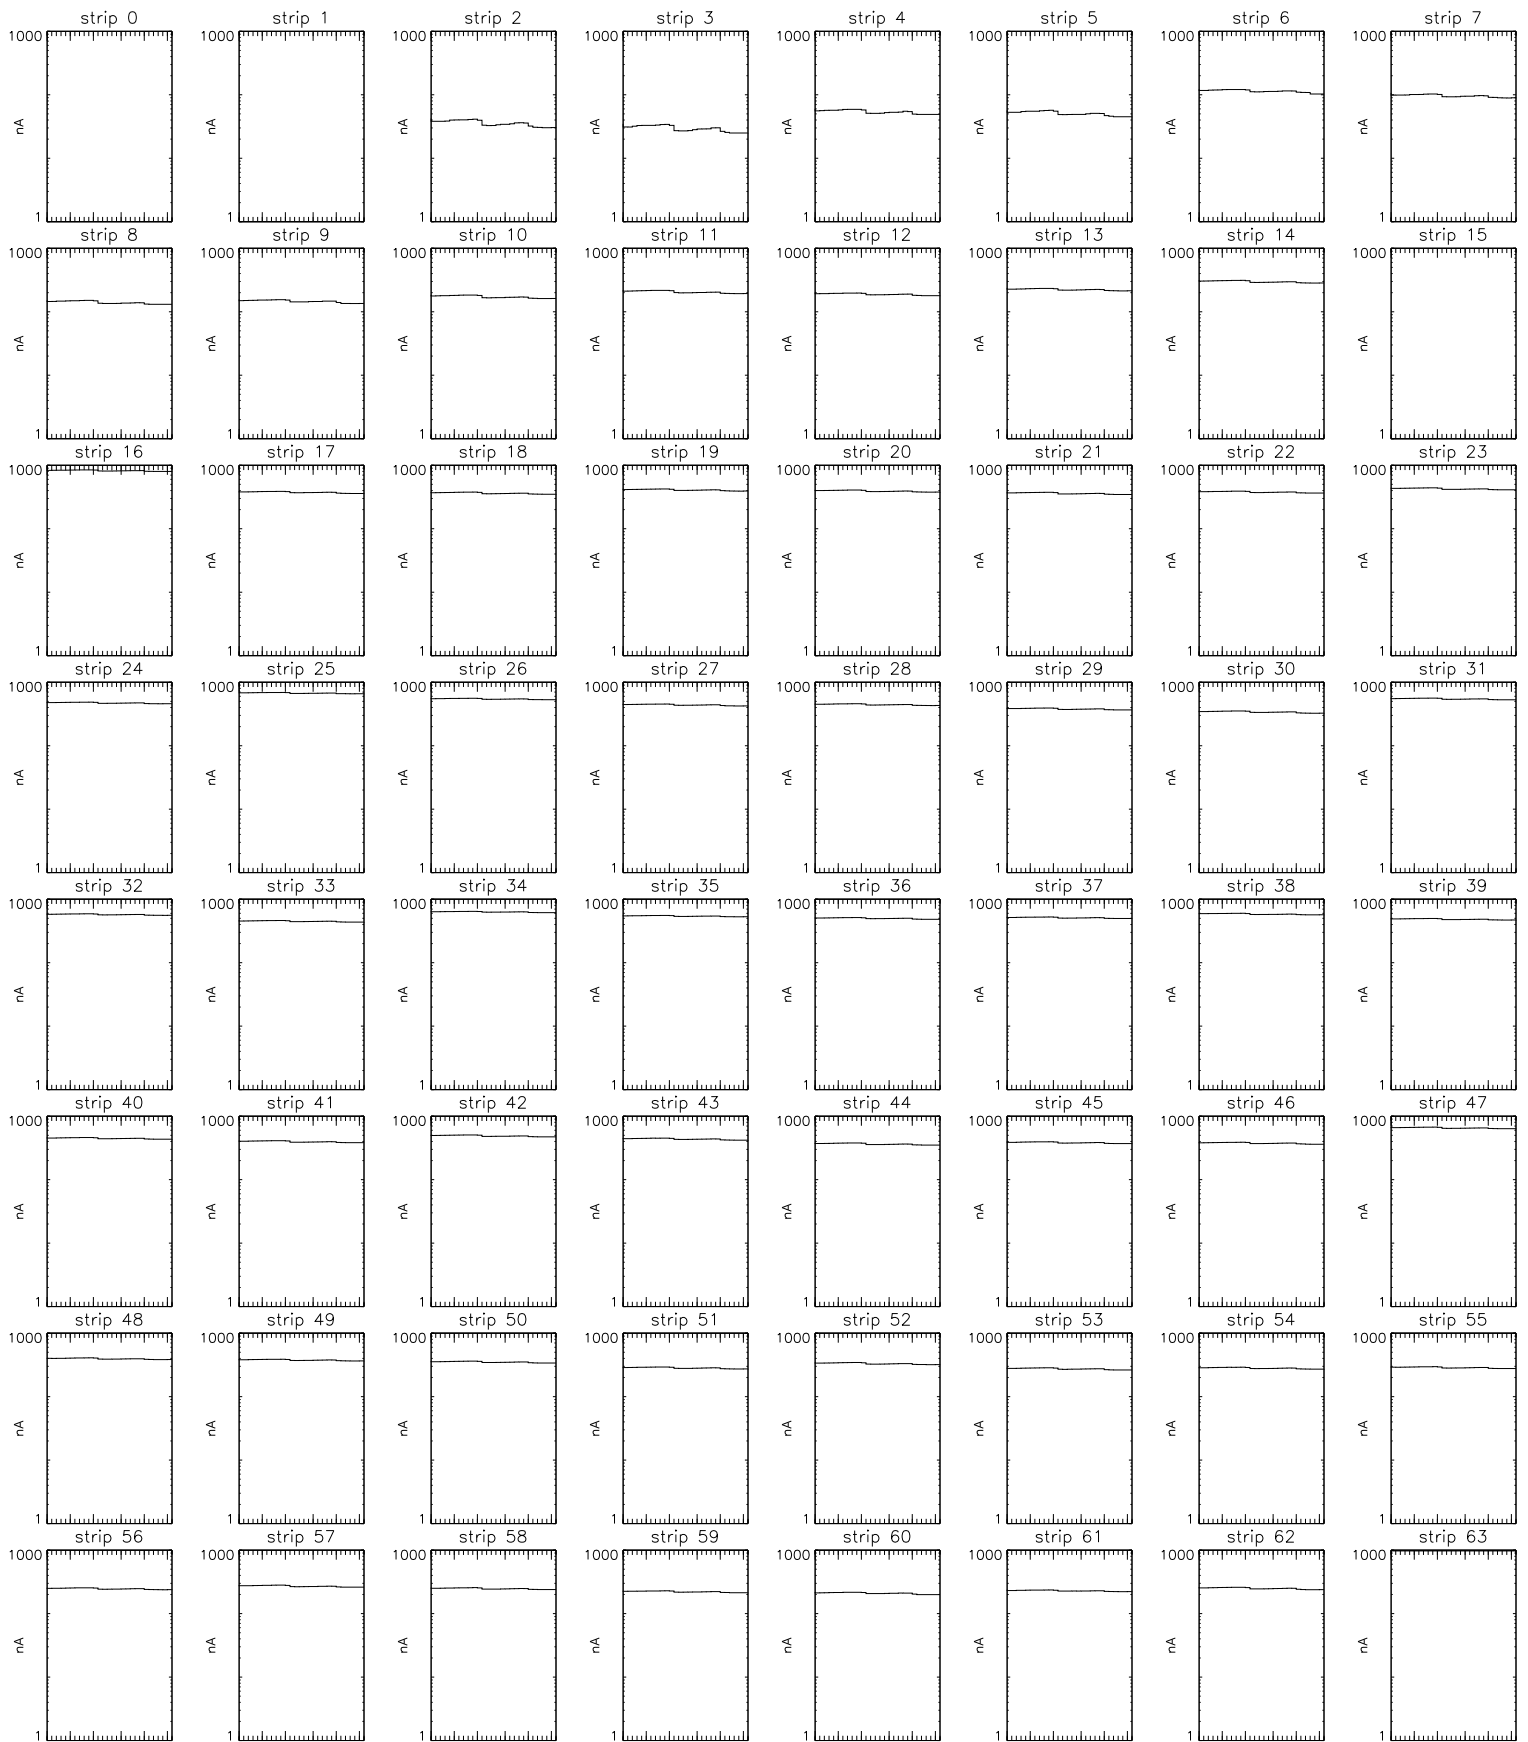


16 21 26 Jun 1 6 11
time (16-May-2009 to 12-Jun-2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M2B – Ground Side
(16–May–2009 thru 11–Jun–2009) (136/2009 thru 162/2009)

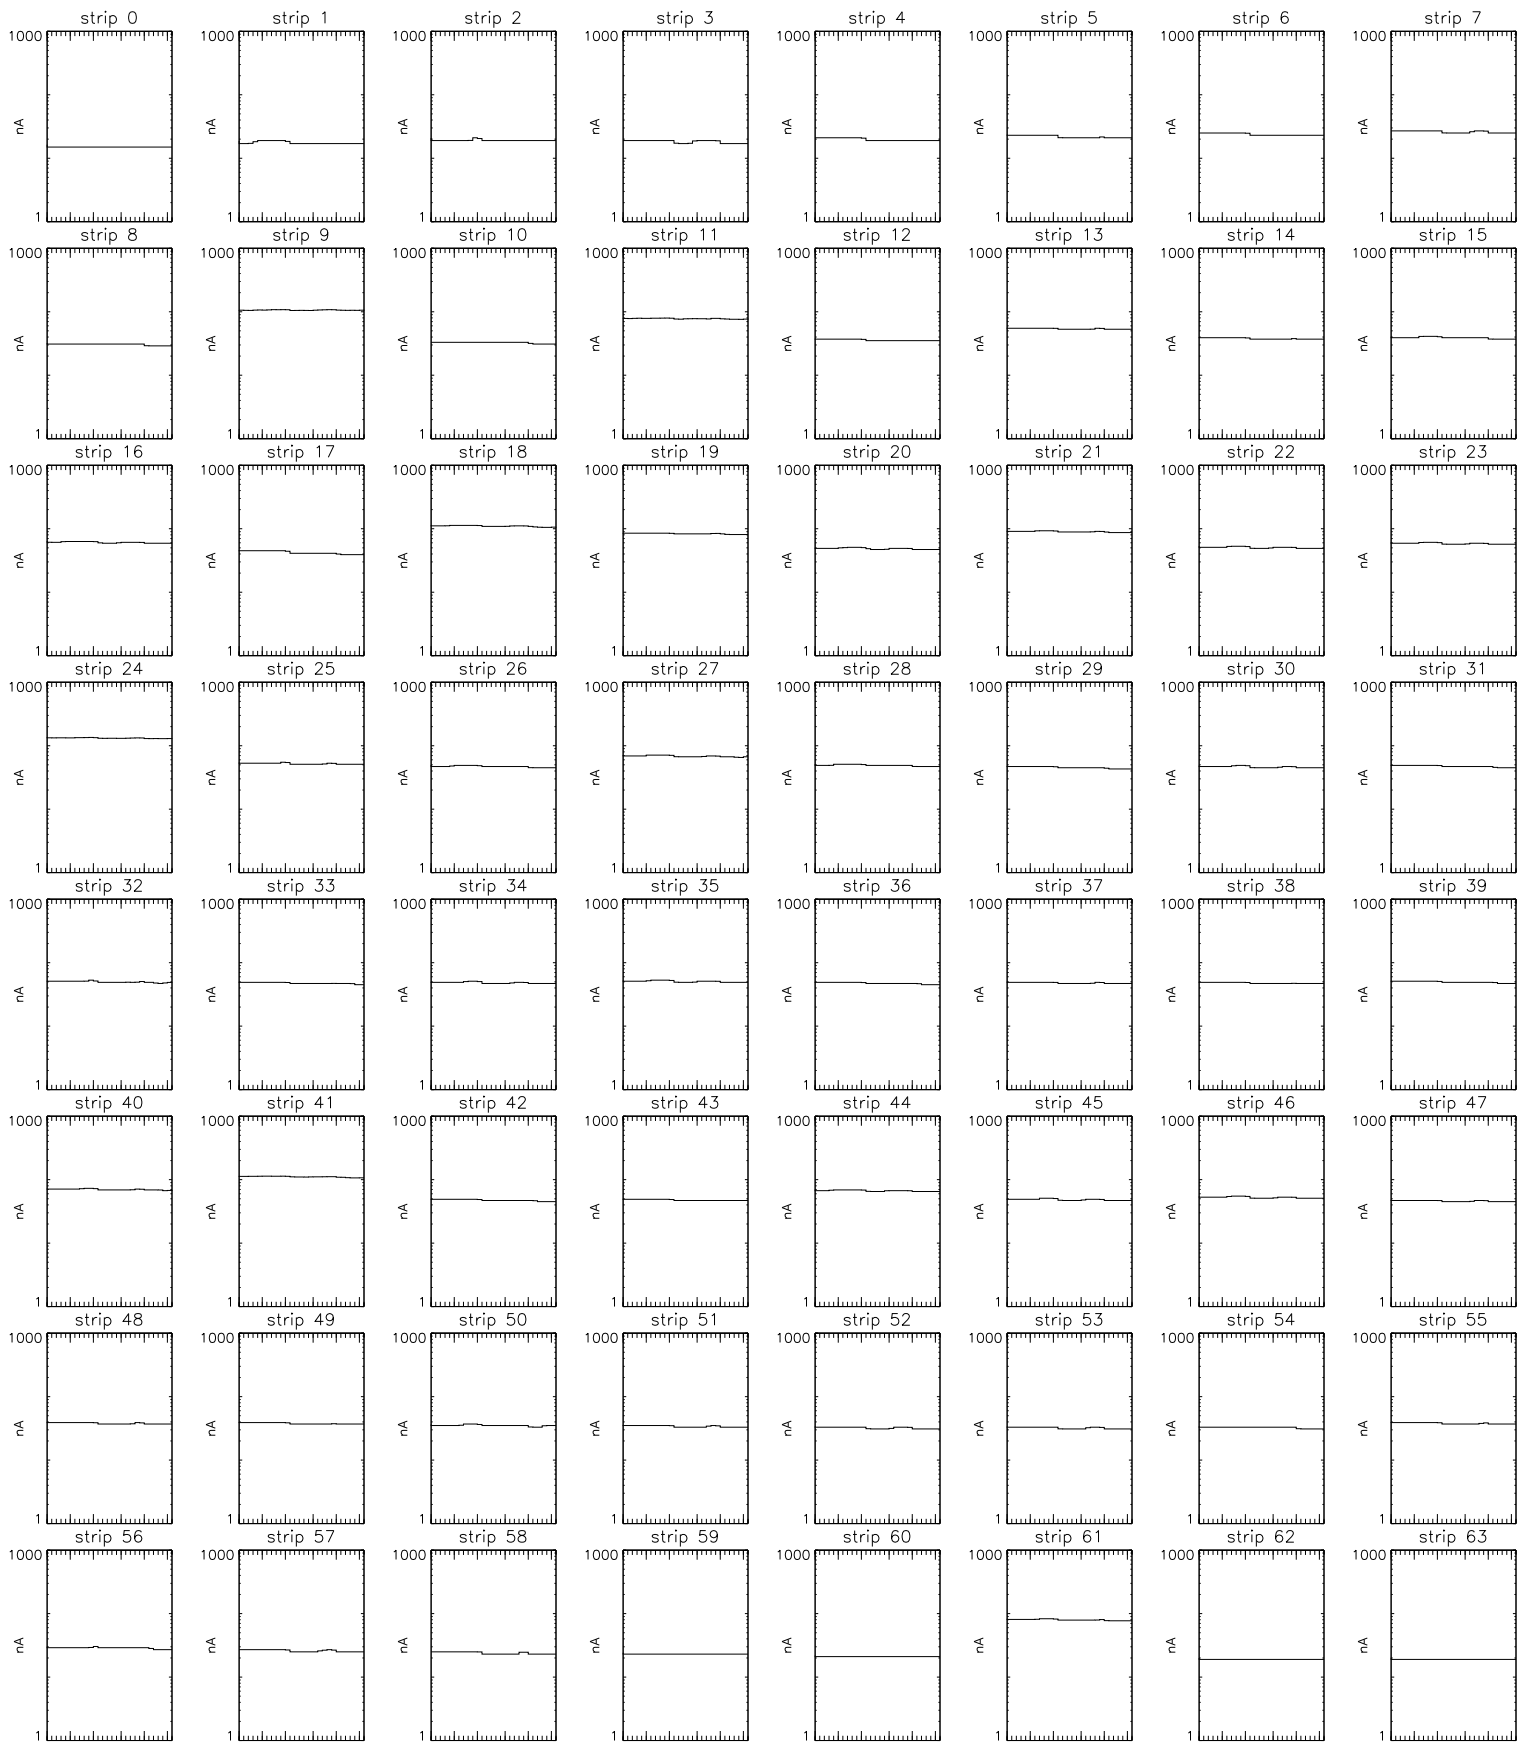

16 21 26 Jun 1 6 11
time (16–May–2009 to 12–Jun–2009)

Bartels Rotation 2399 – Daily Averages
Leakage Current – M2B – High Voltage Side
(16-May-2009 thru 11-Jun-2009) (136/2009 thru 162/2009)

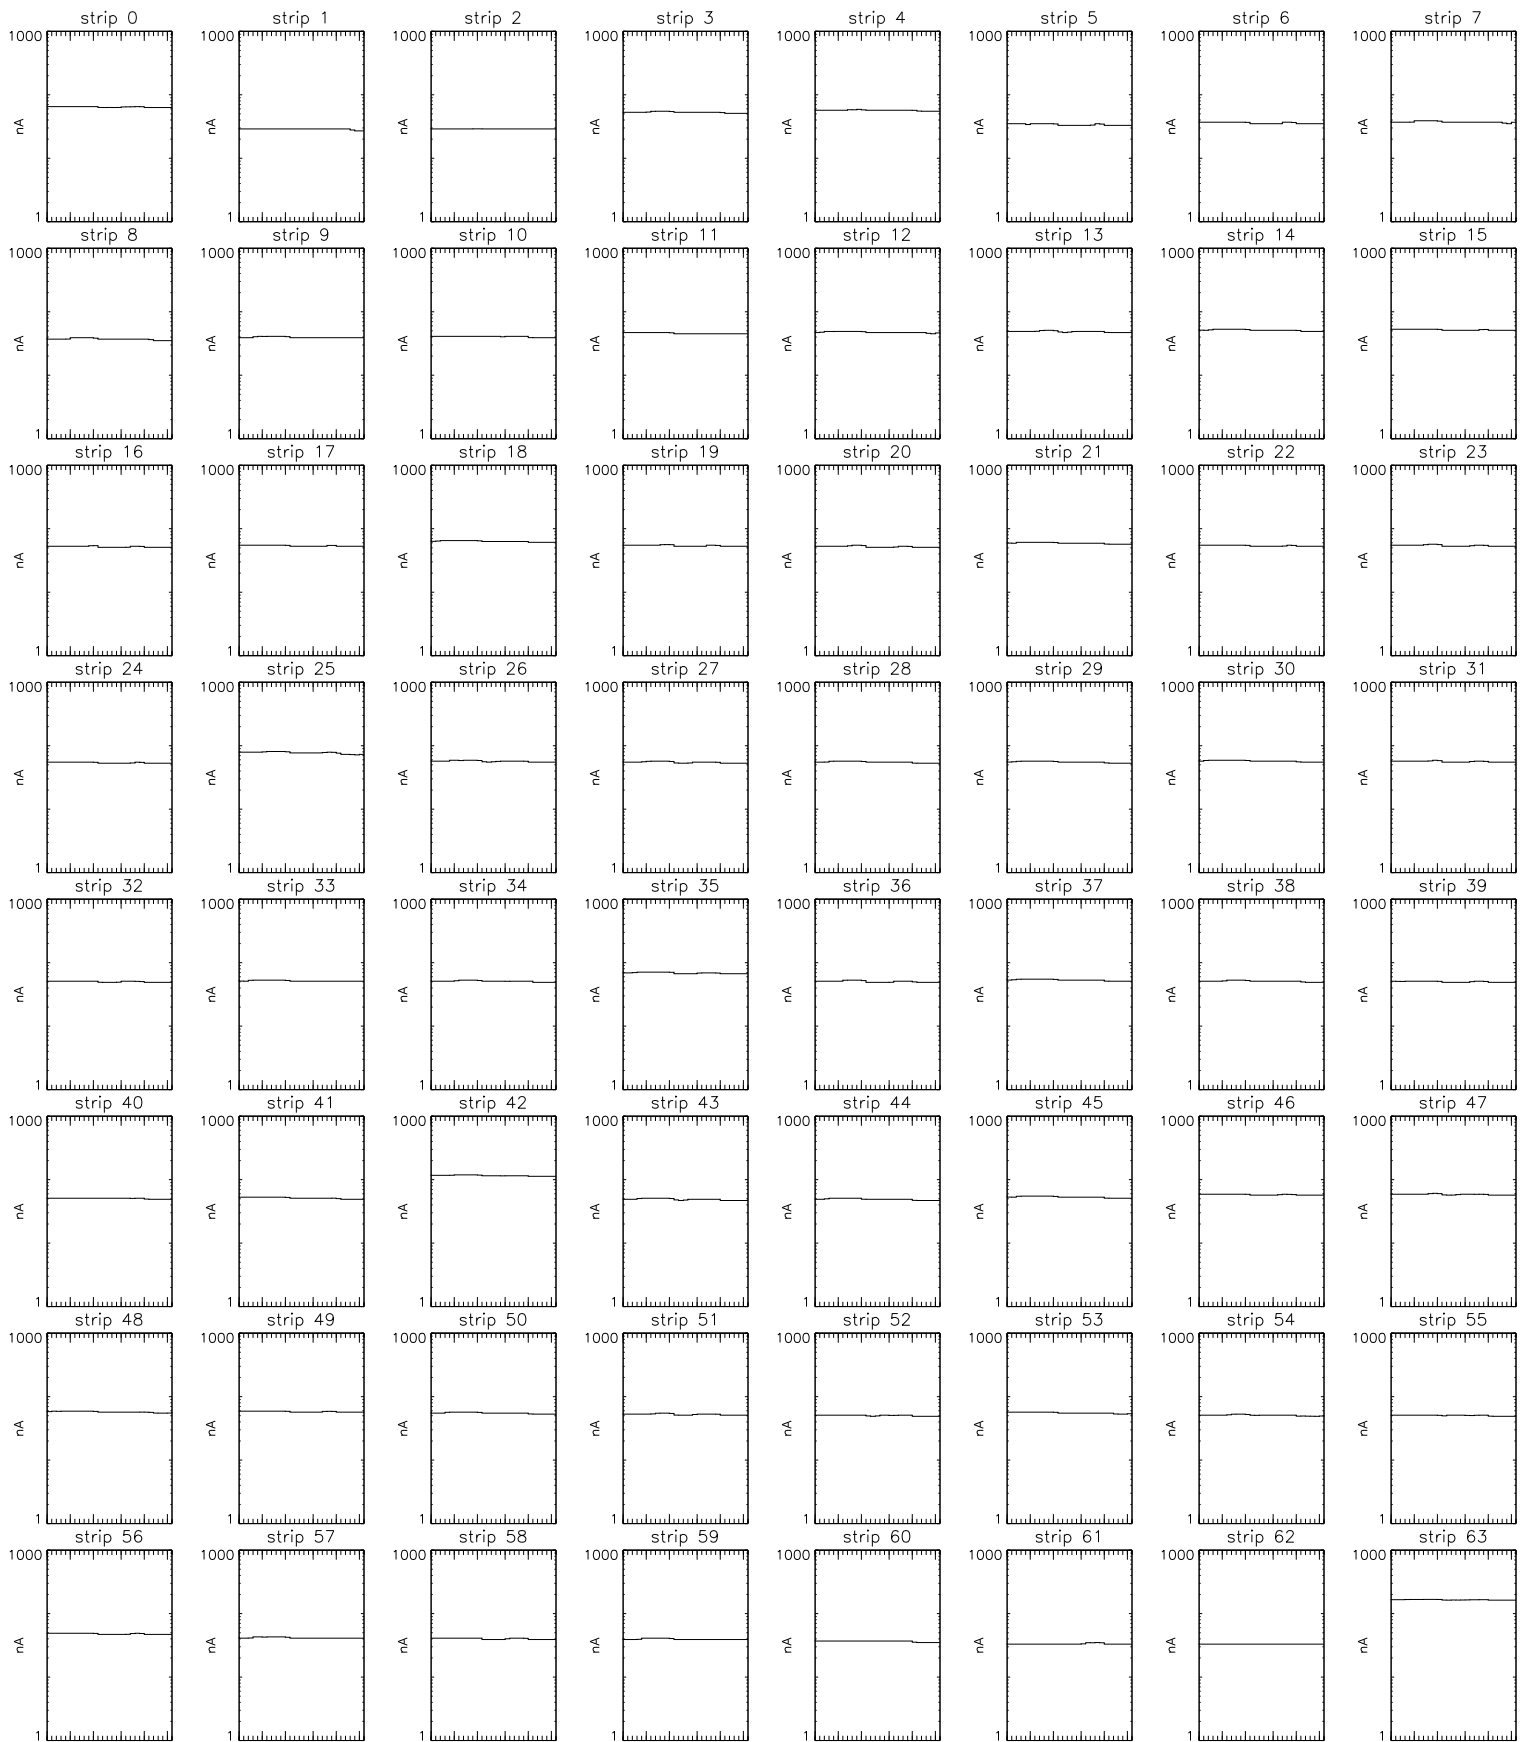

16 21 26 Jun 1 6 11
time (16-May-2009 to 12-Jun-2009)