




Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M1A - Ground Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

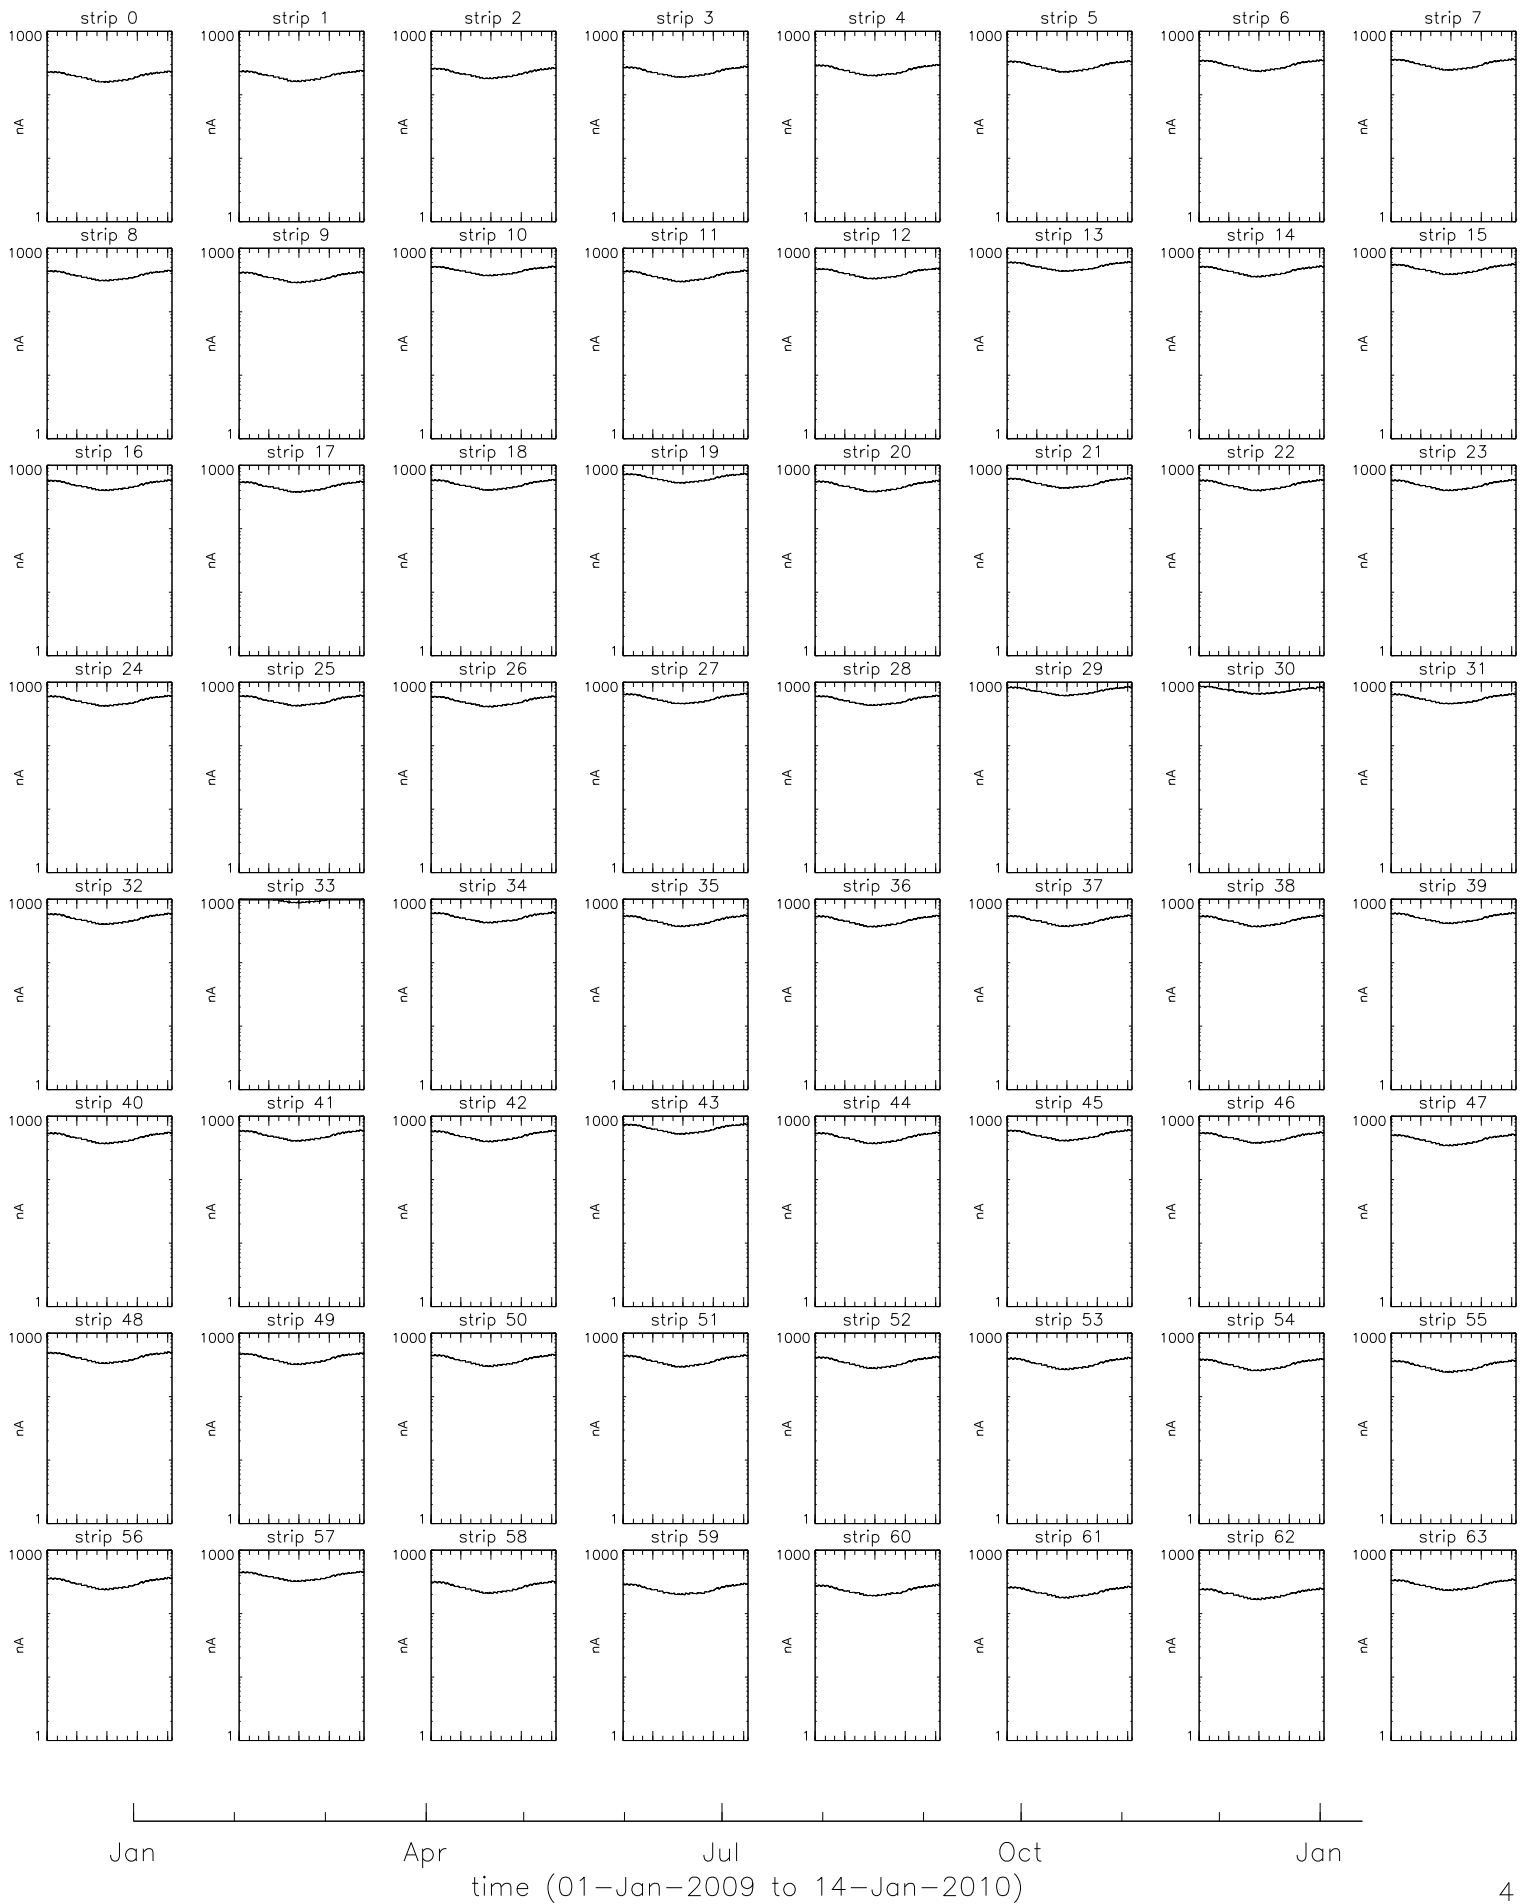


Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M1A - High Voltage Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

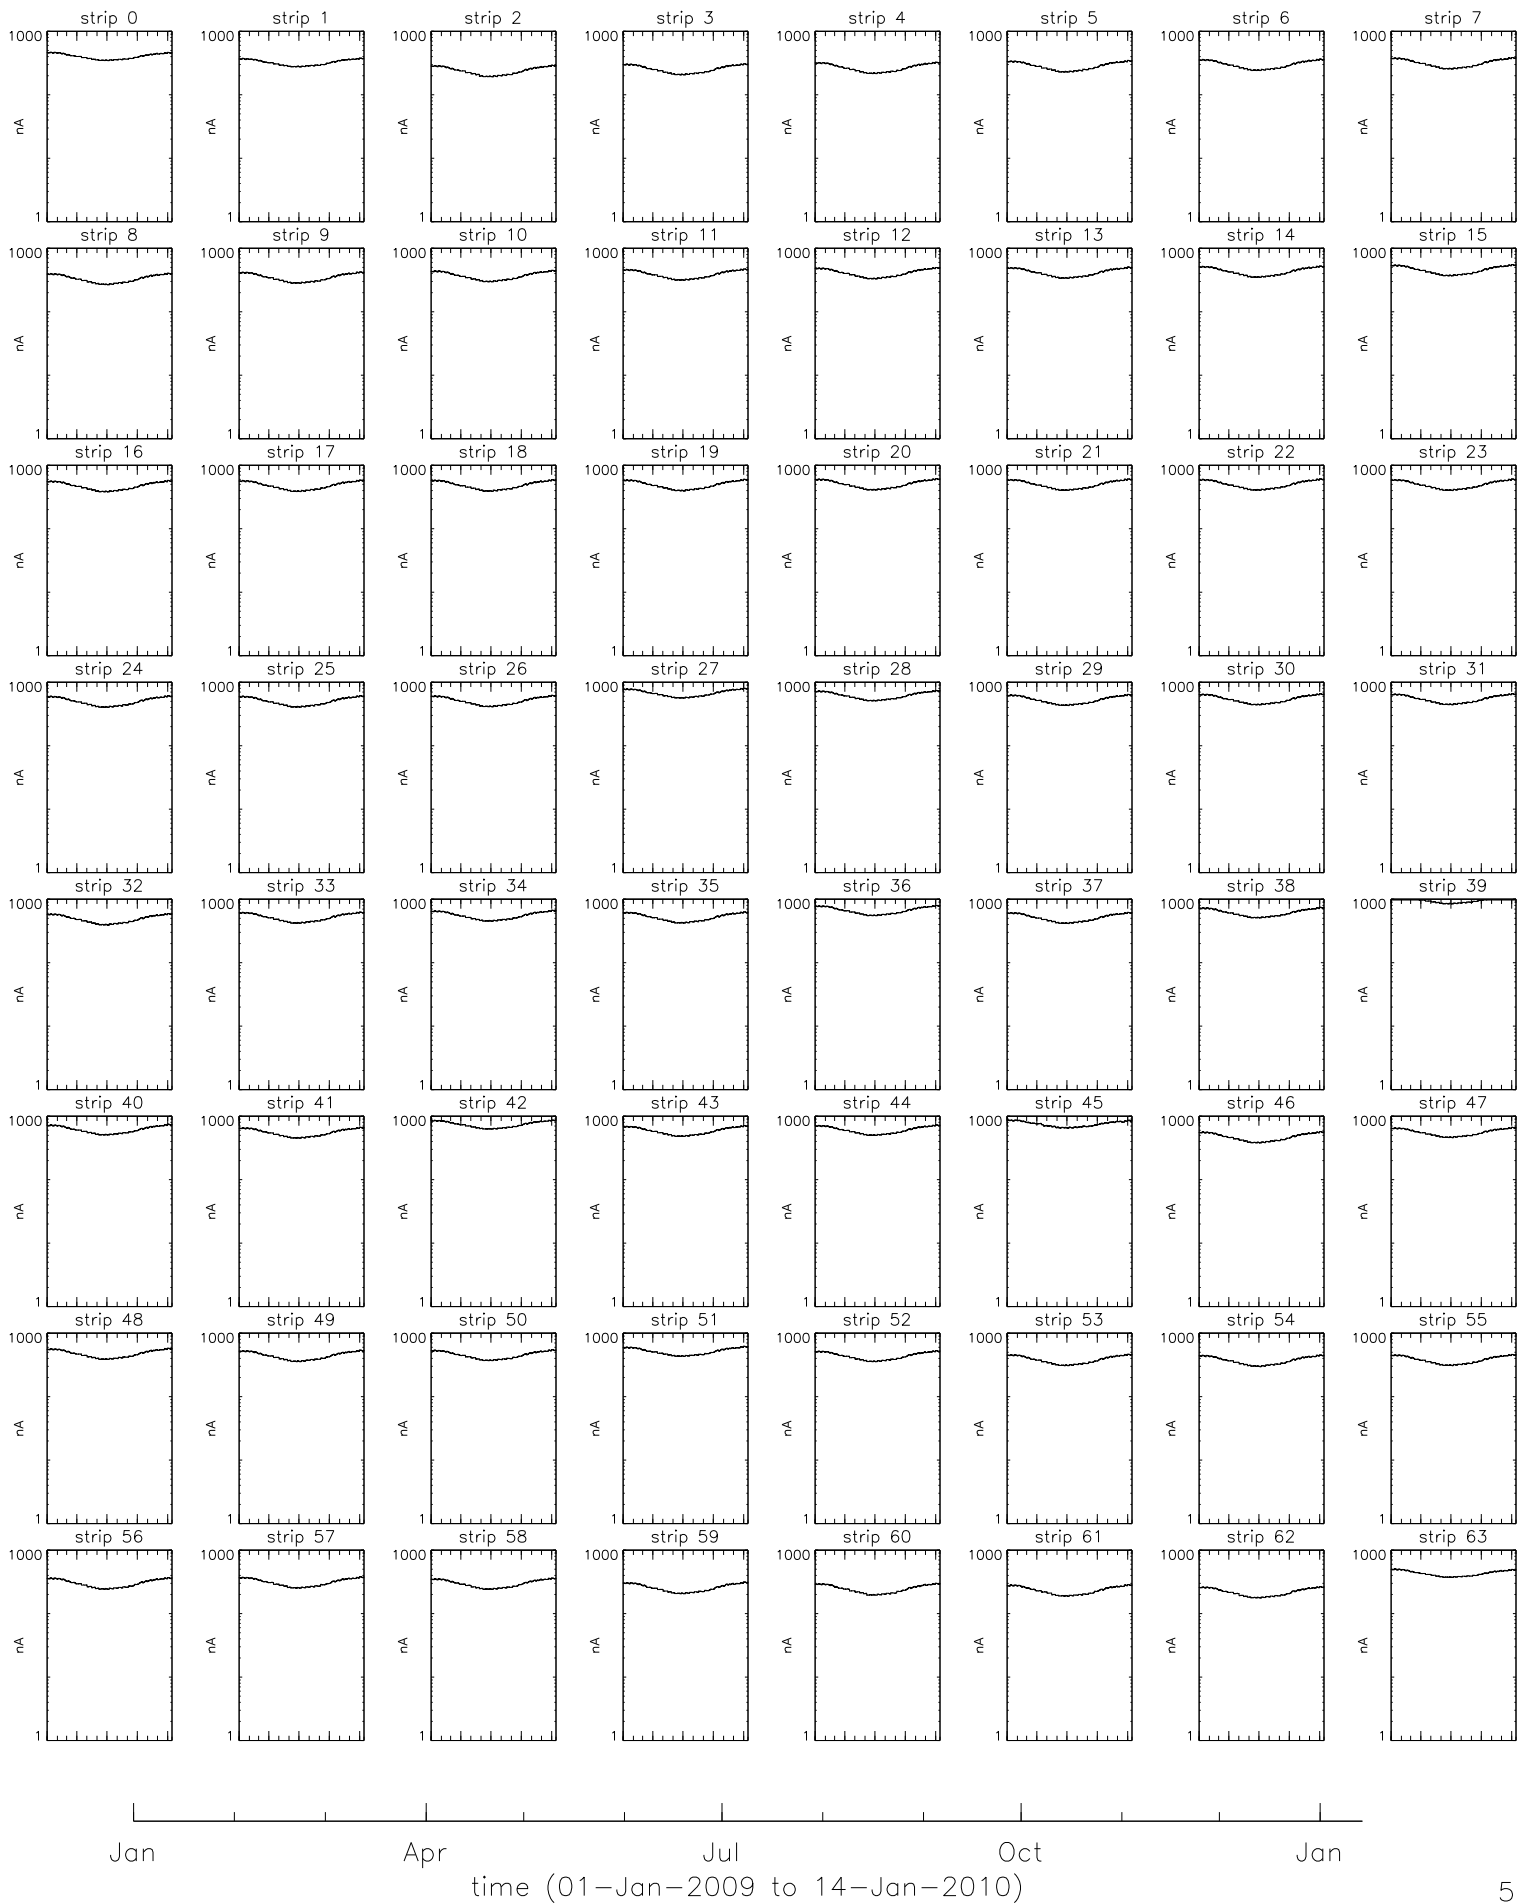


Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M2A - Ground Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

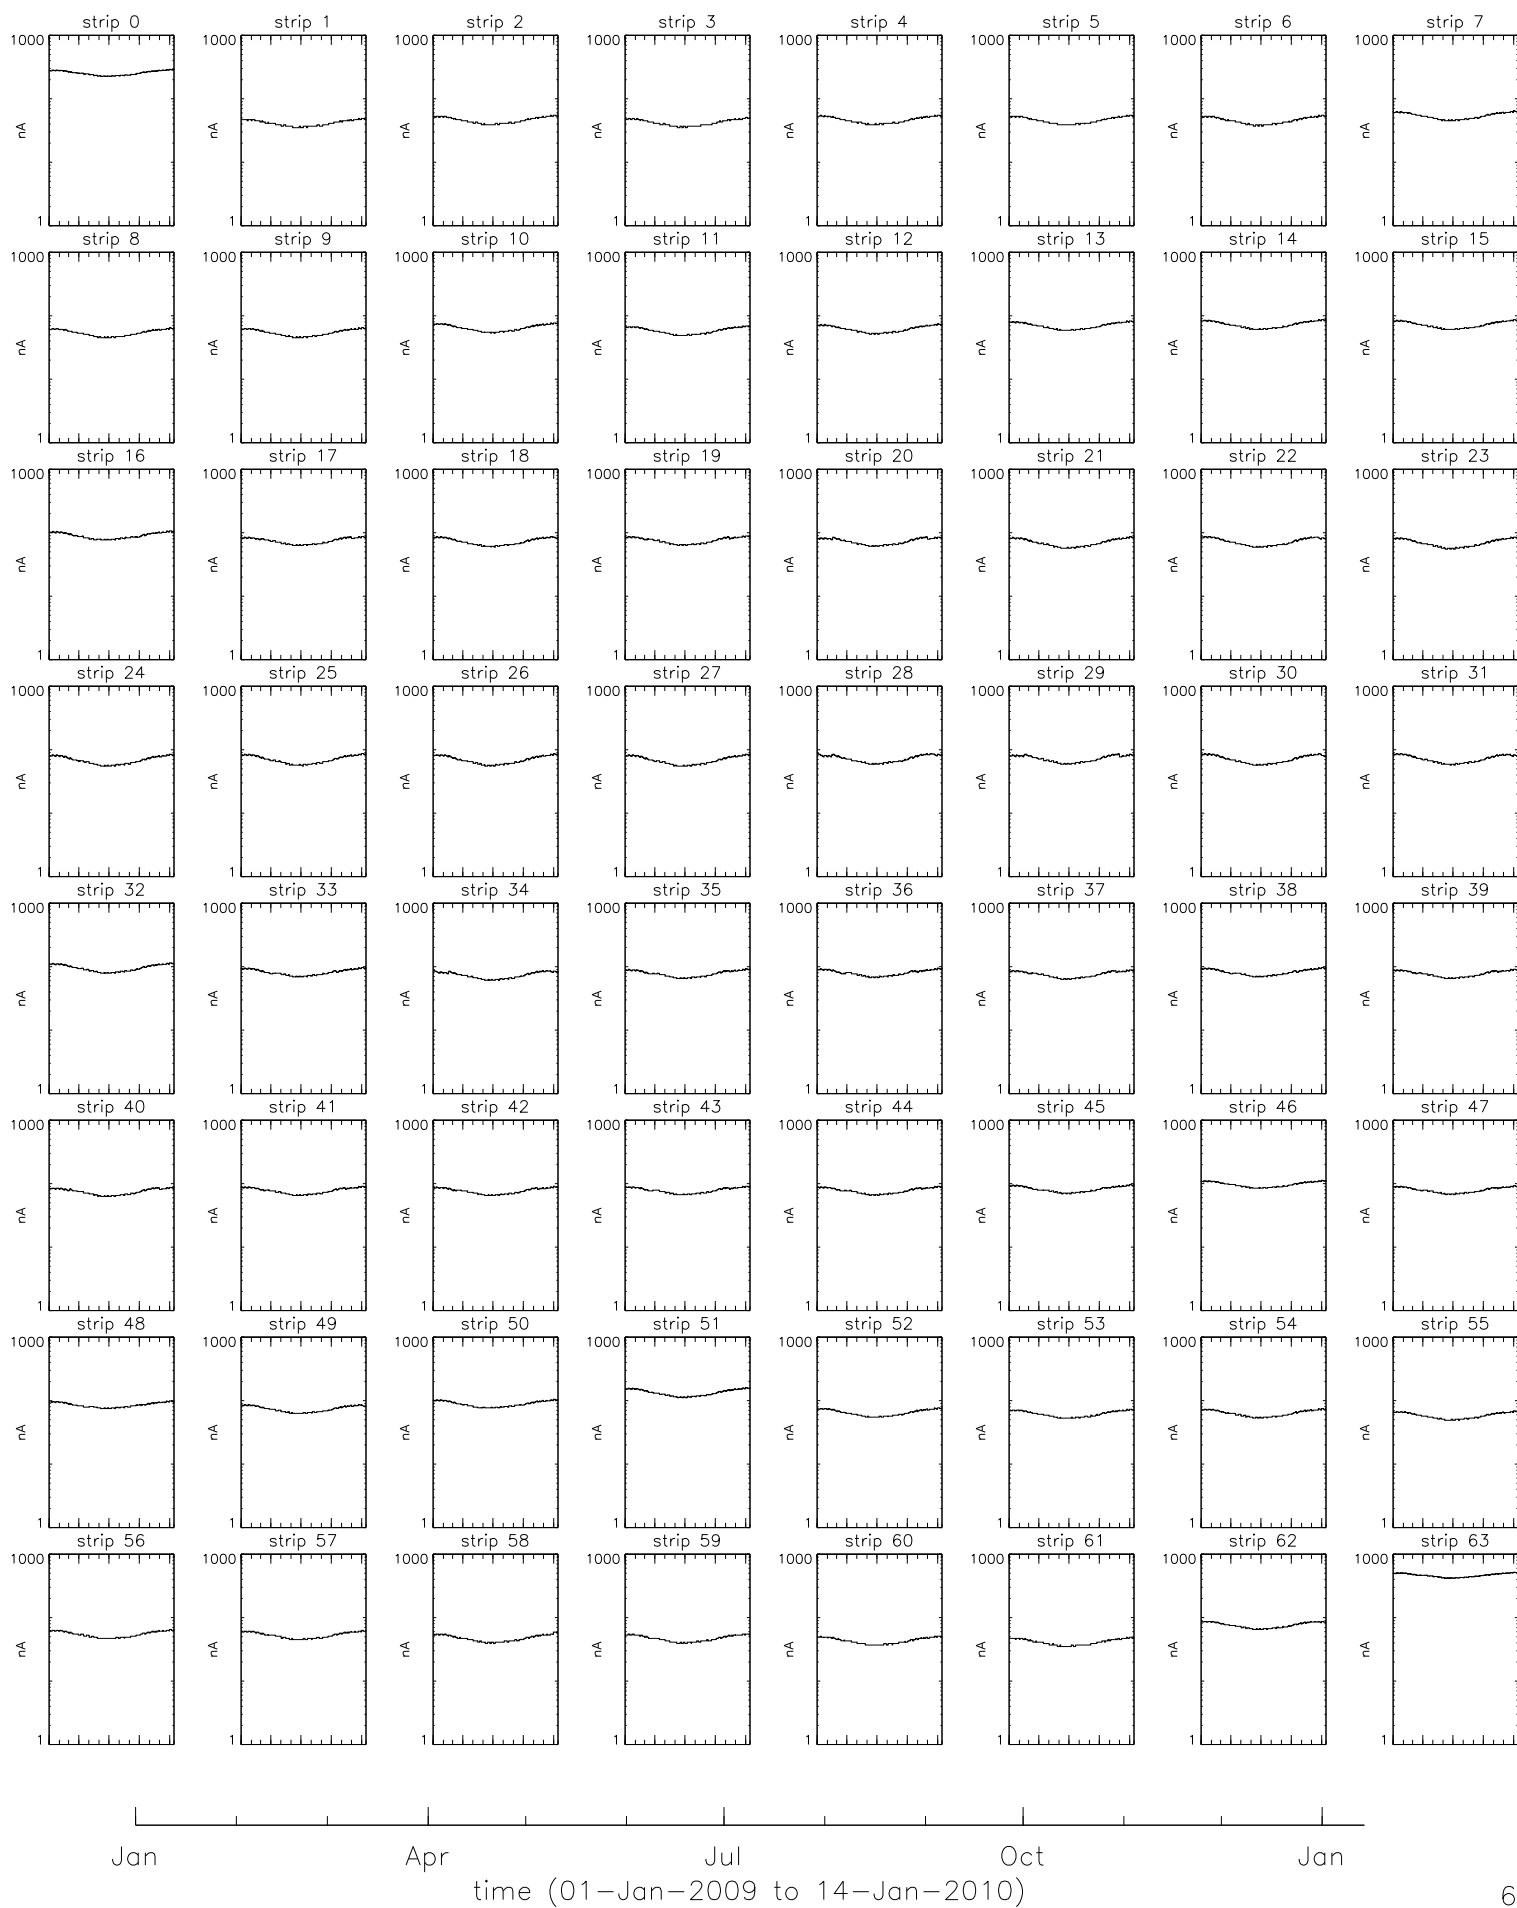


Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M2A - High Voltage Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

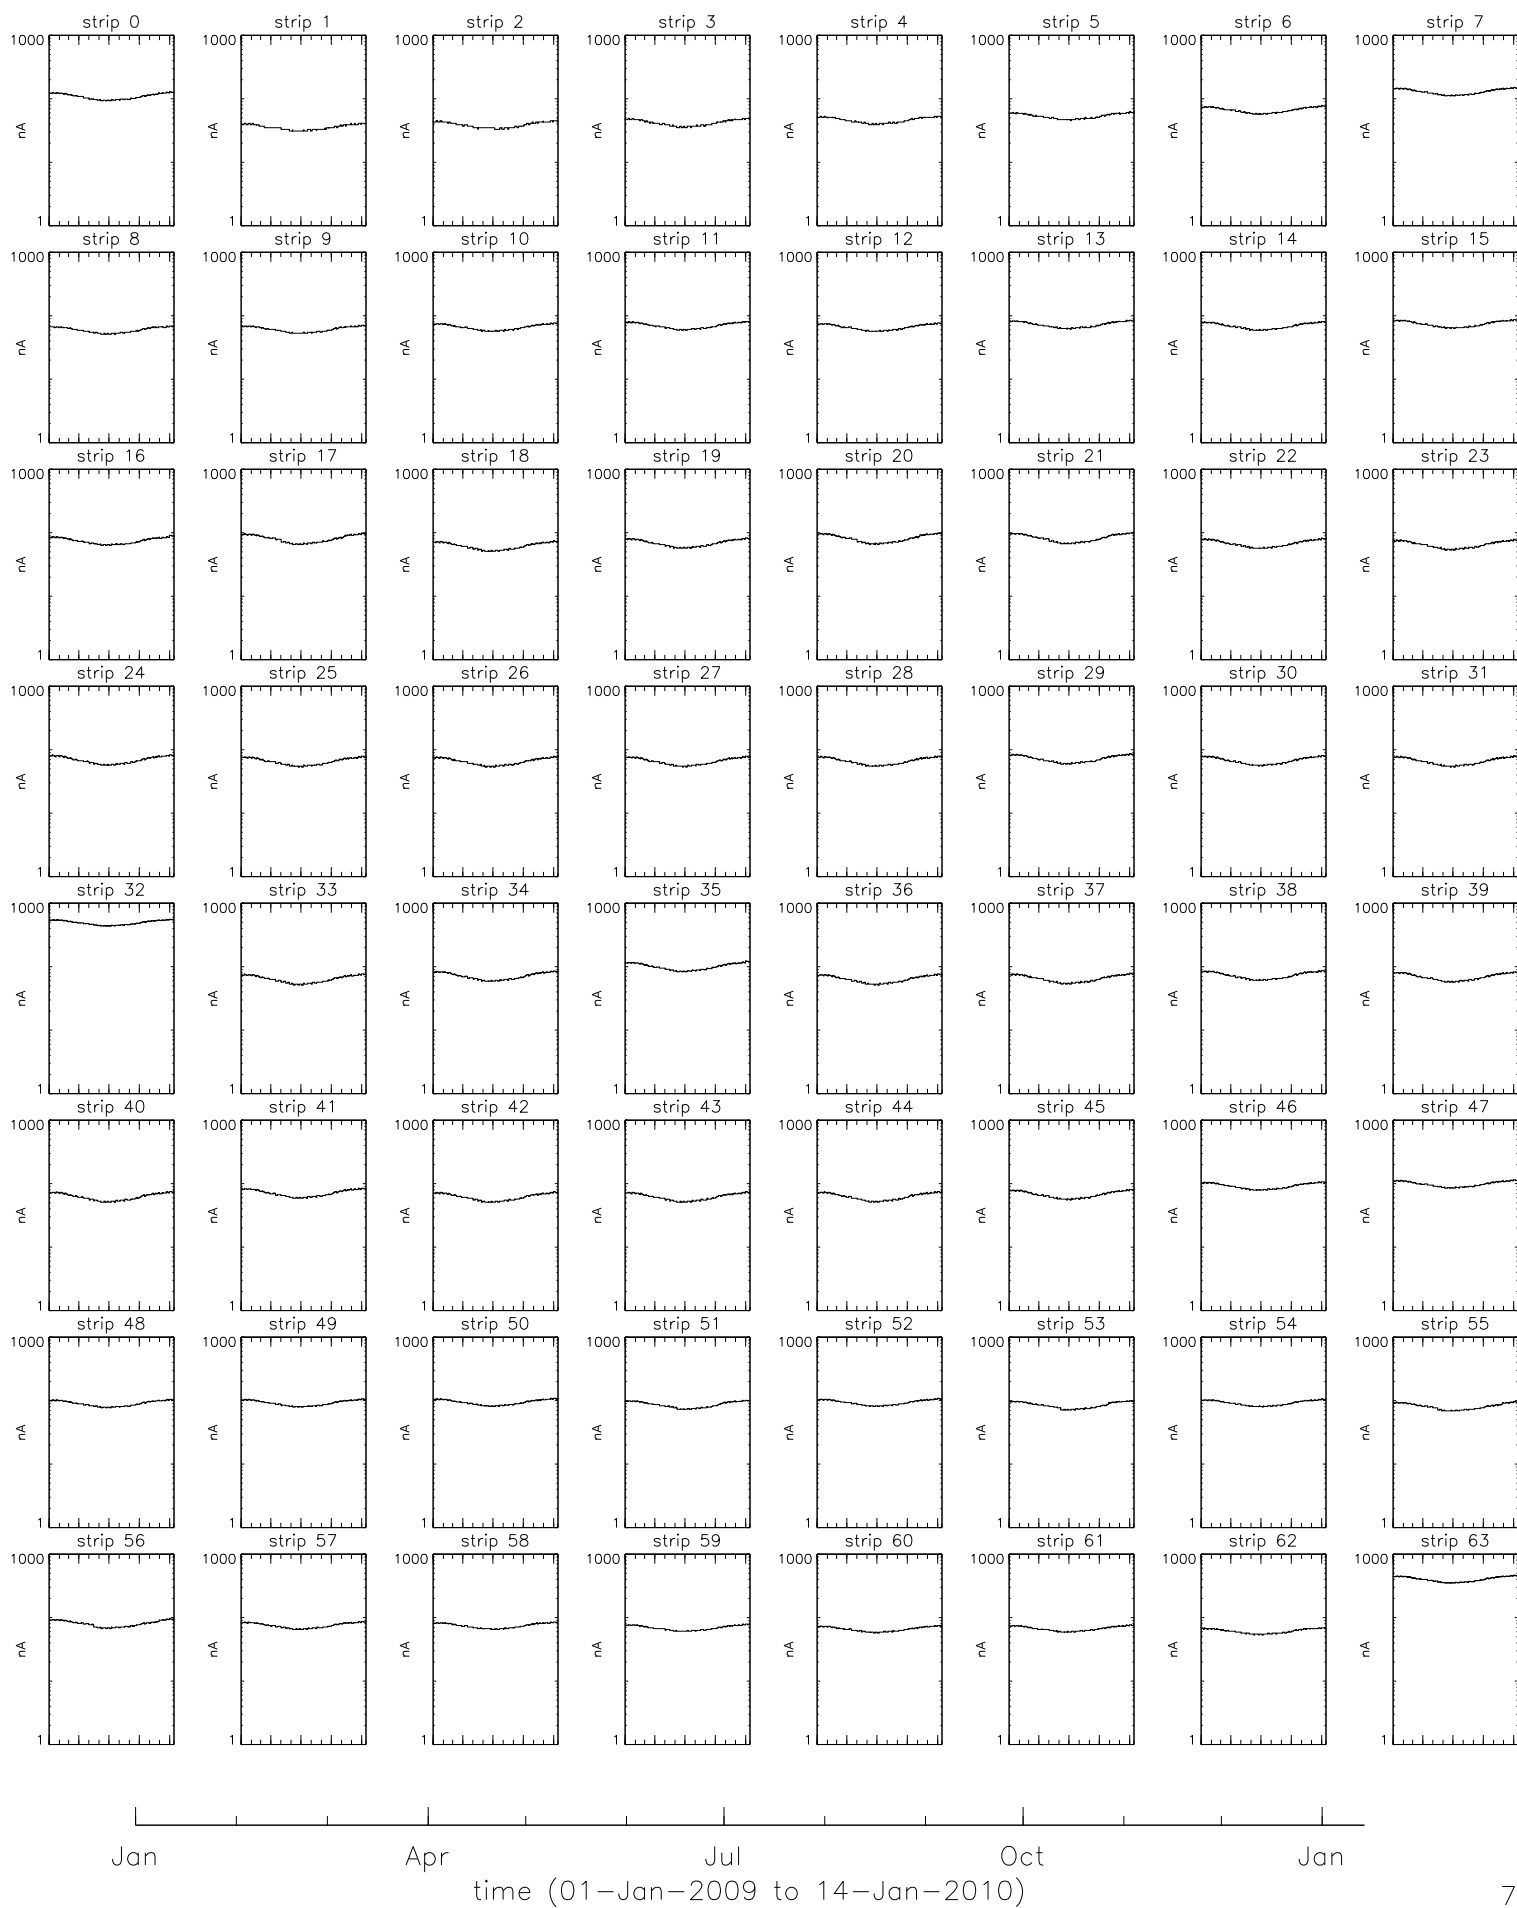


Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M1B - Ground Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

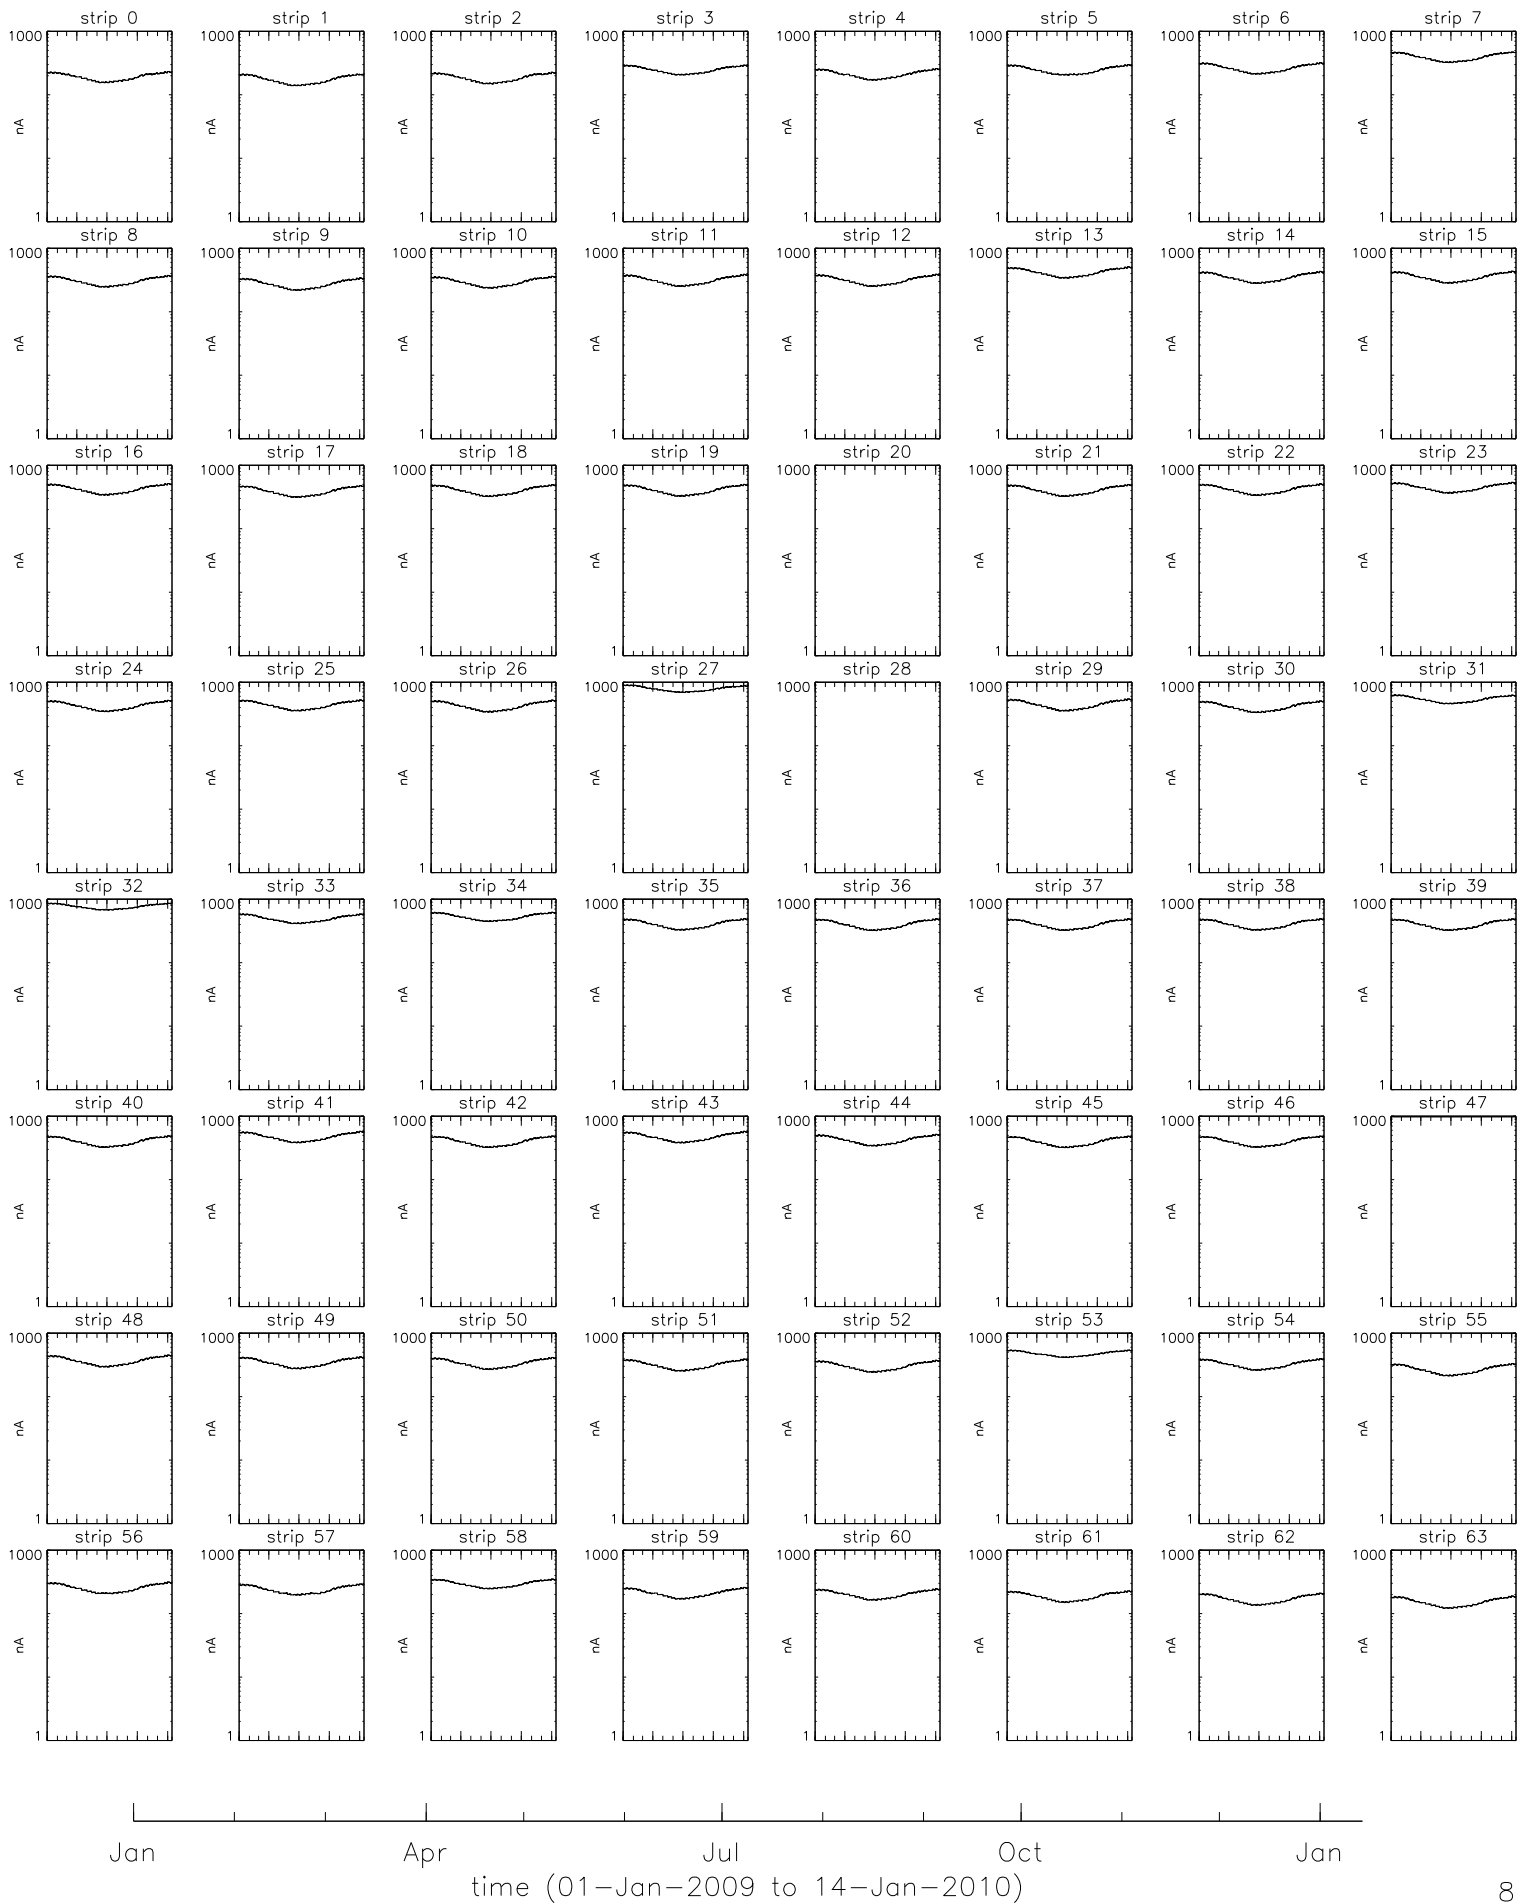

Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M1B - High Voltage Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

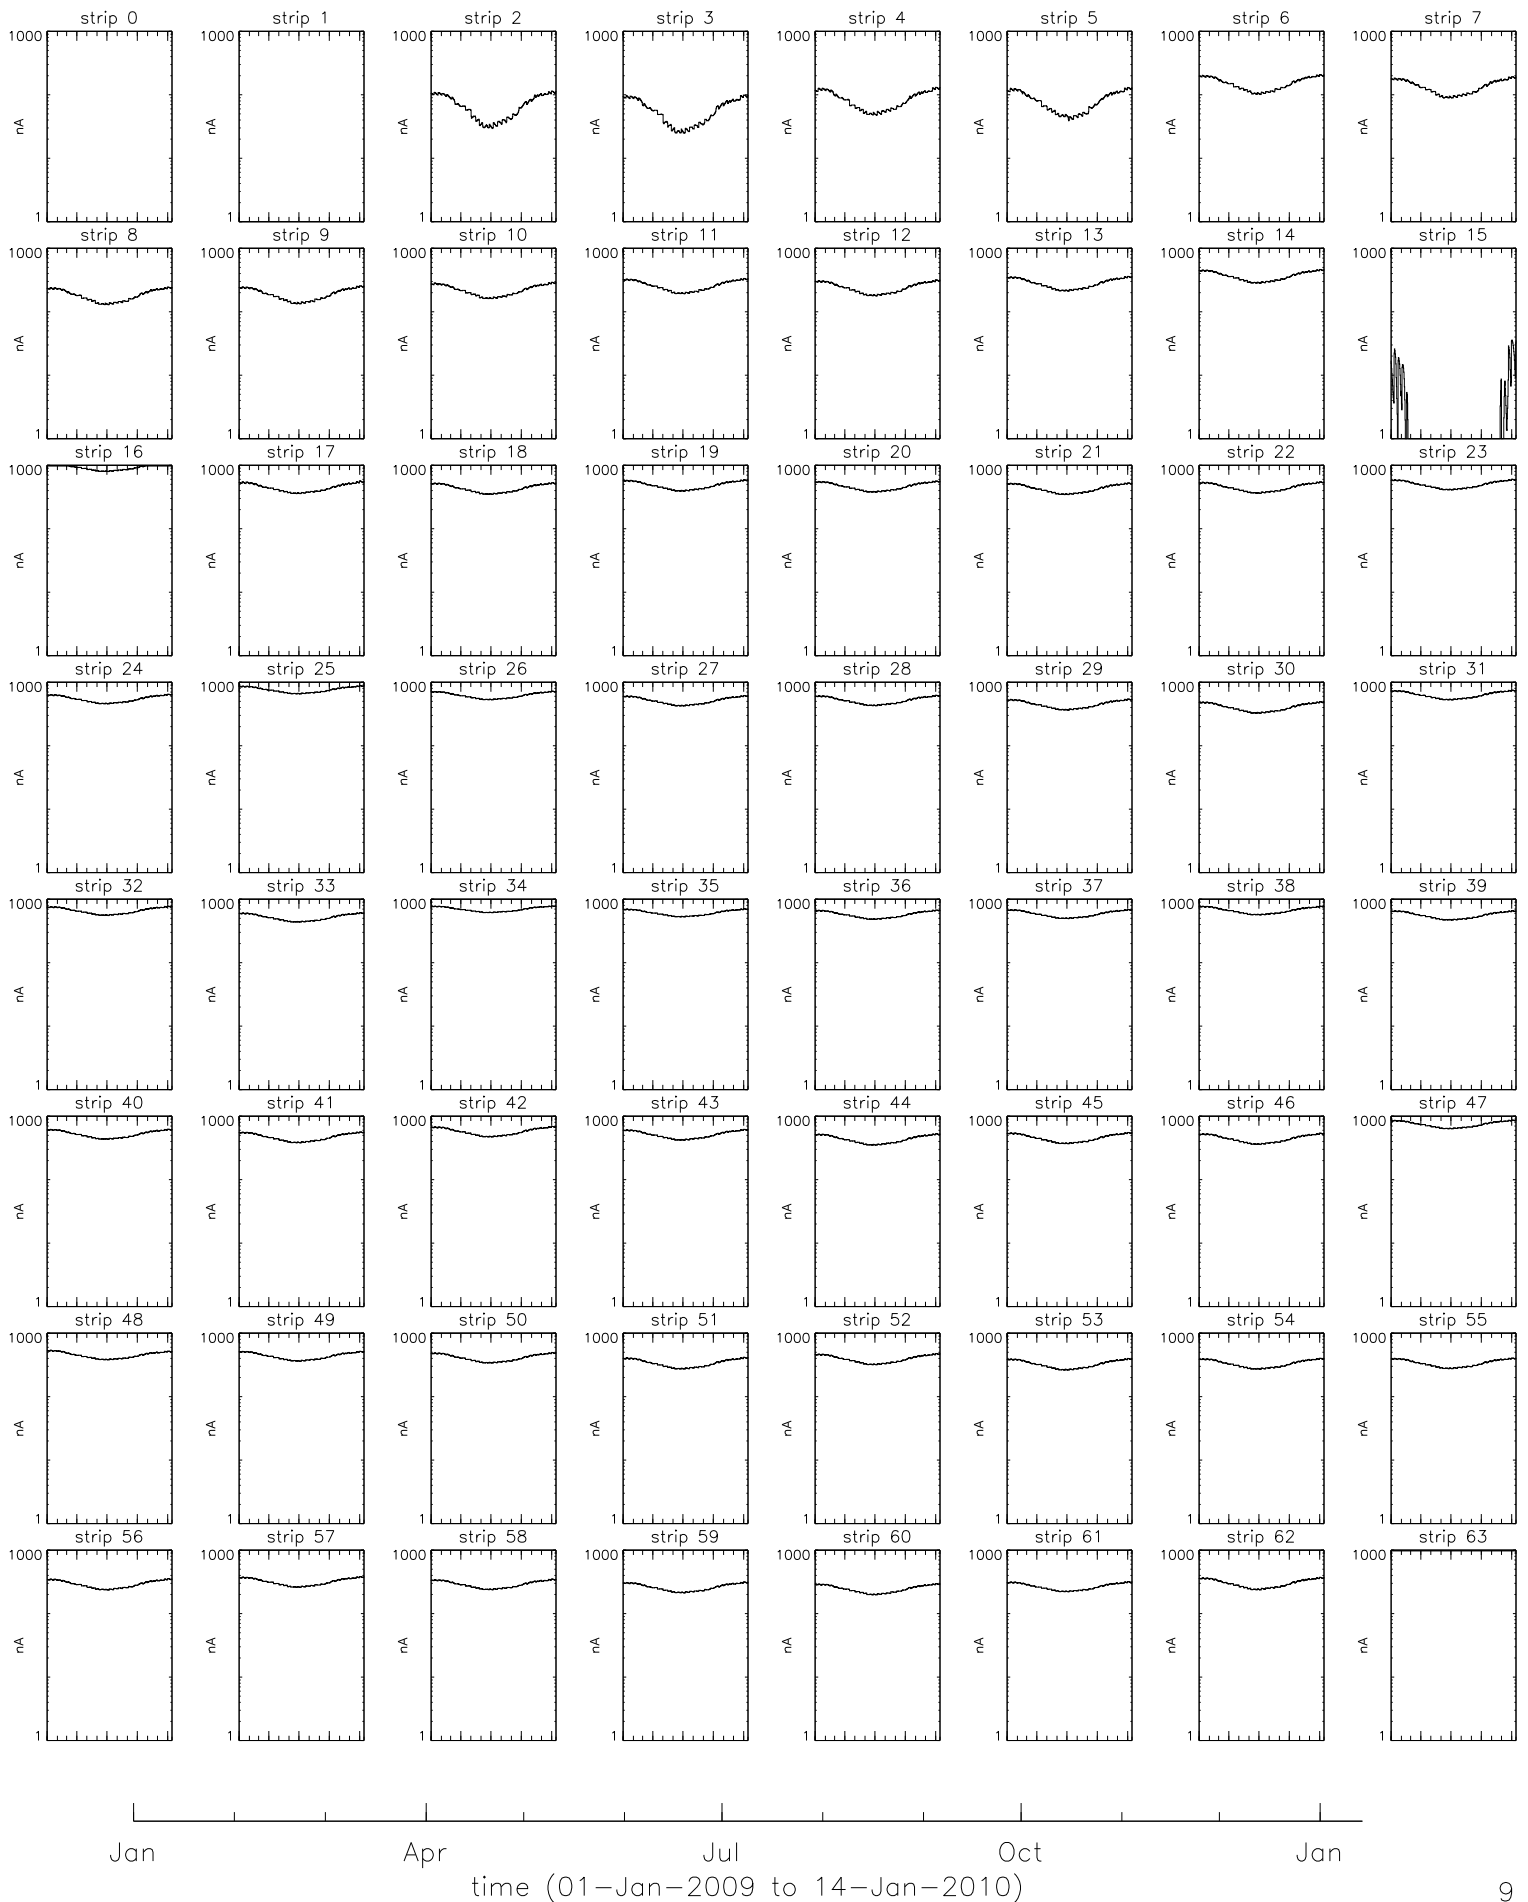

Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M2B - Ground Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

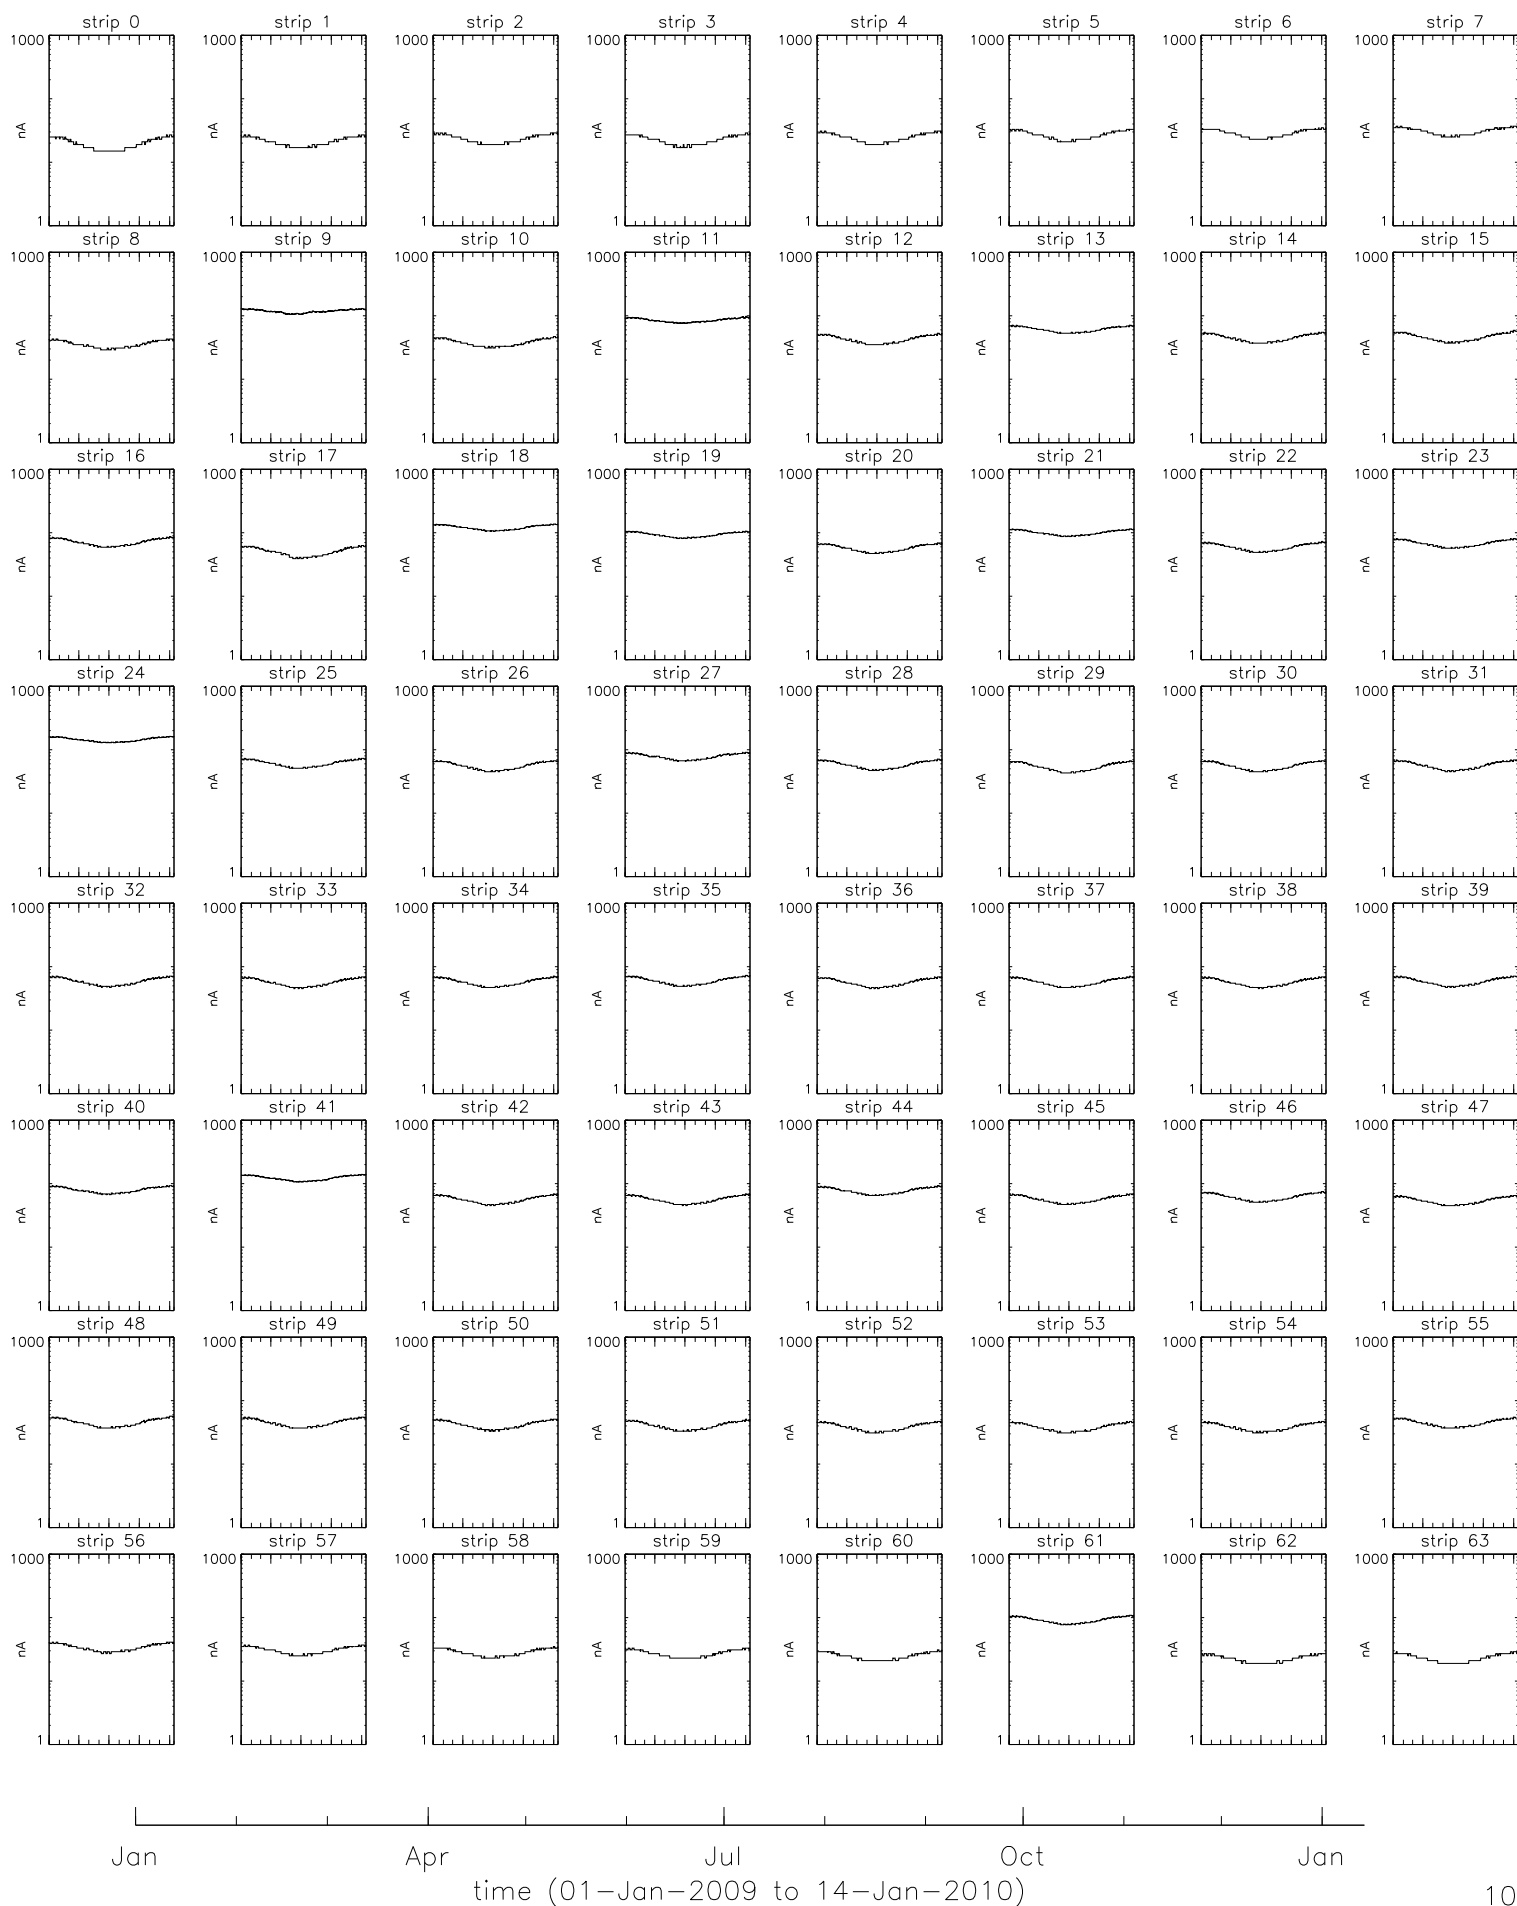

Bartels Rotation 2394-2407 - Daily Averages  
Leakage Current - M2B - High Voltage Side  
(01-Jan-2009 thru 13-Jan-2010) (001/2009 thru 013/2010)

