



Bartels Rotation 2420 – Daily Averages
 Leakage Current – M1A – Ground Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

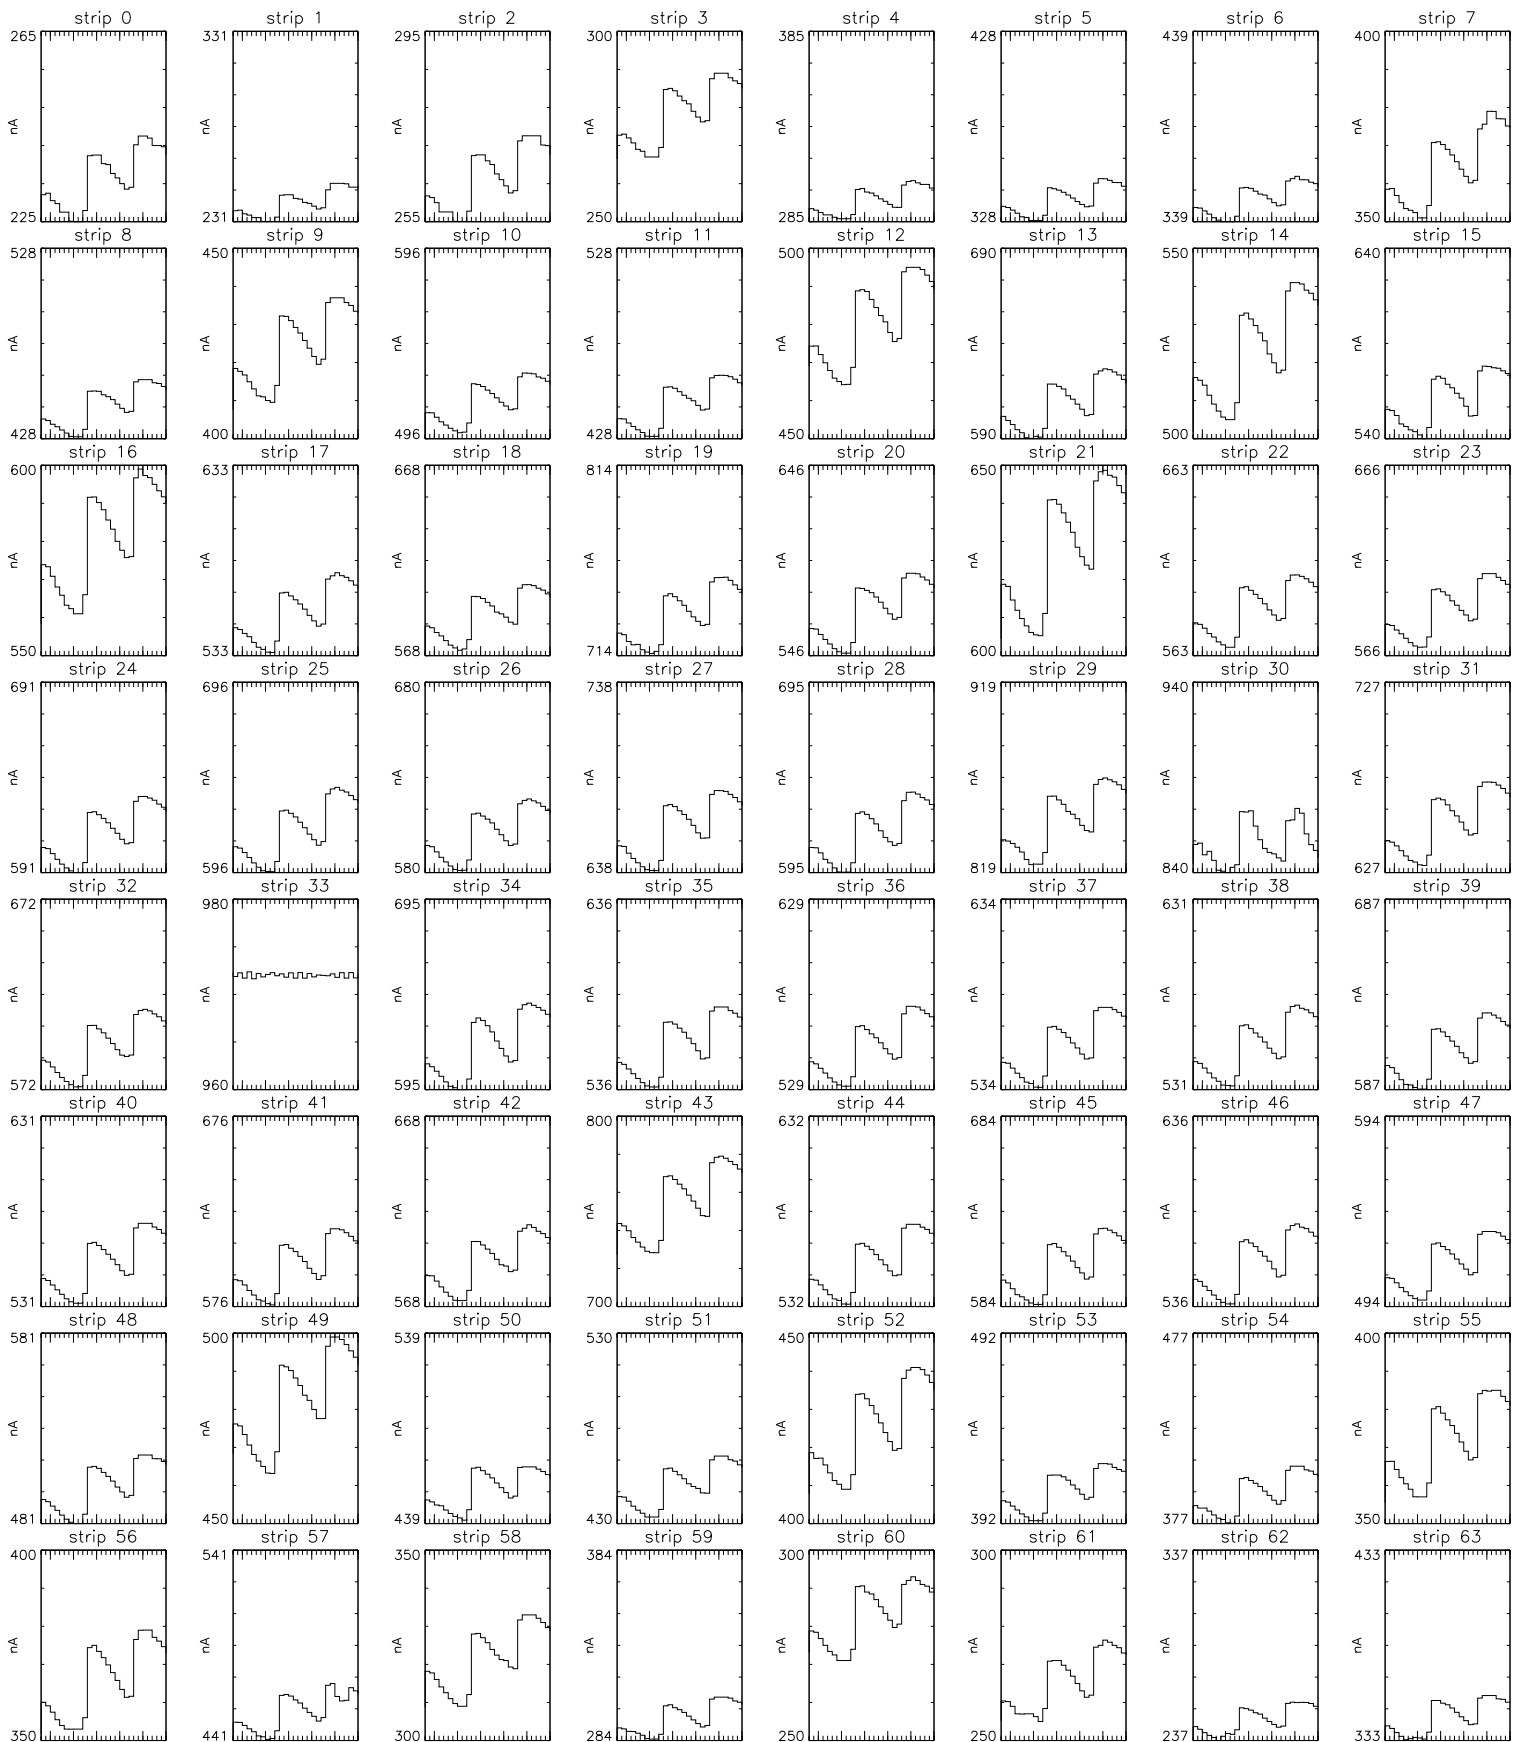


6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
 Leakage Current – M1A – High Voltage Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

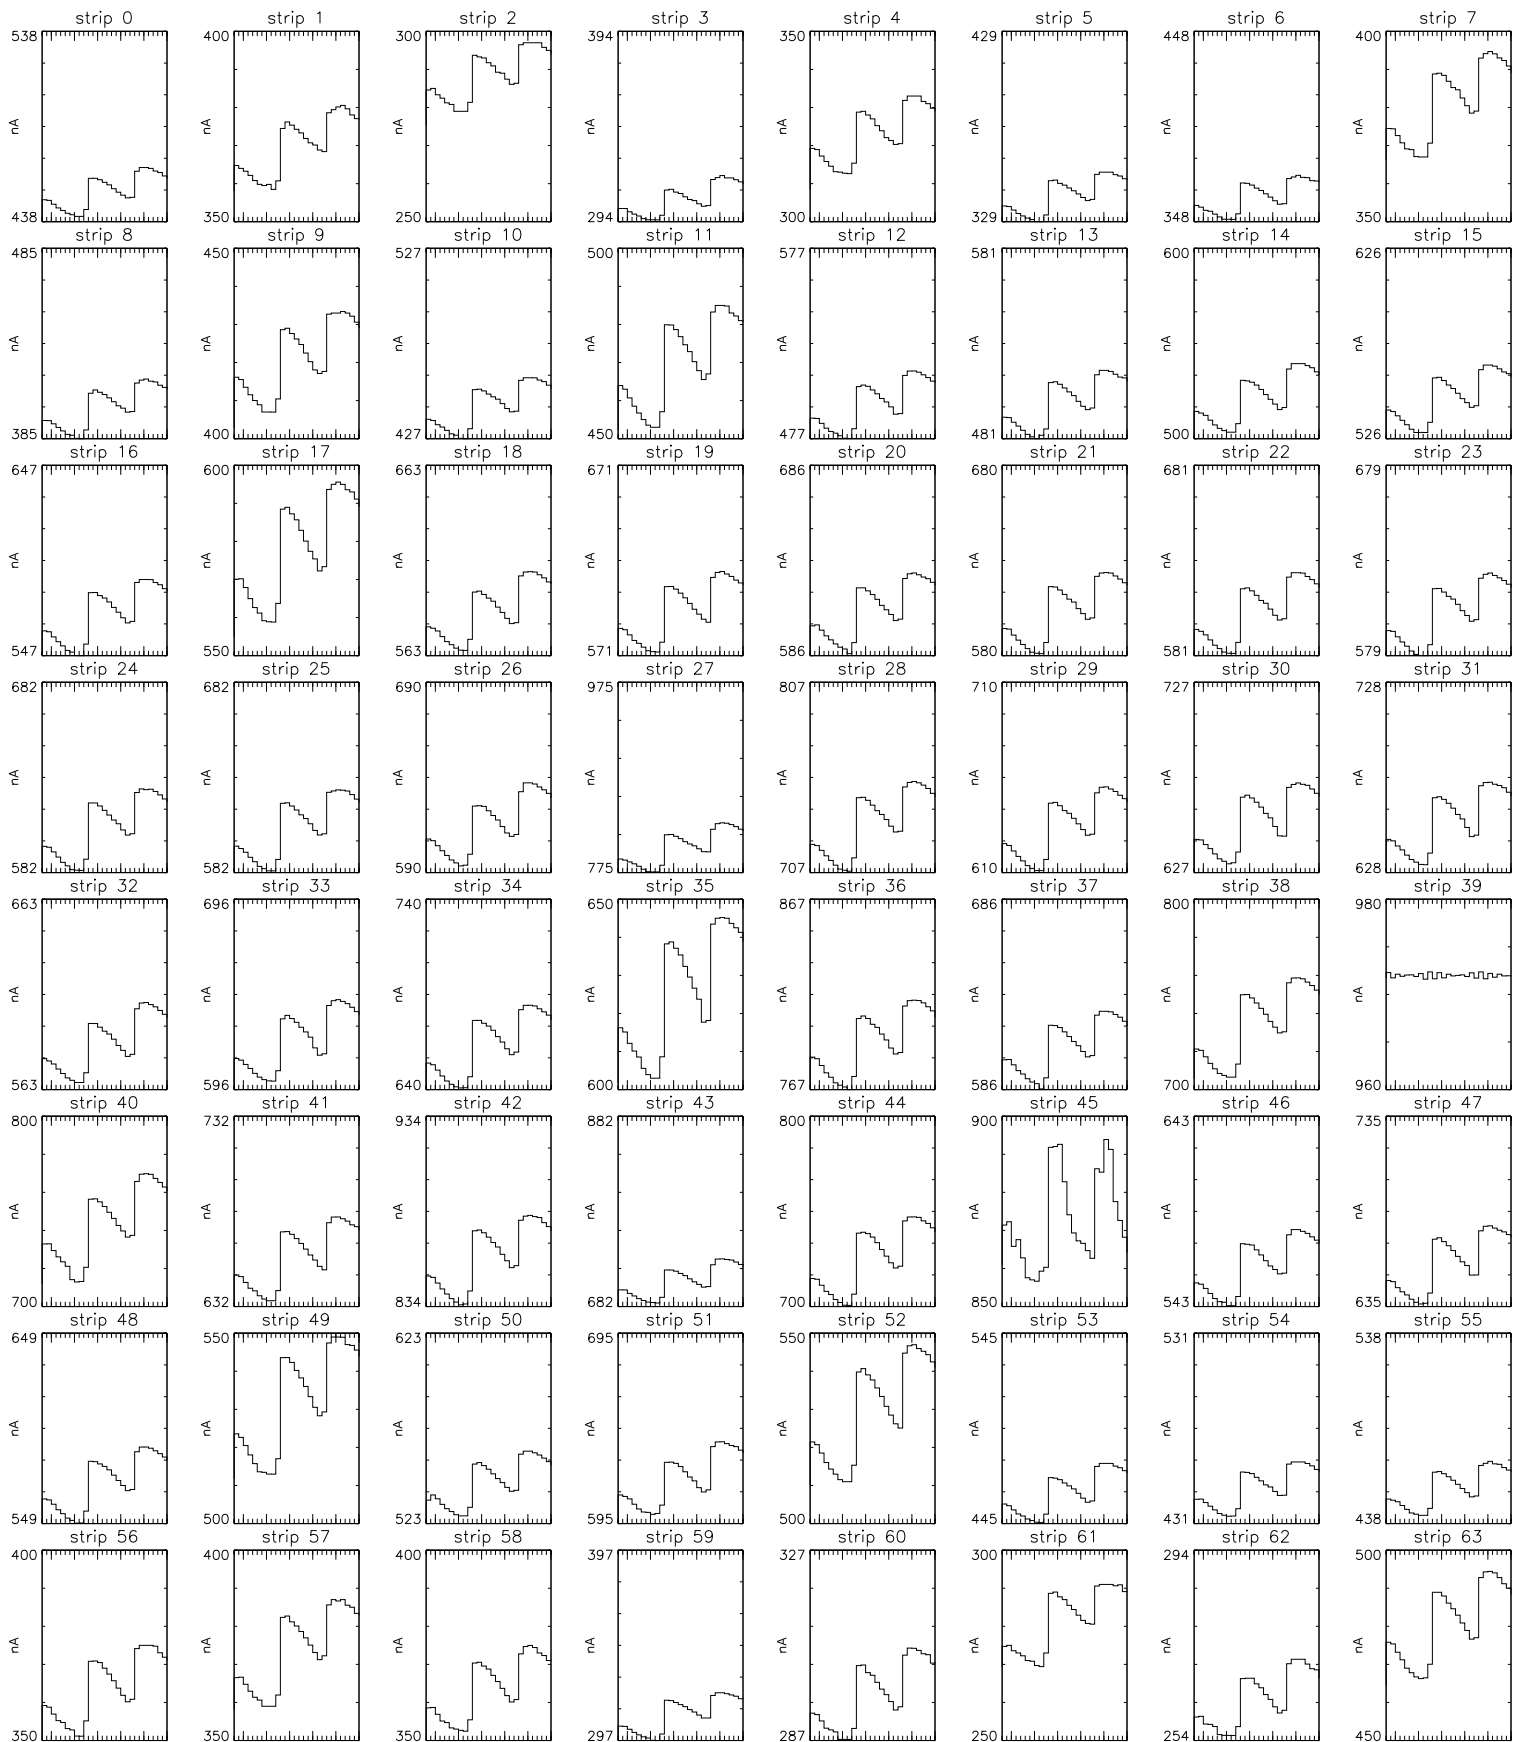


6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
Leakage Current – M2A – Ground Side
(04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

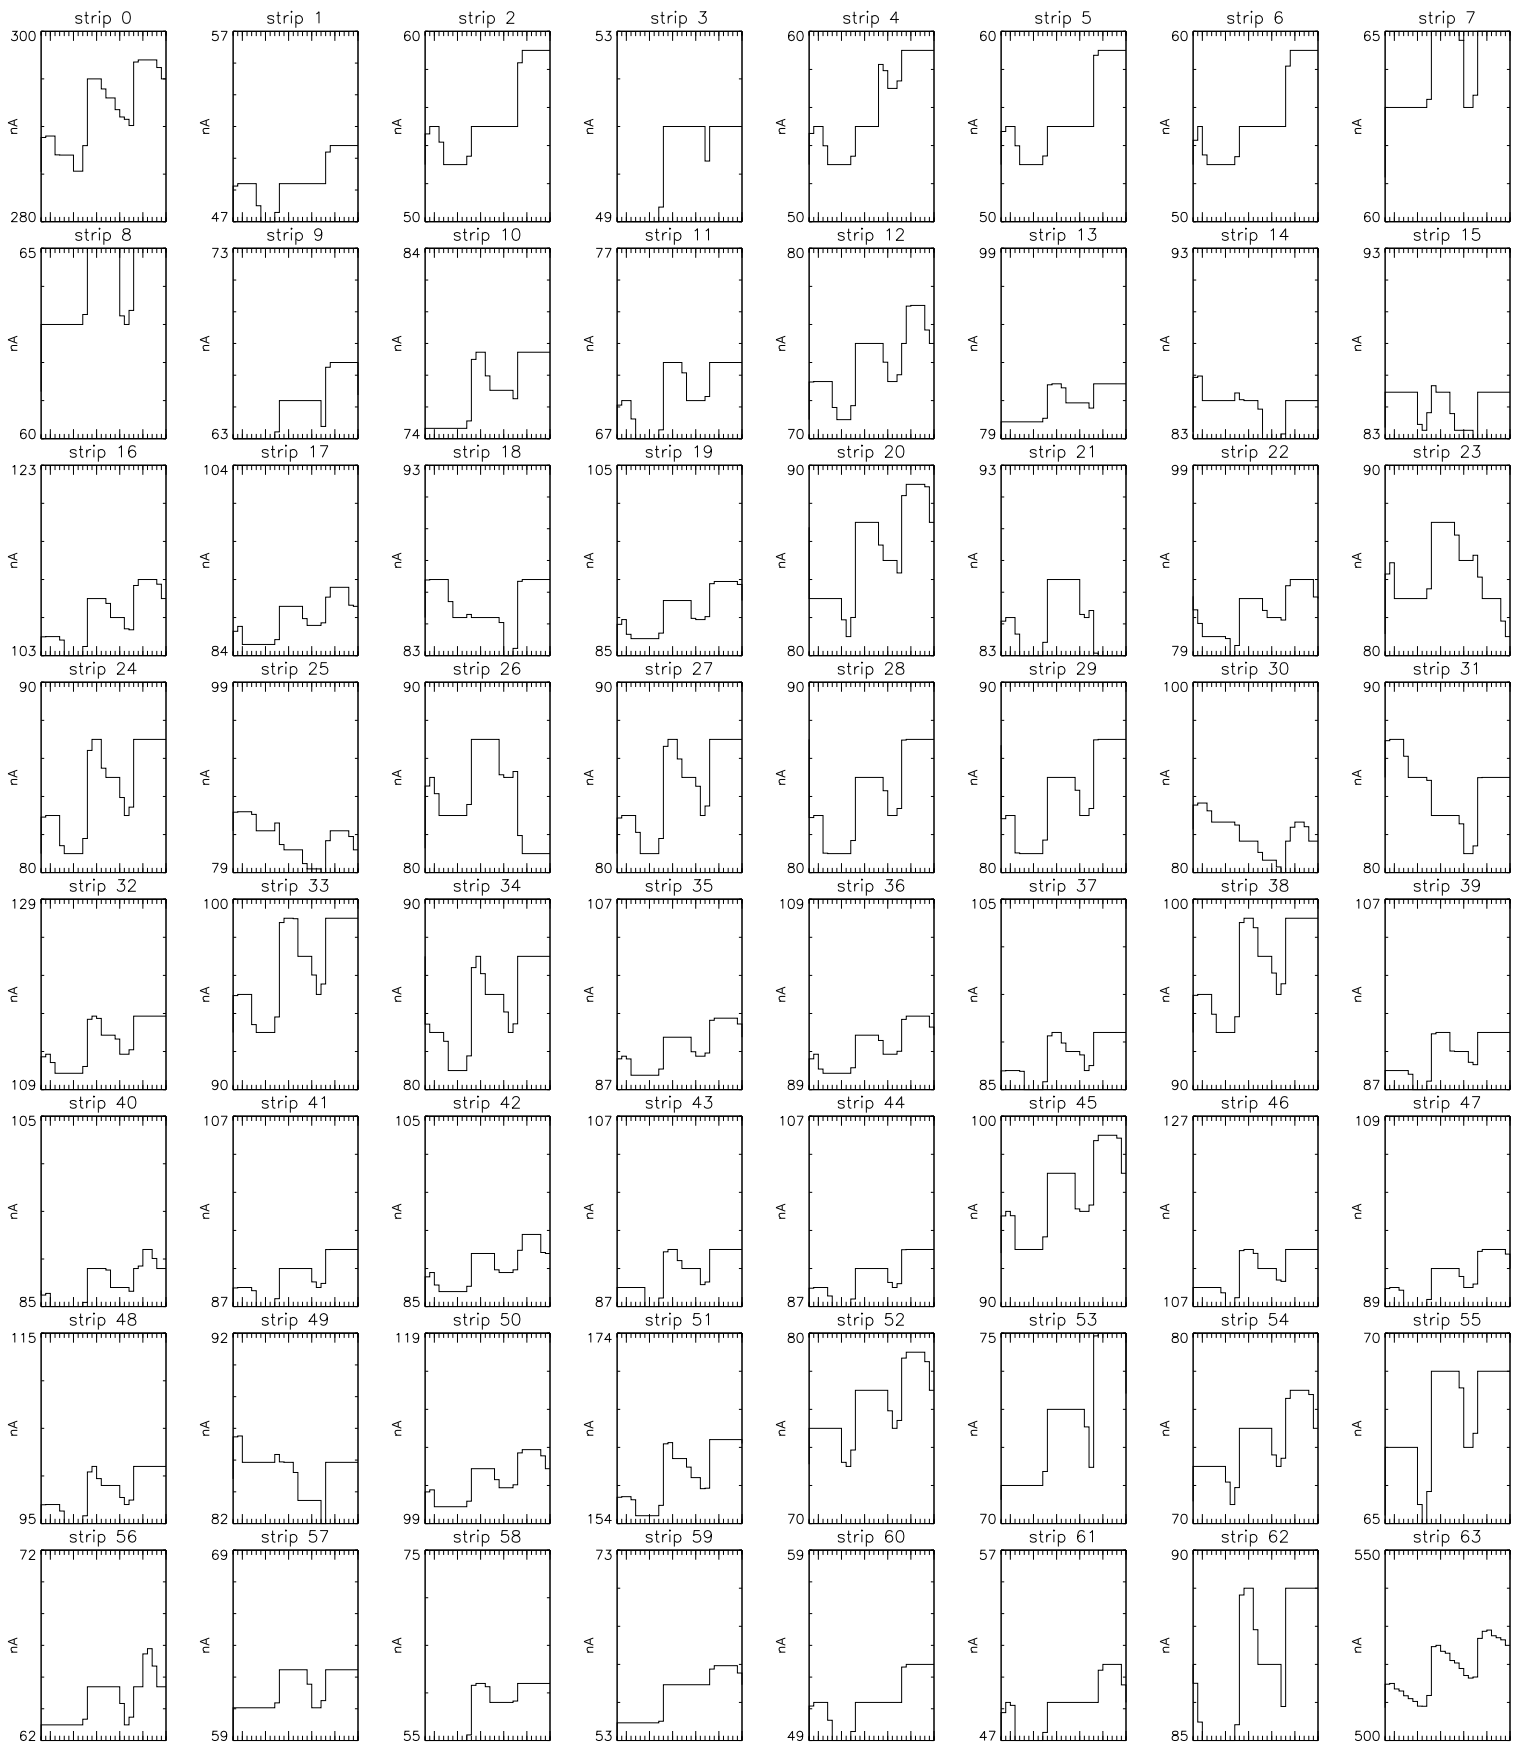

6 11 16 21 26 31
time (04-Dec-2010 to 31-Dec-2010)


Bartels Rotation 2420 – Daily Averages
 Leakage Current – M2A – High Voltage Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

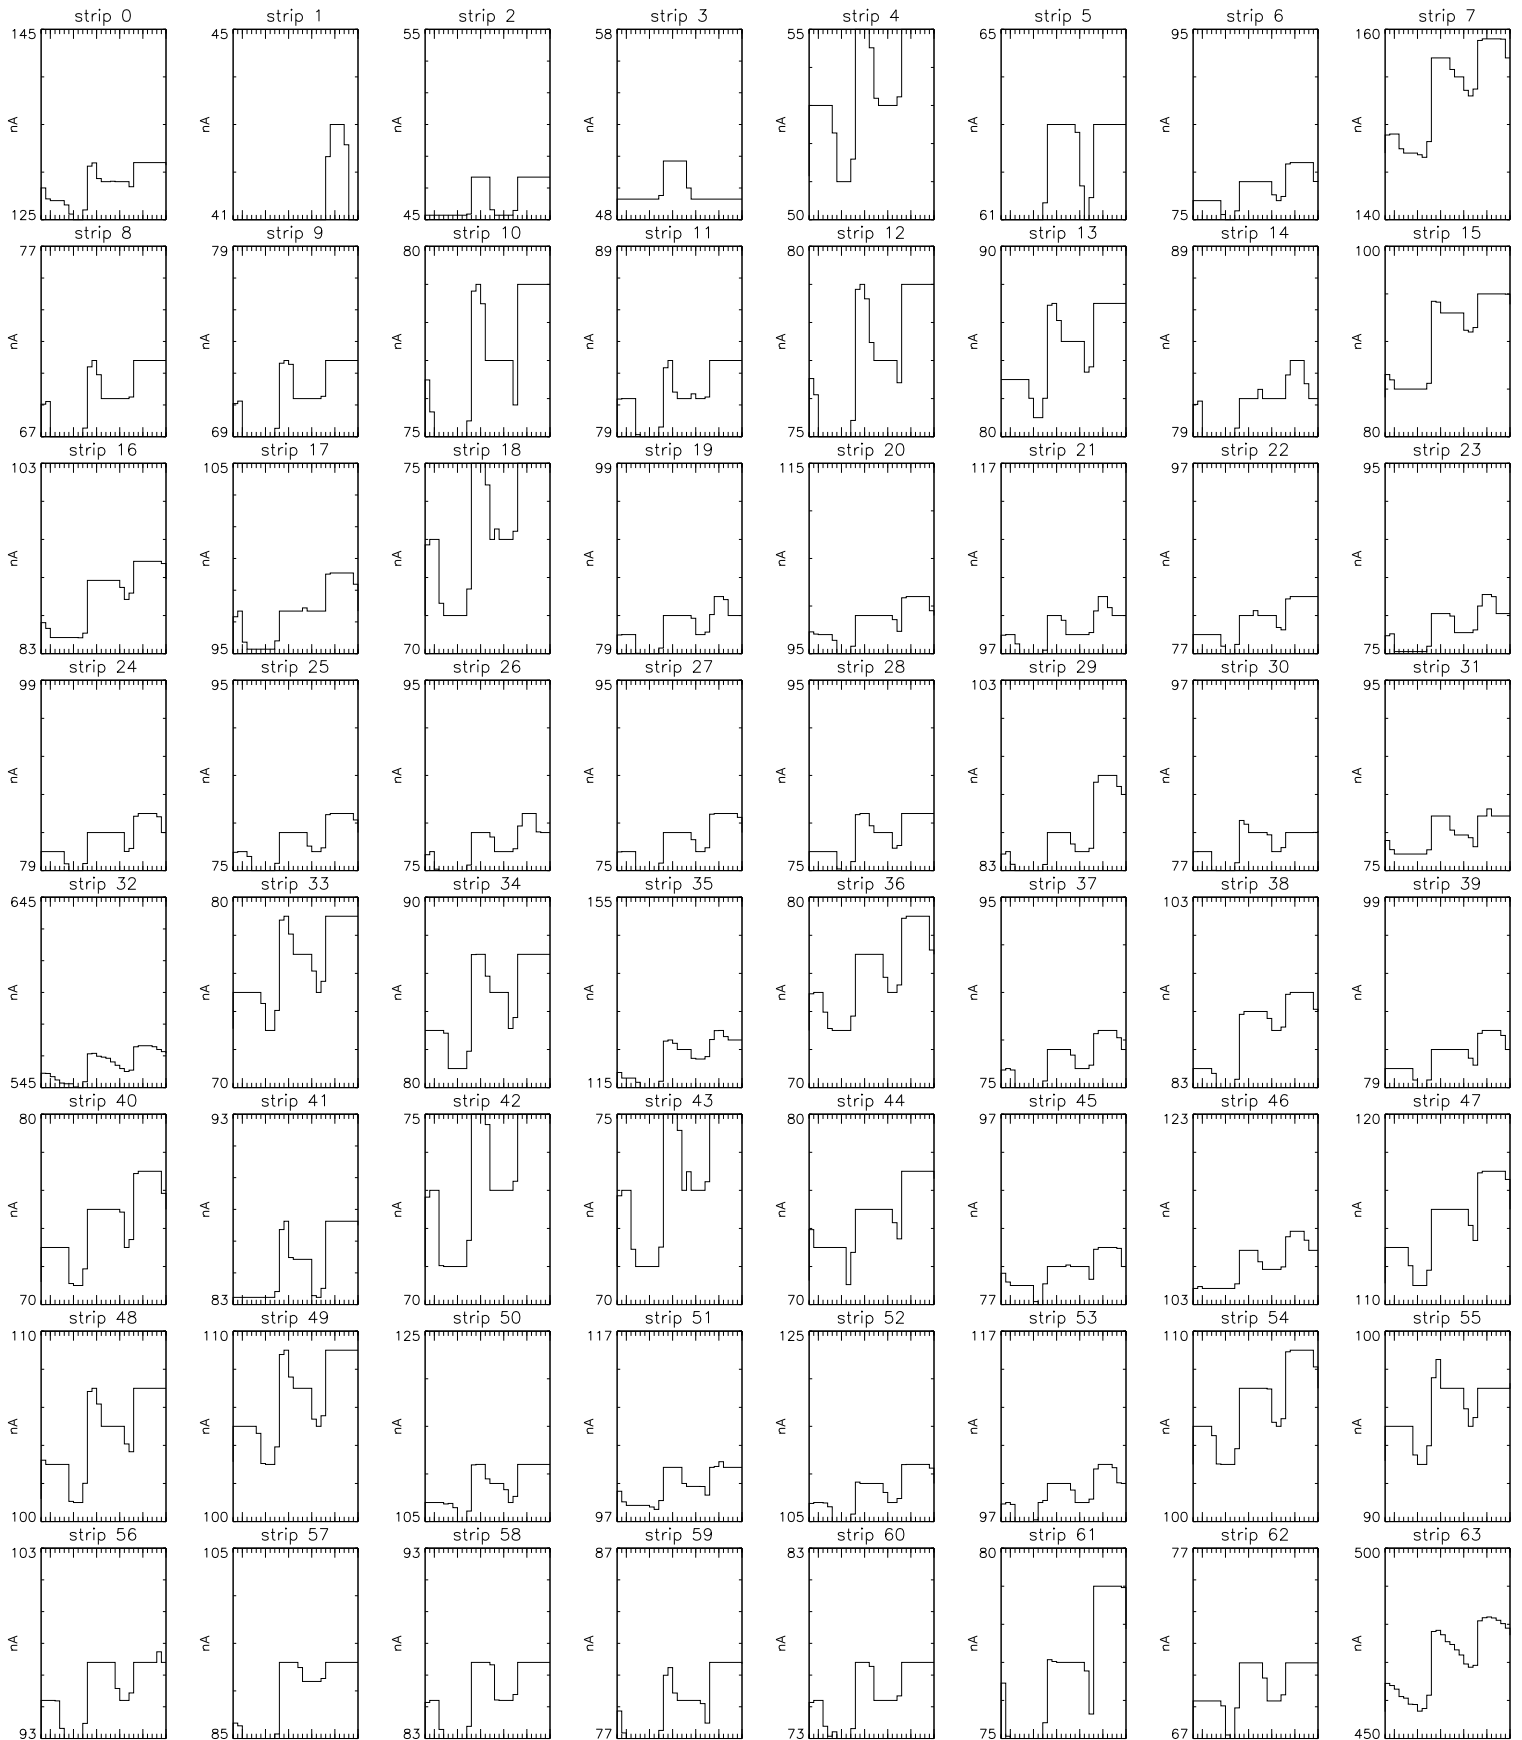

6 11 16 21 26 31


time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
 Leakage Current – M1B – Ground Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

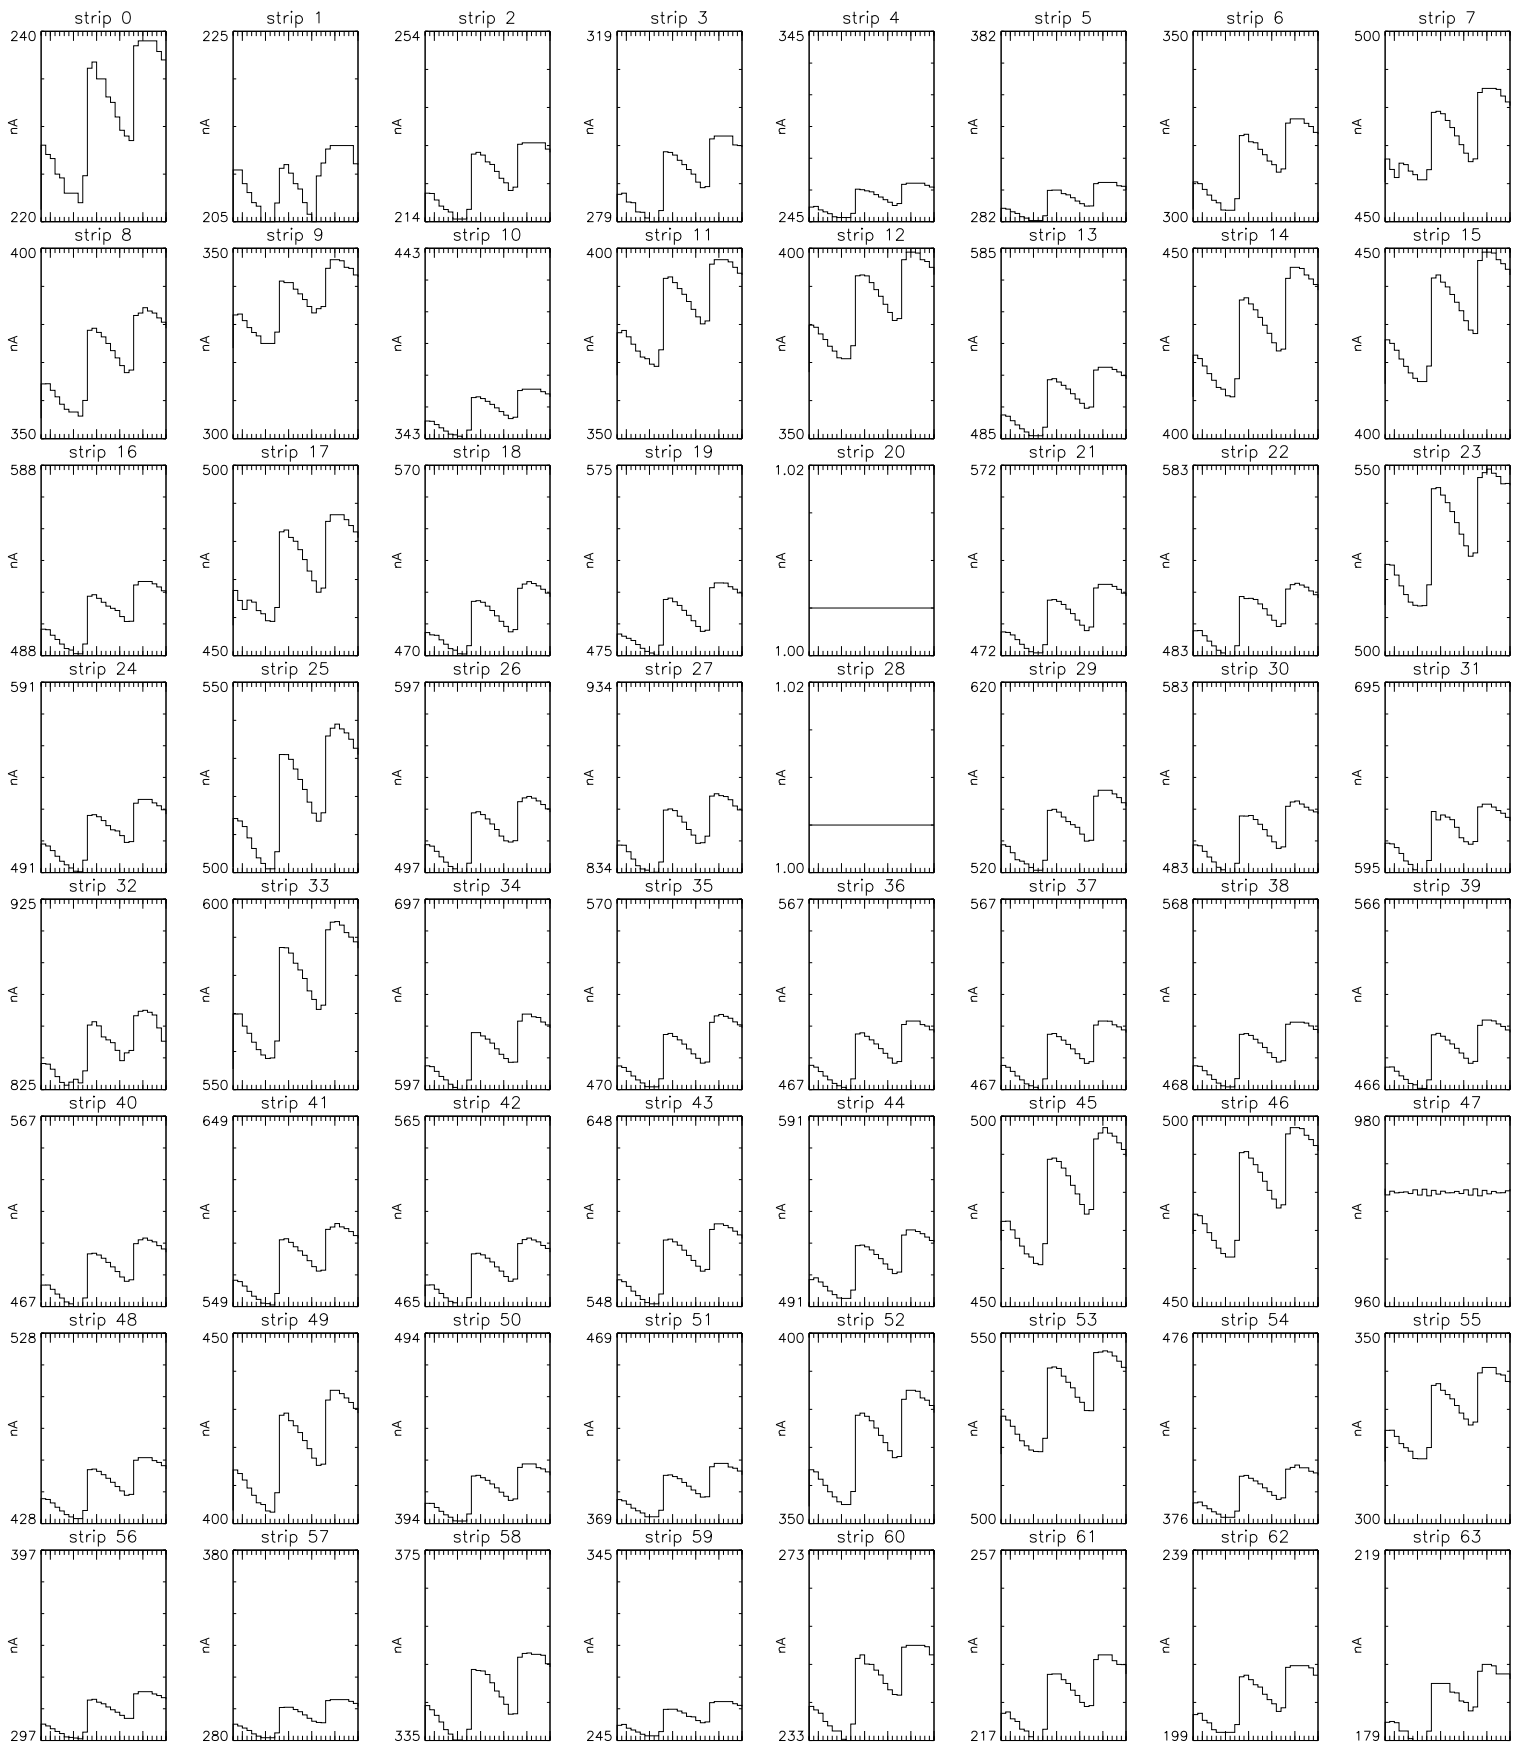


6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
 Leakage Current – M1B – High Voltage Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

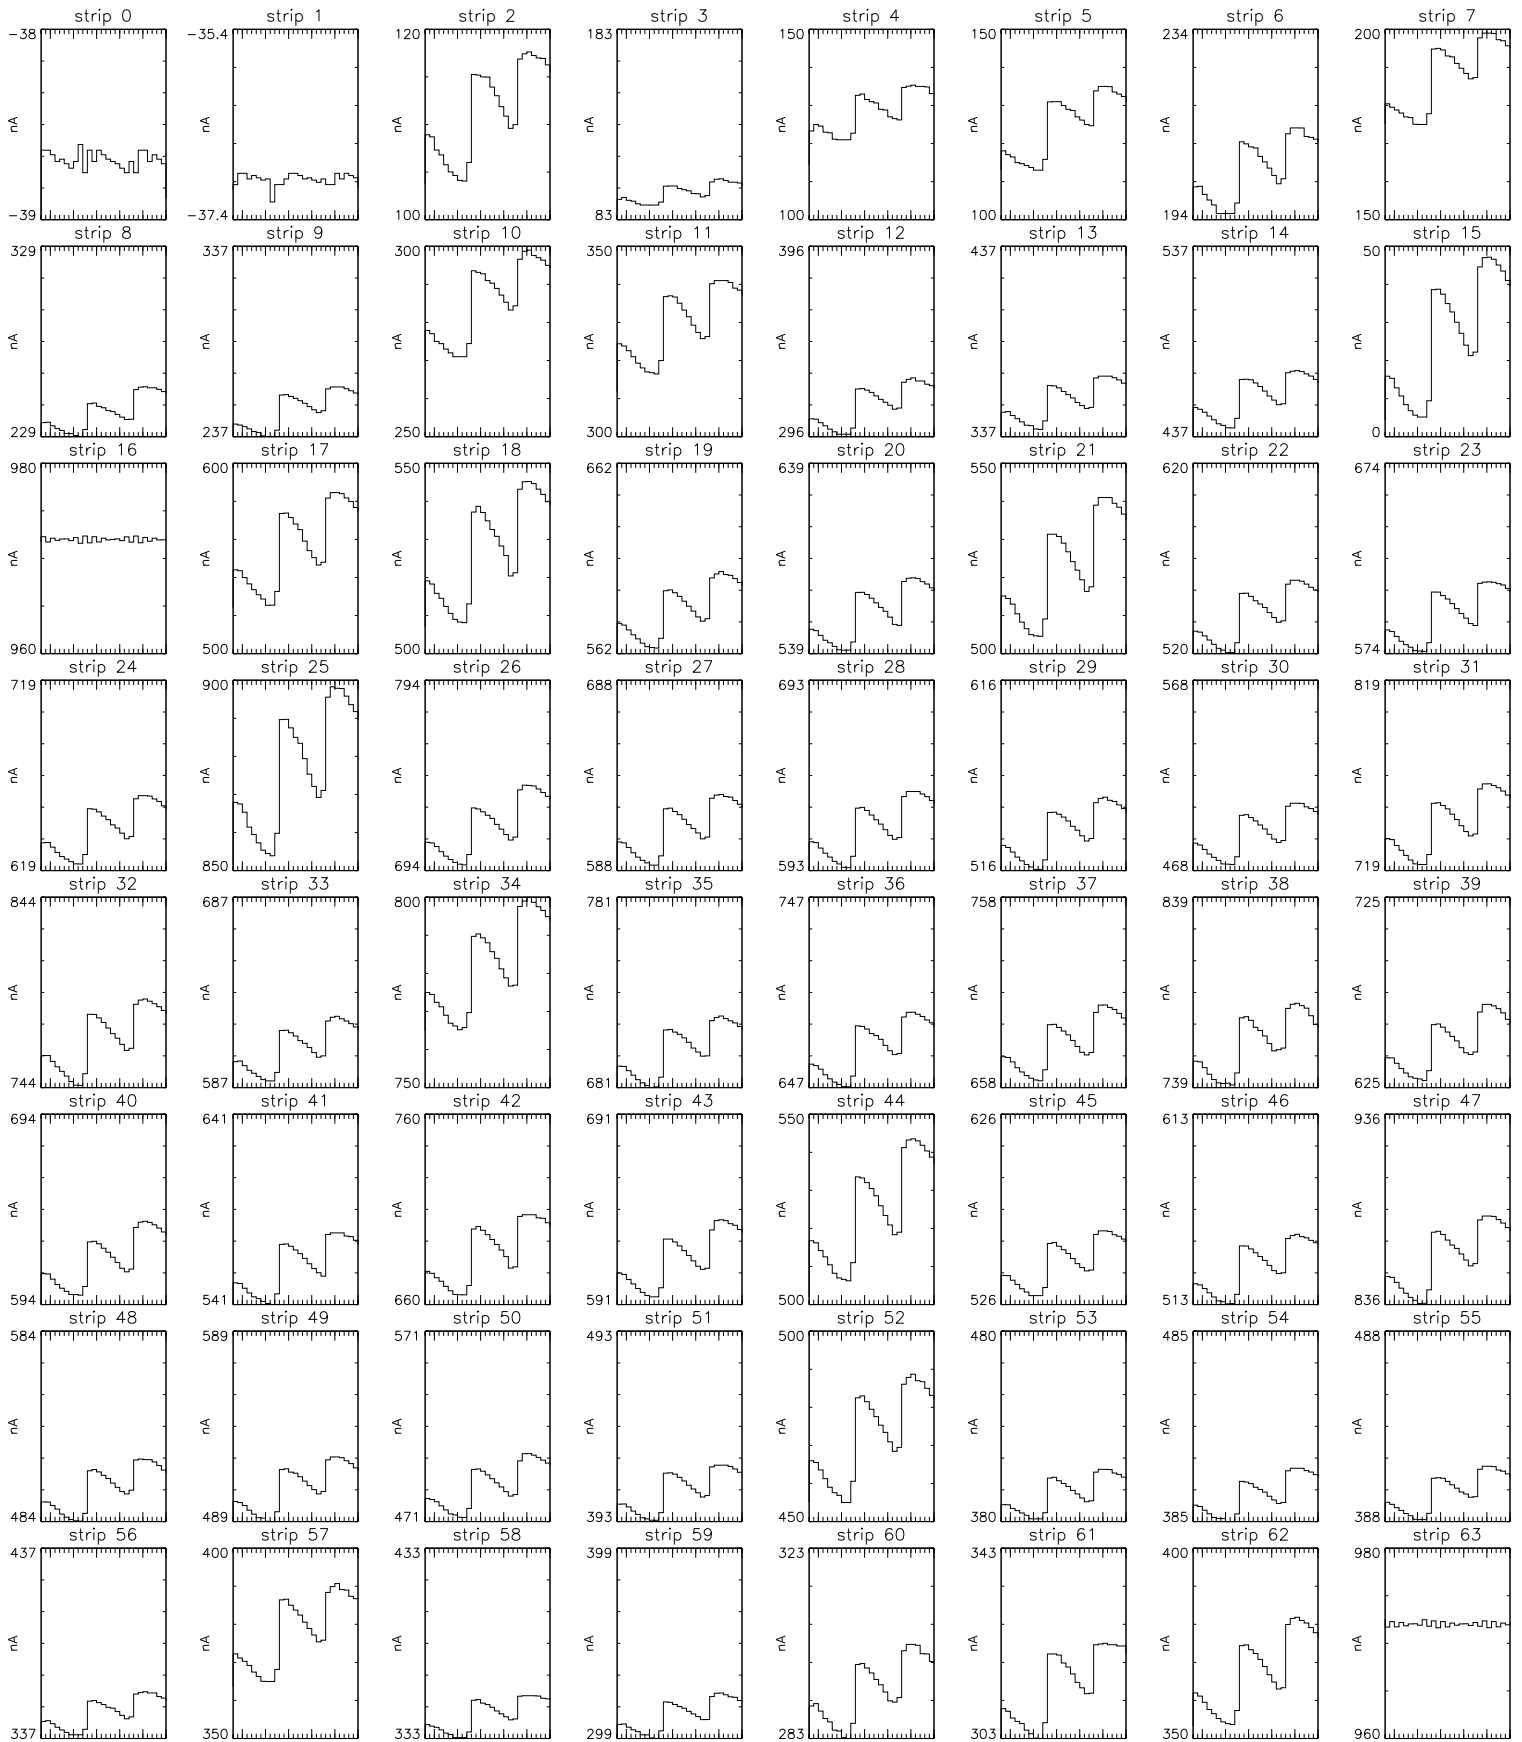


6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
 Leakage Current – M2B – Ground Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

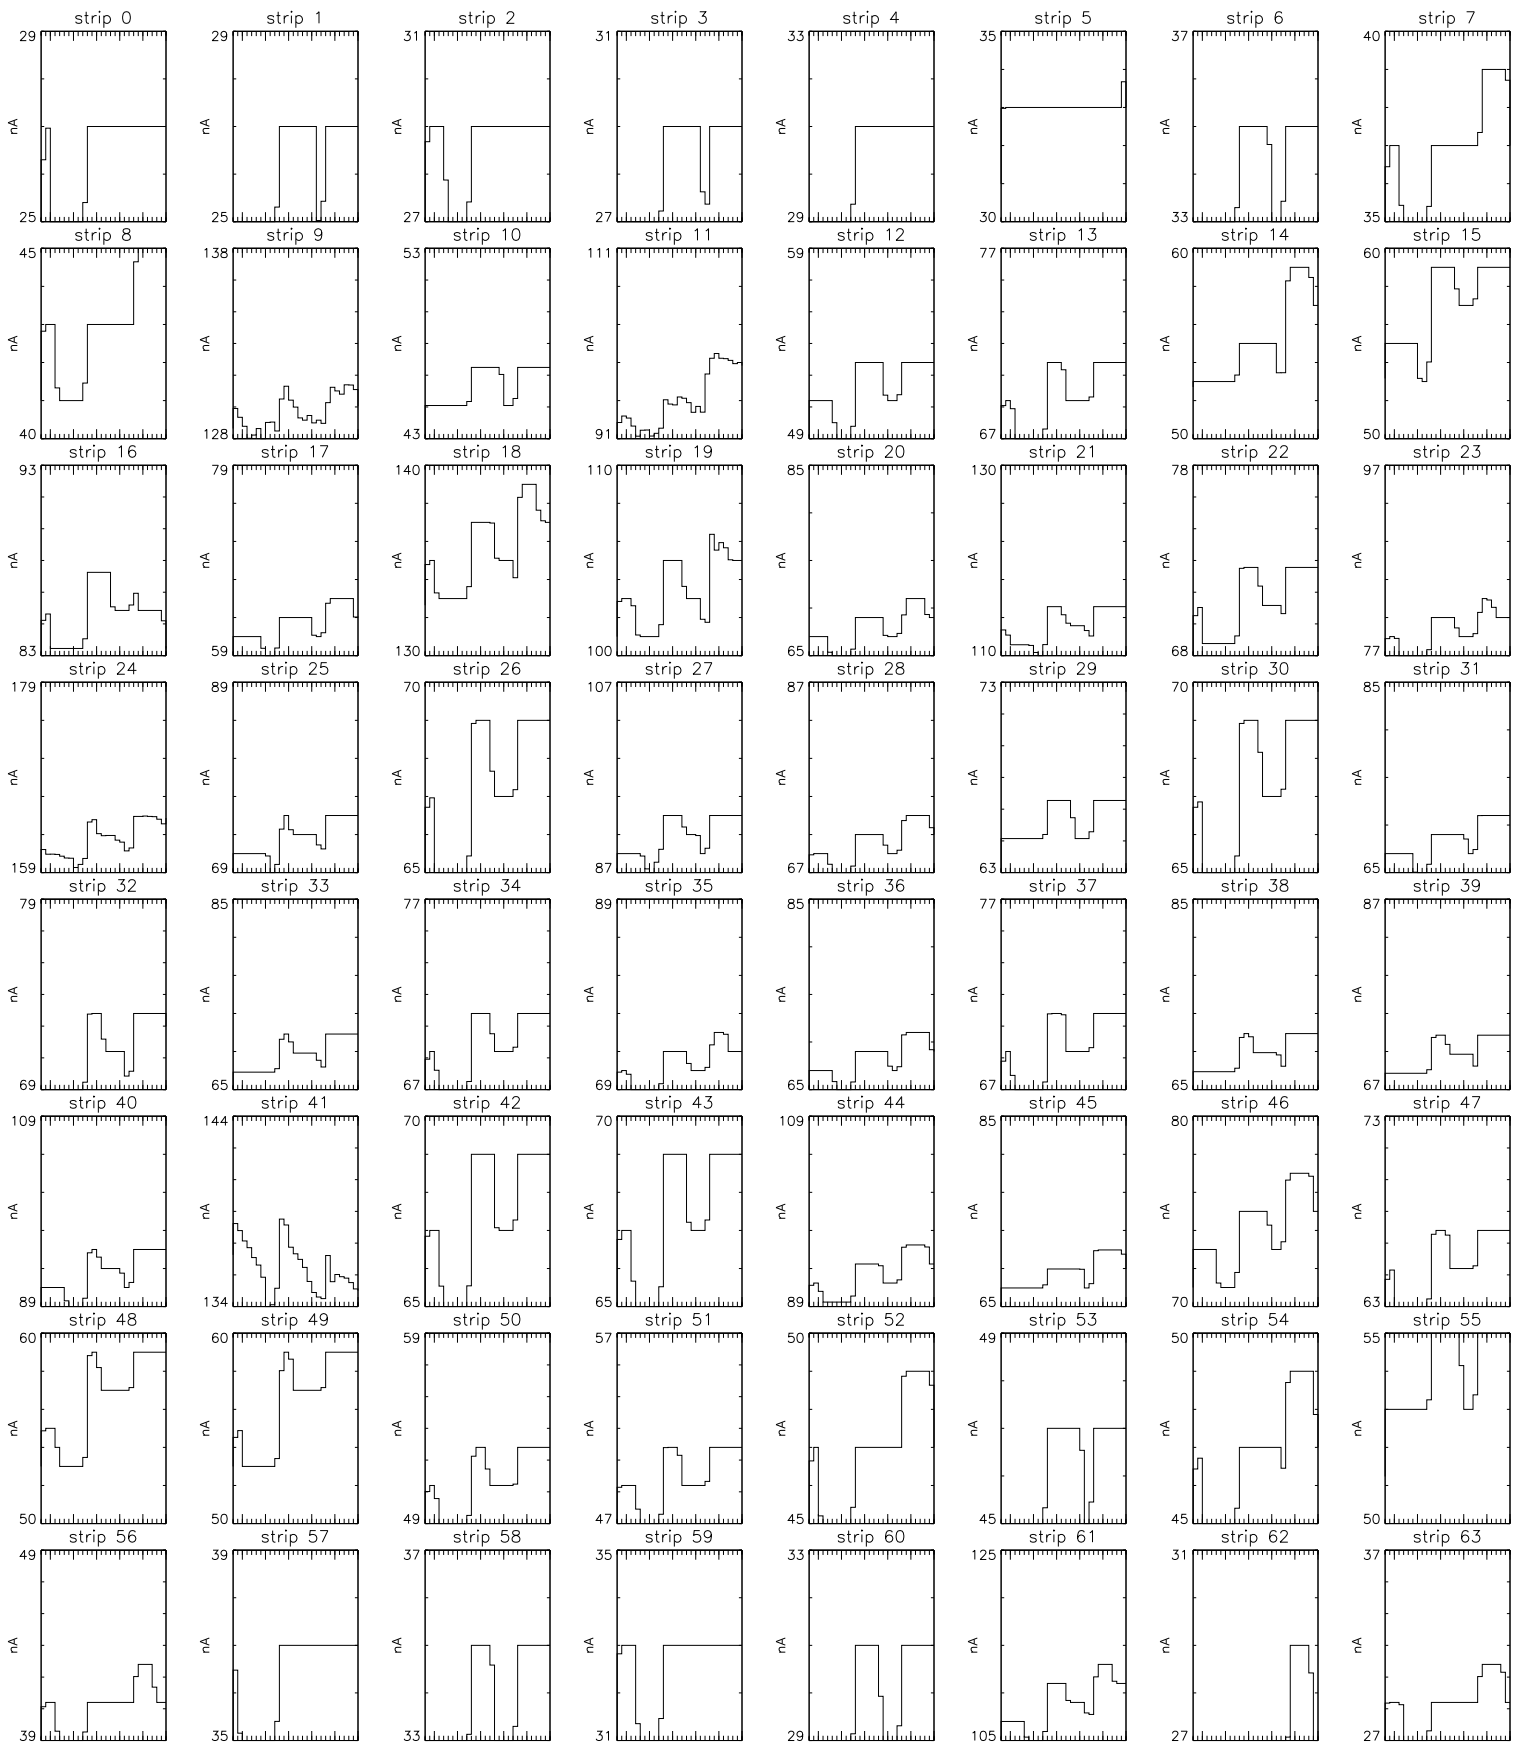

6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)

Bartels Rotation 2420 – Daily Averages
 Leakage Current – M2B – High Voltage Side
 (04-Dec-2010 thru 30-Dec-2010) (338/2010 thru 364/2010)

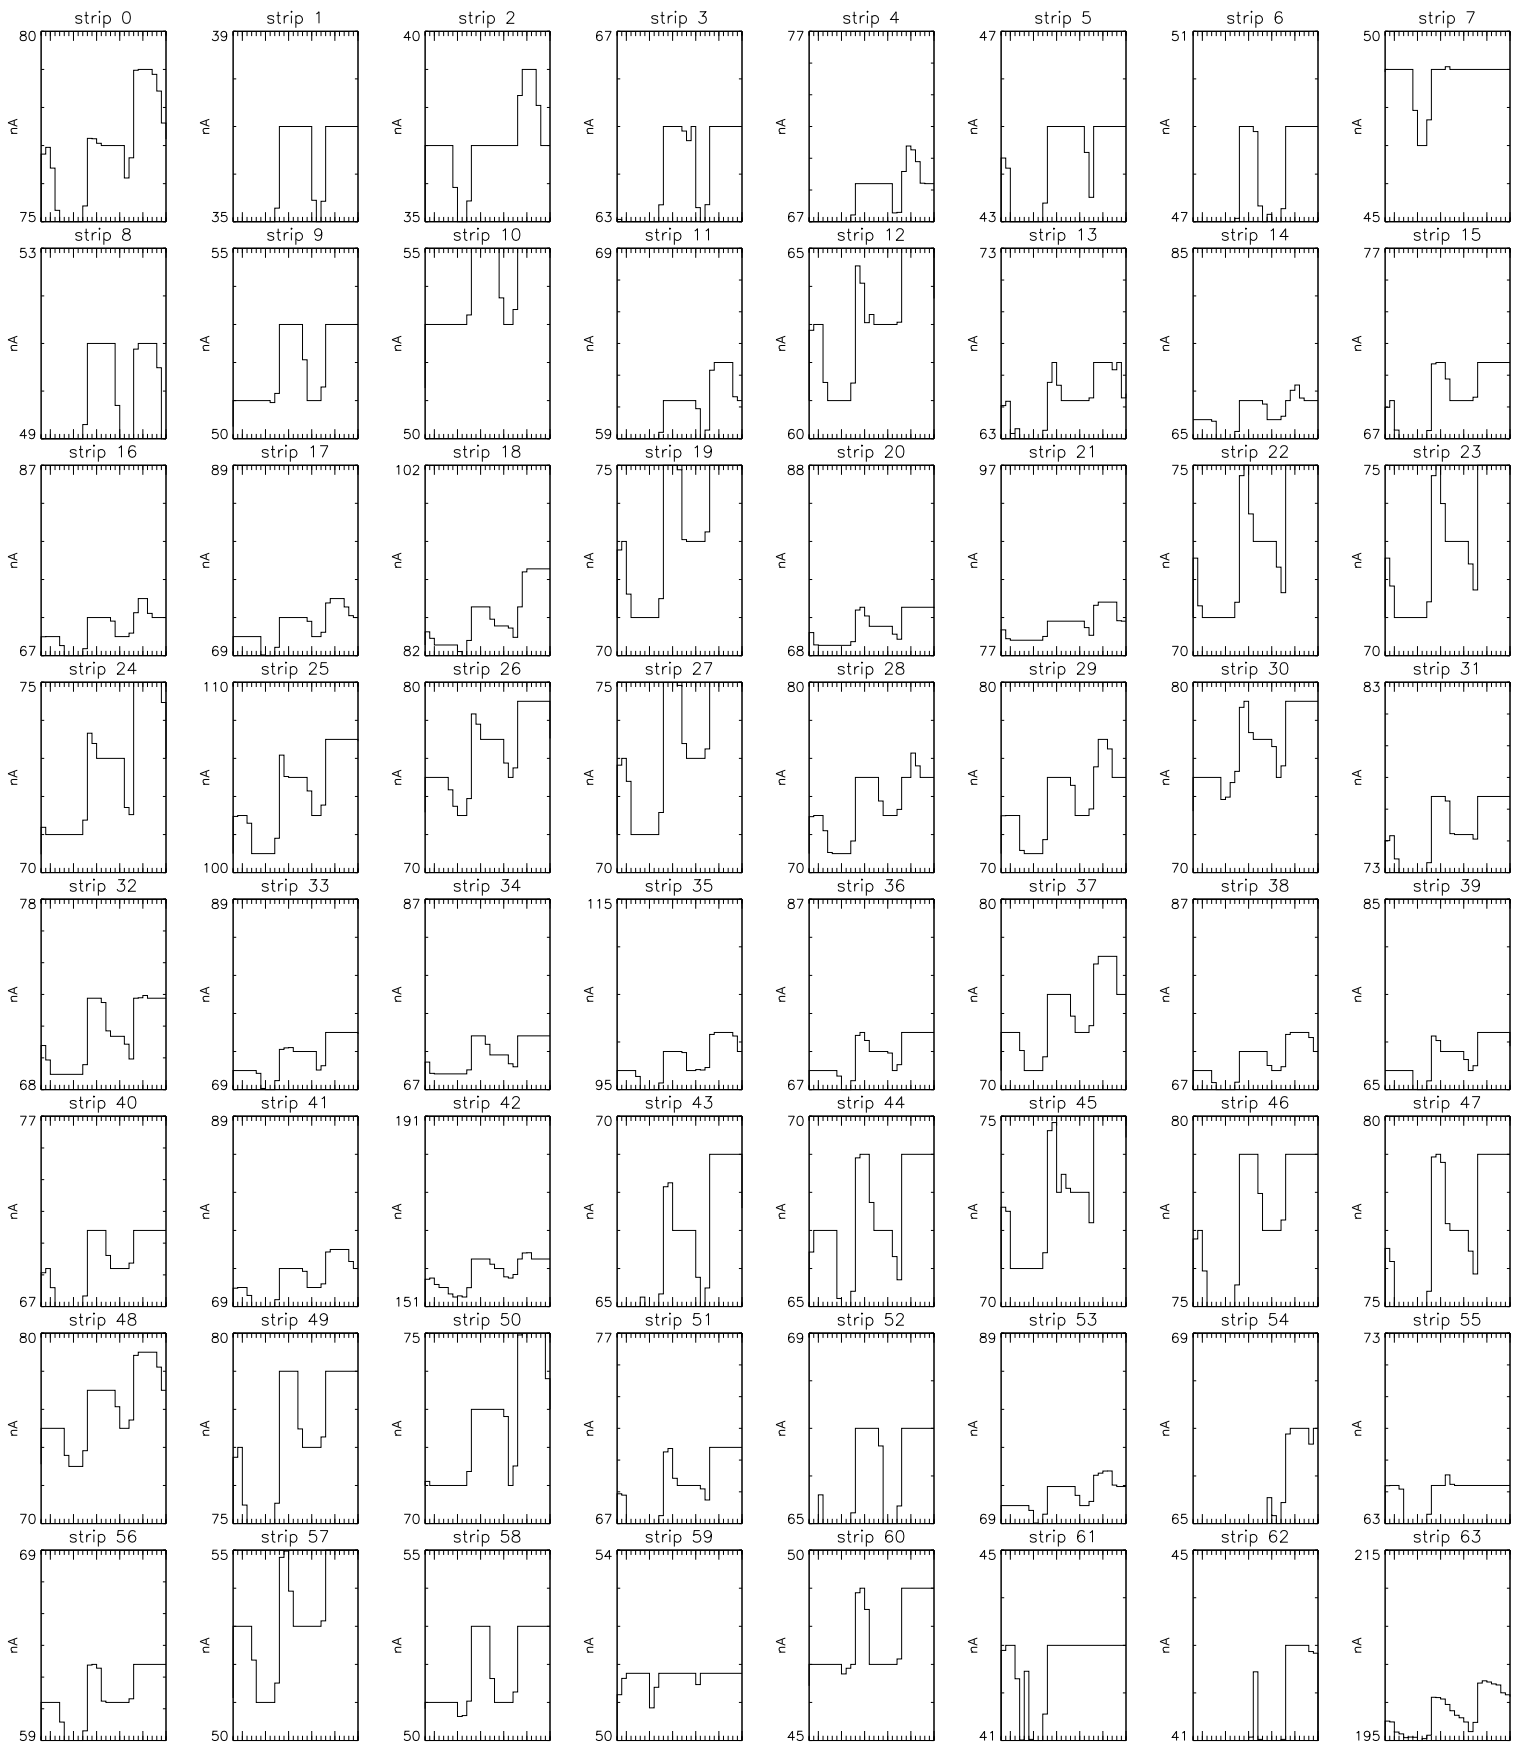

6 11 16 21 26 31
 time (04-Dec-2010 to 31-Dec-2010)