



Bartels Rotation 2491 – Daily Averages  
Leakage Current – M1A – Ground Side  
(04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

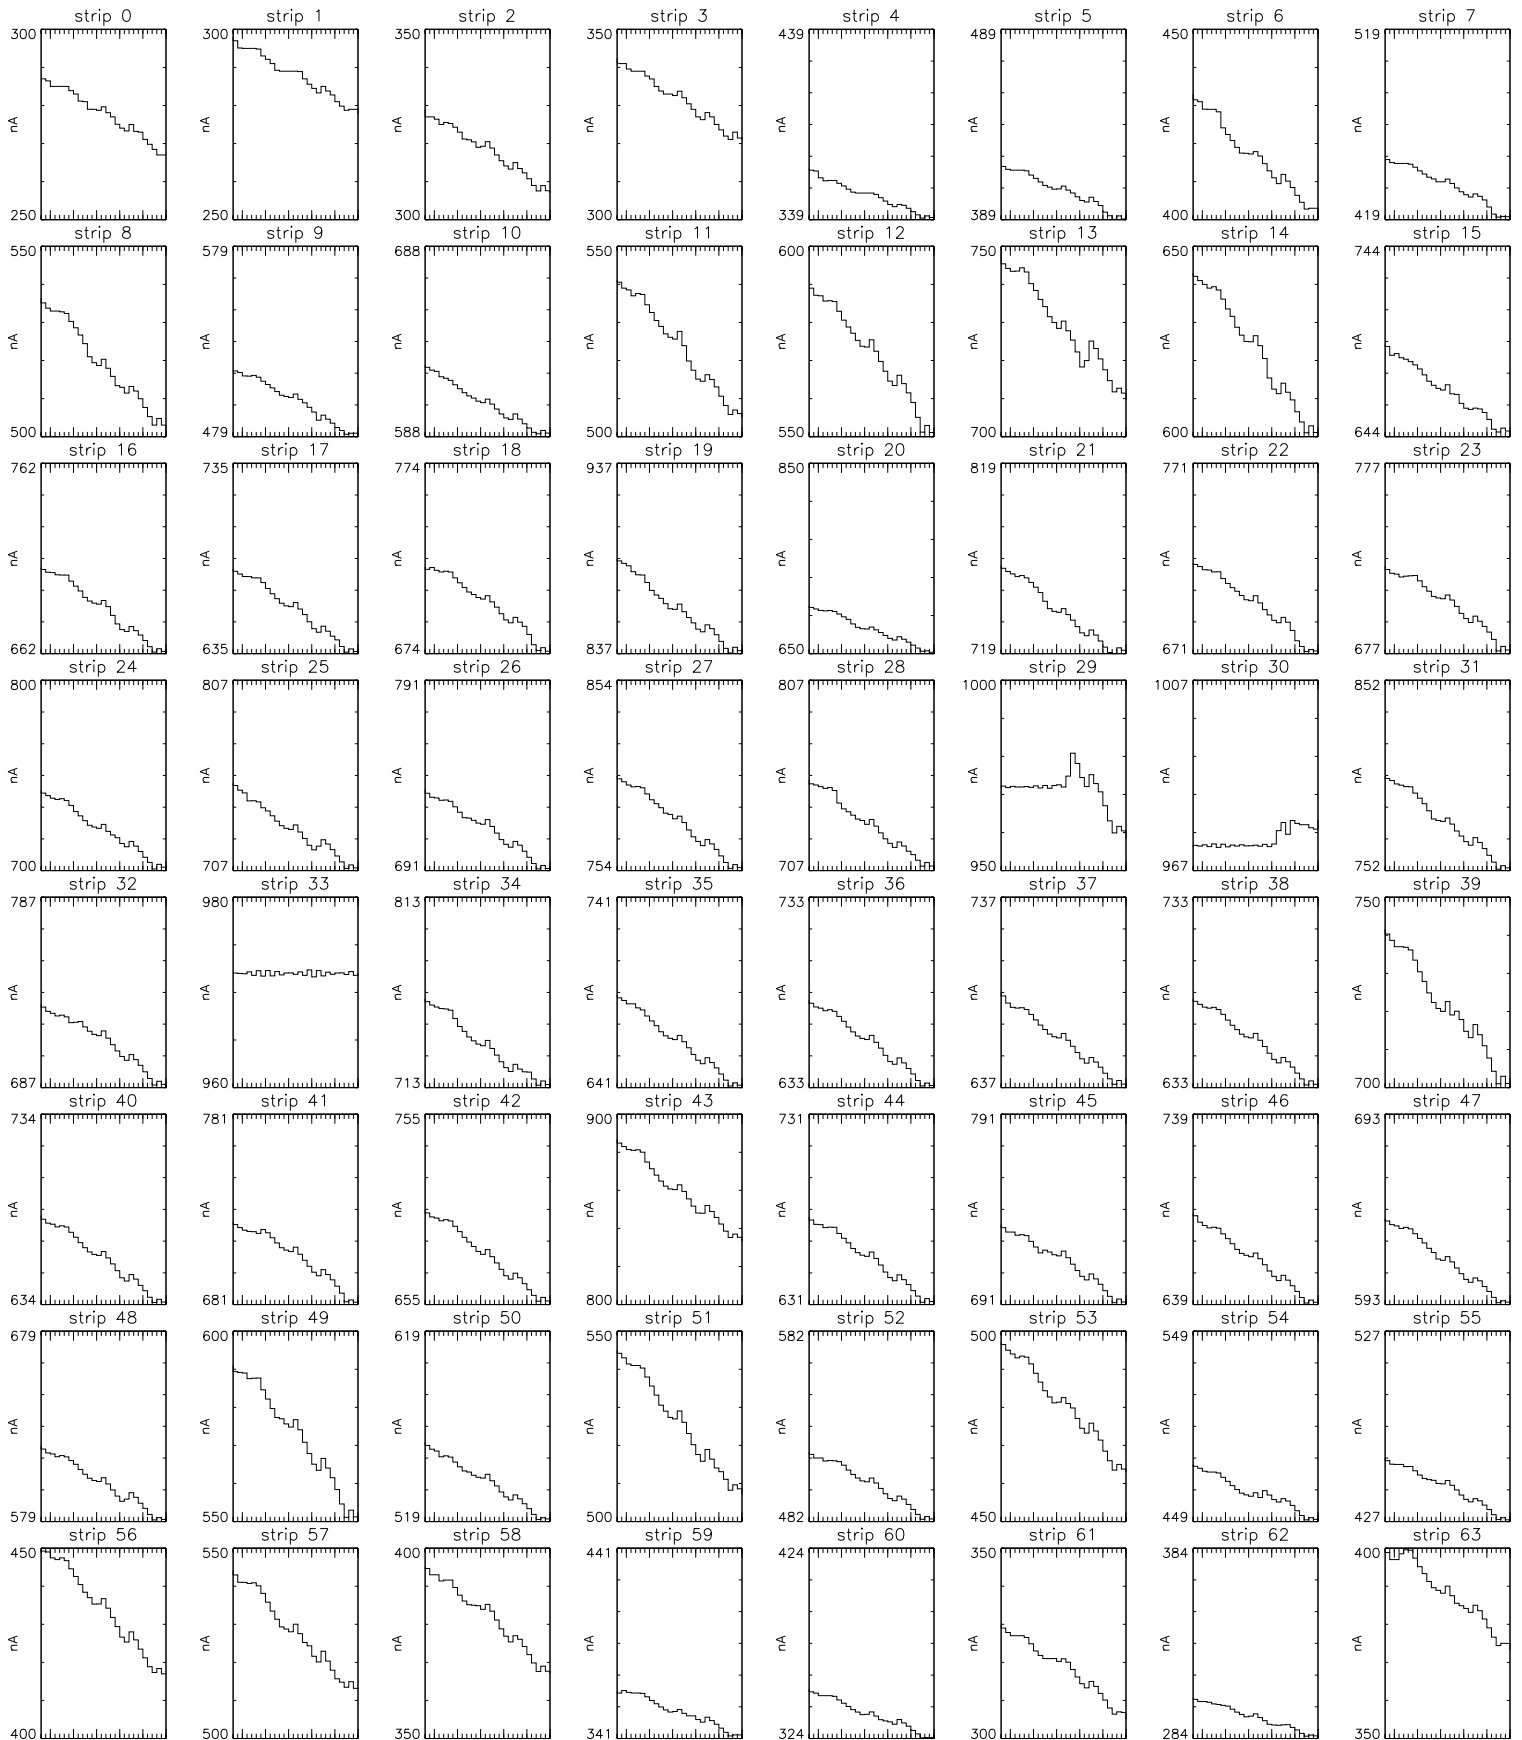


6 11 16 21 26 31  
time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
 Leakage Current – M1A – High Voltage Side  
 (04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

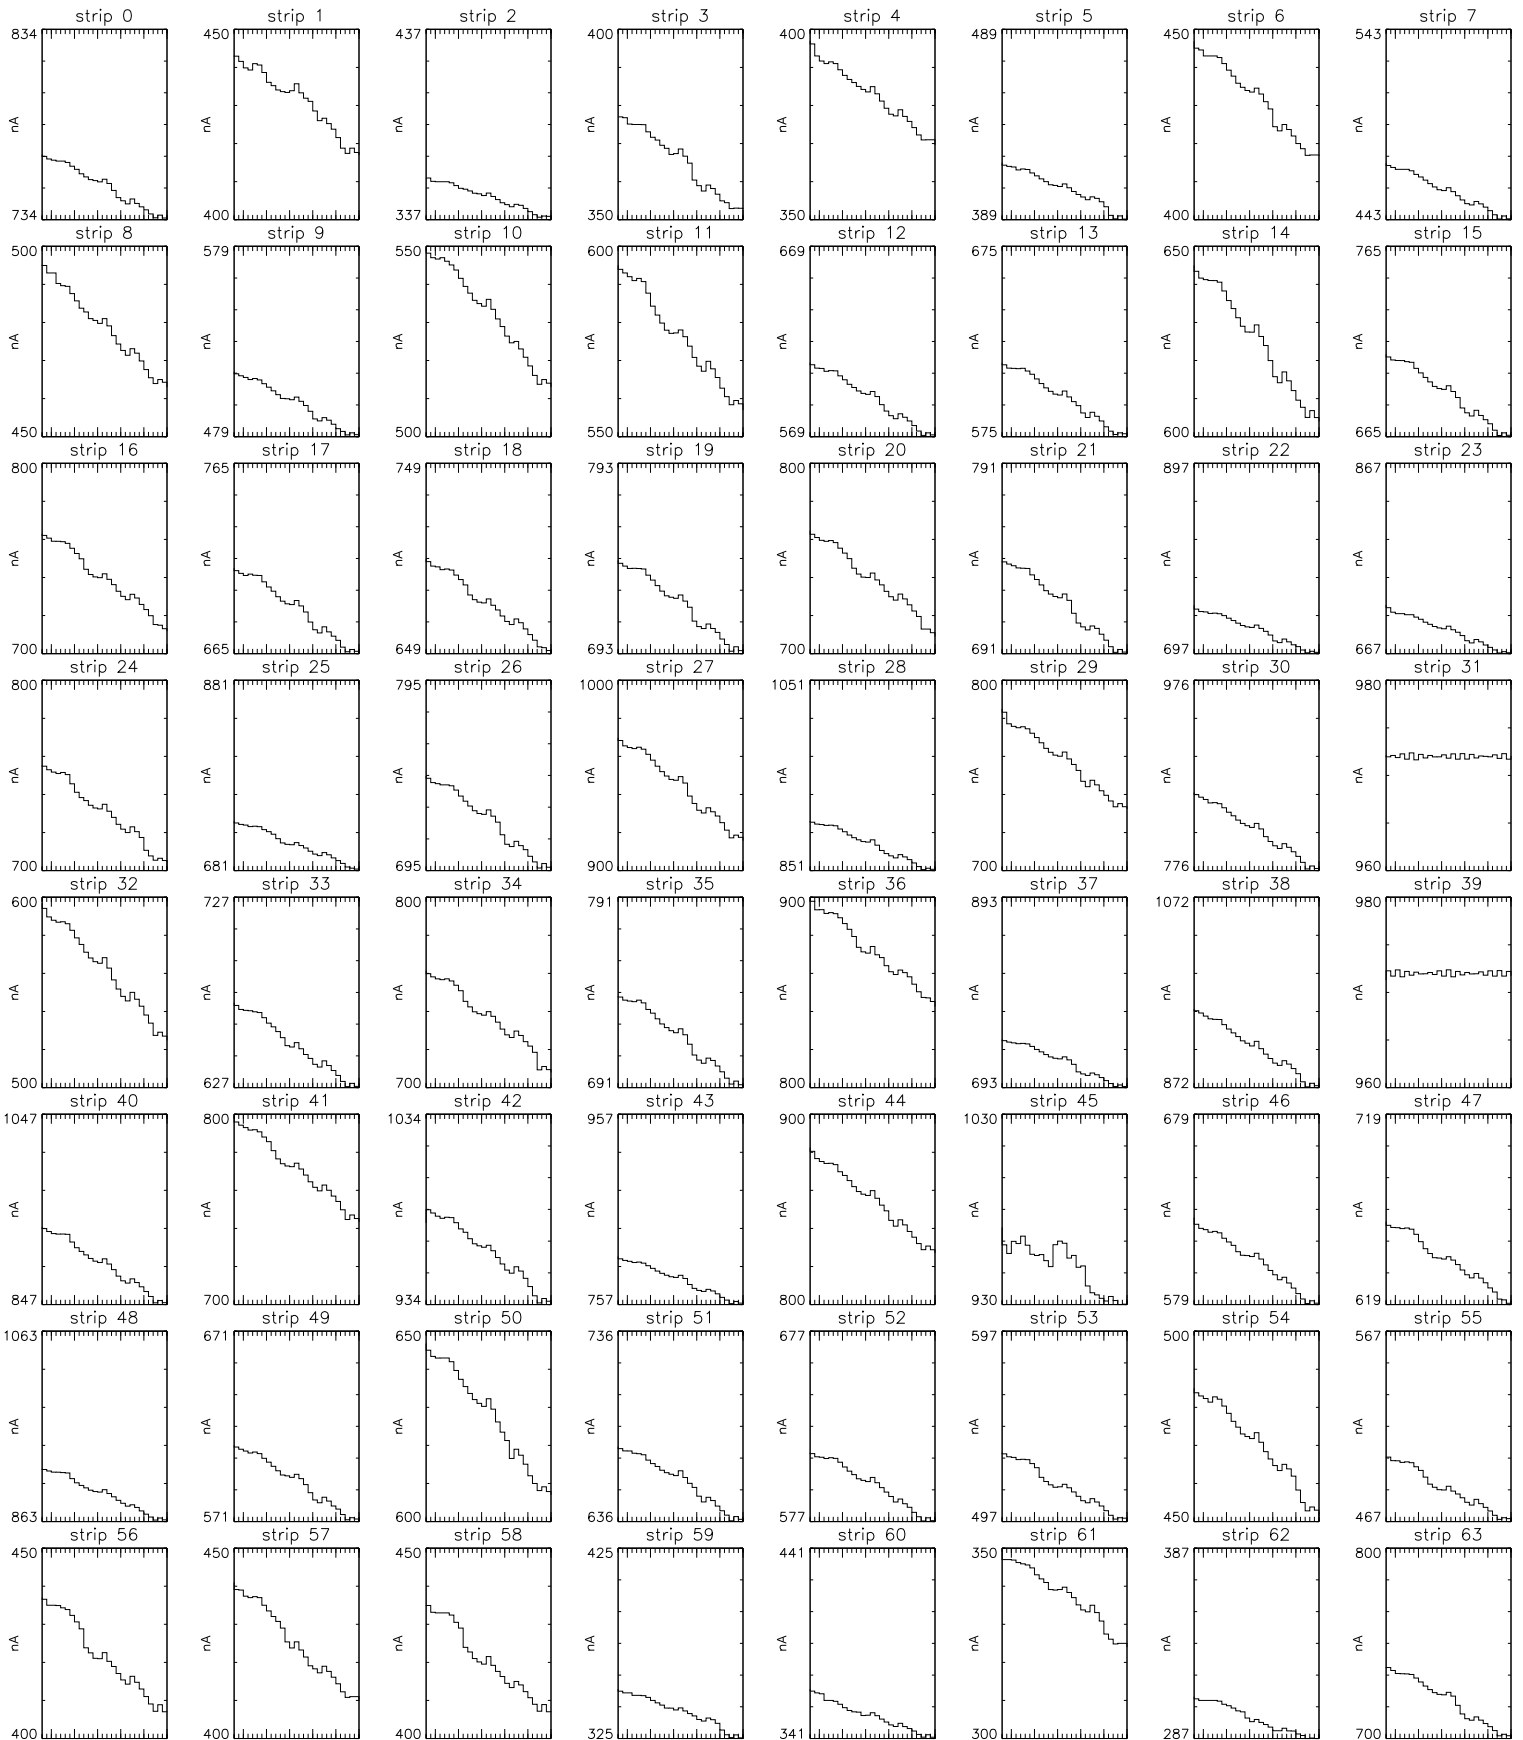


6 11 16 21 26 31  
 time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
 Leakage Current – M2A – Ground Side  
 (04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

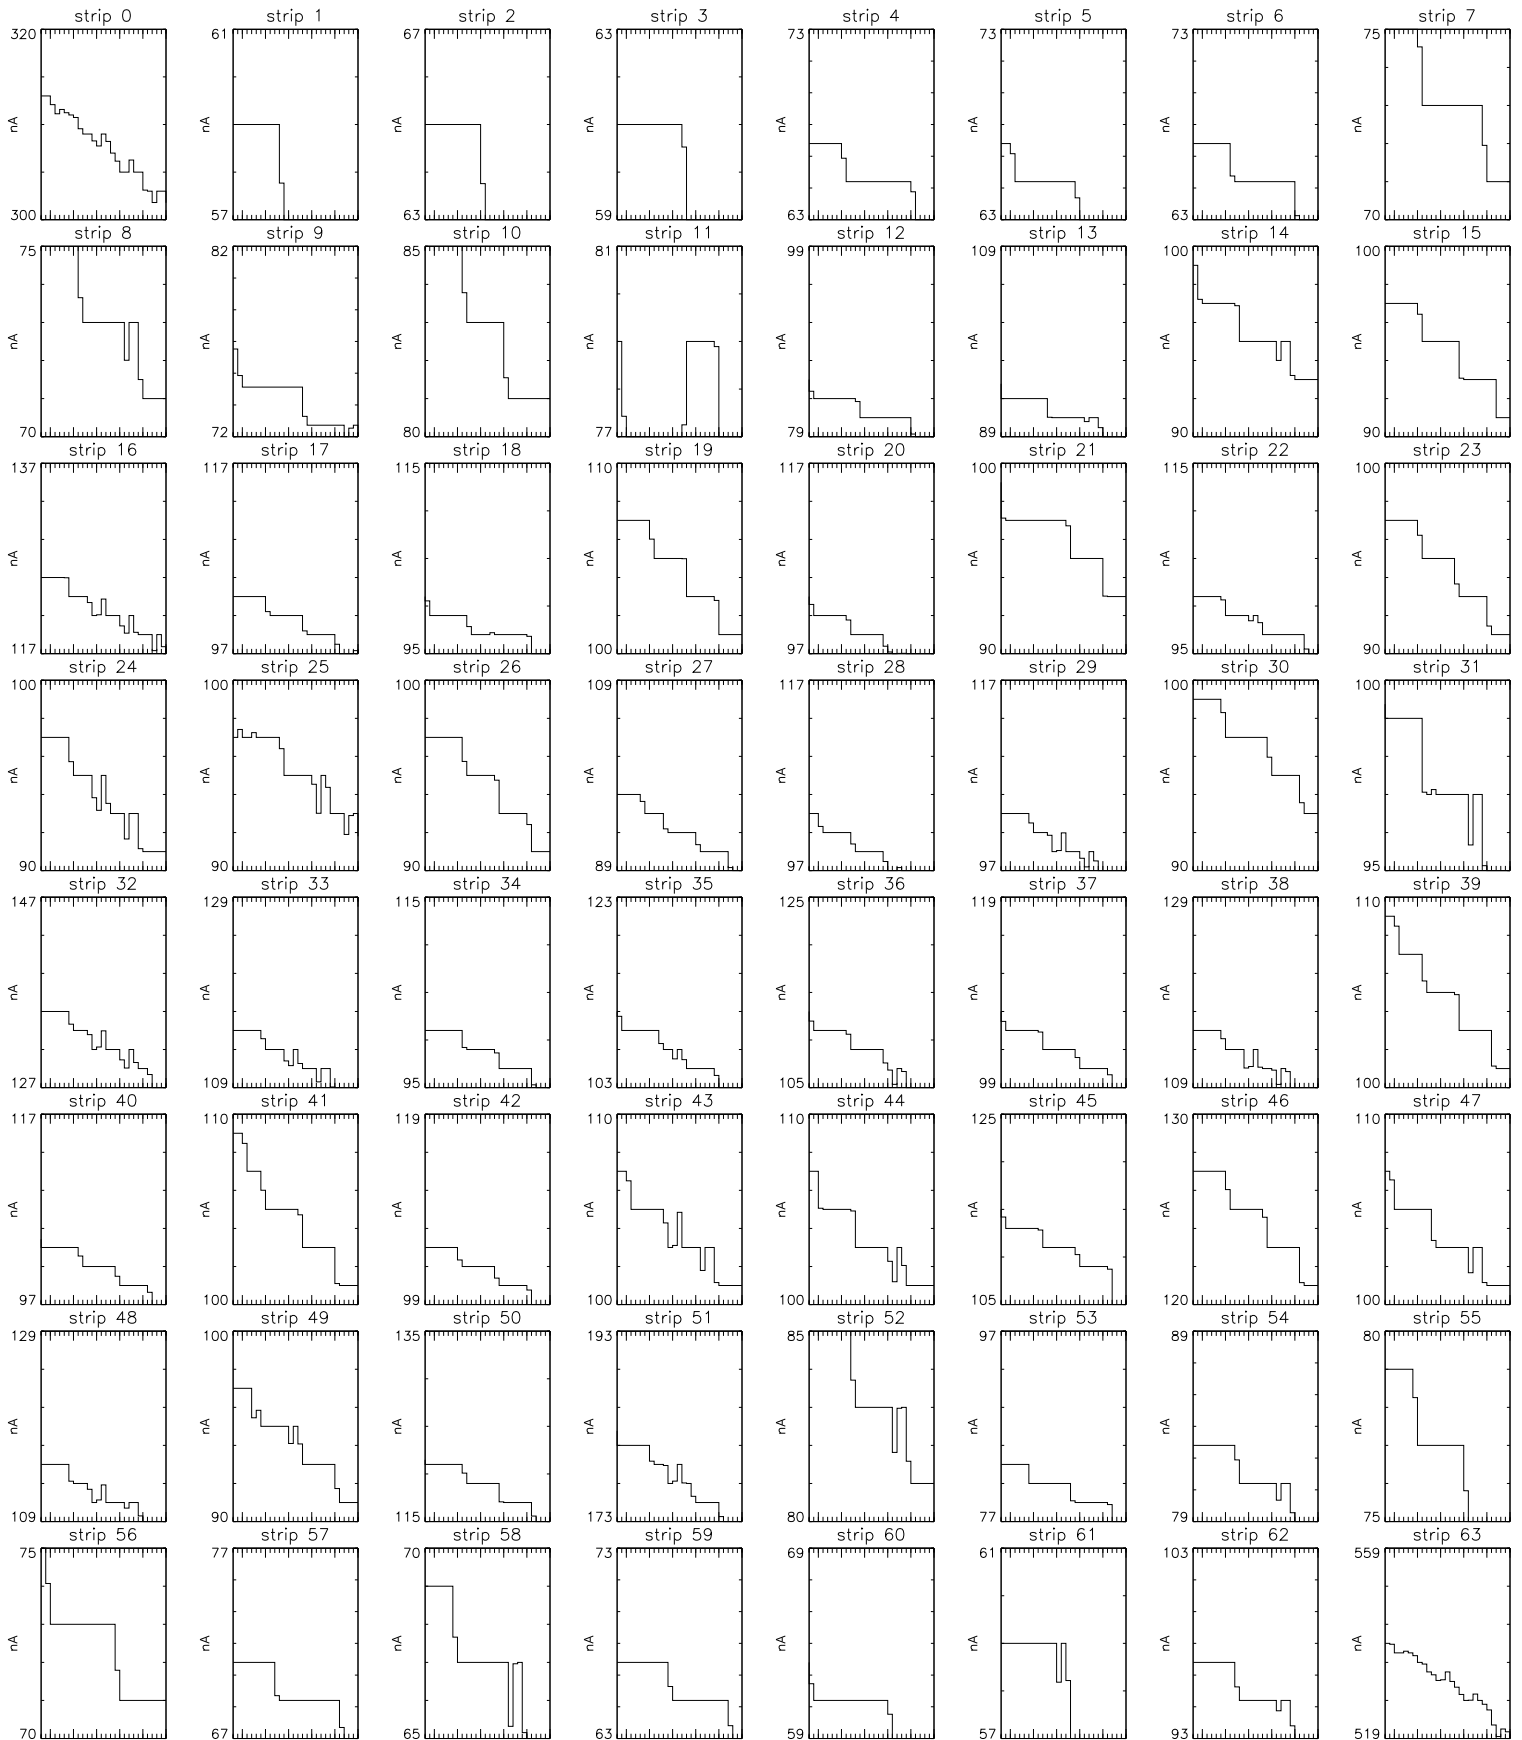


6 11 16 21 26 31  
 time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
Leakage Current – M2A – High Voltage Side  
(04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

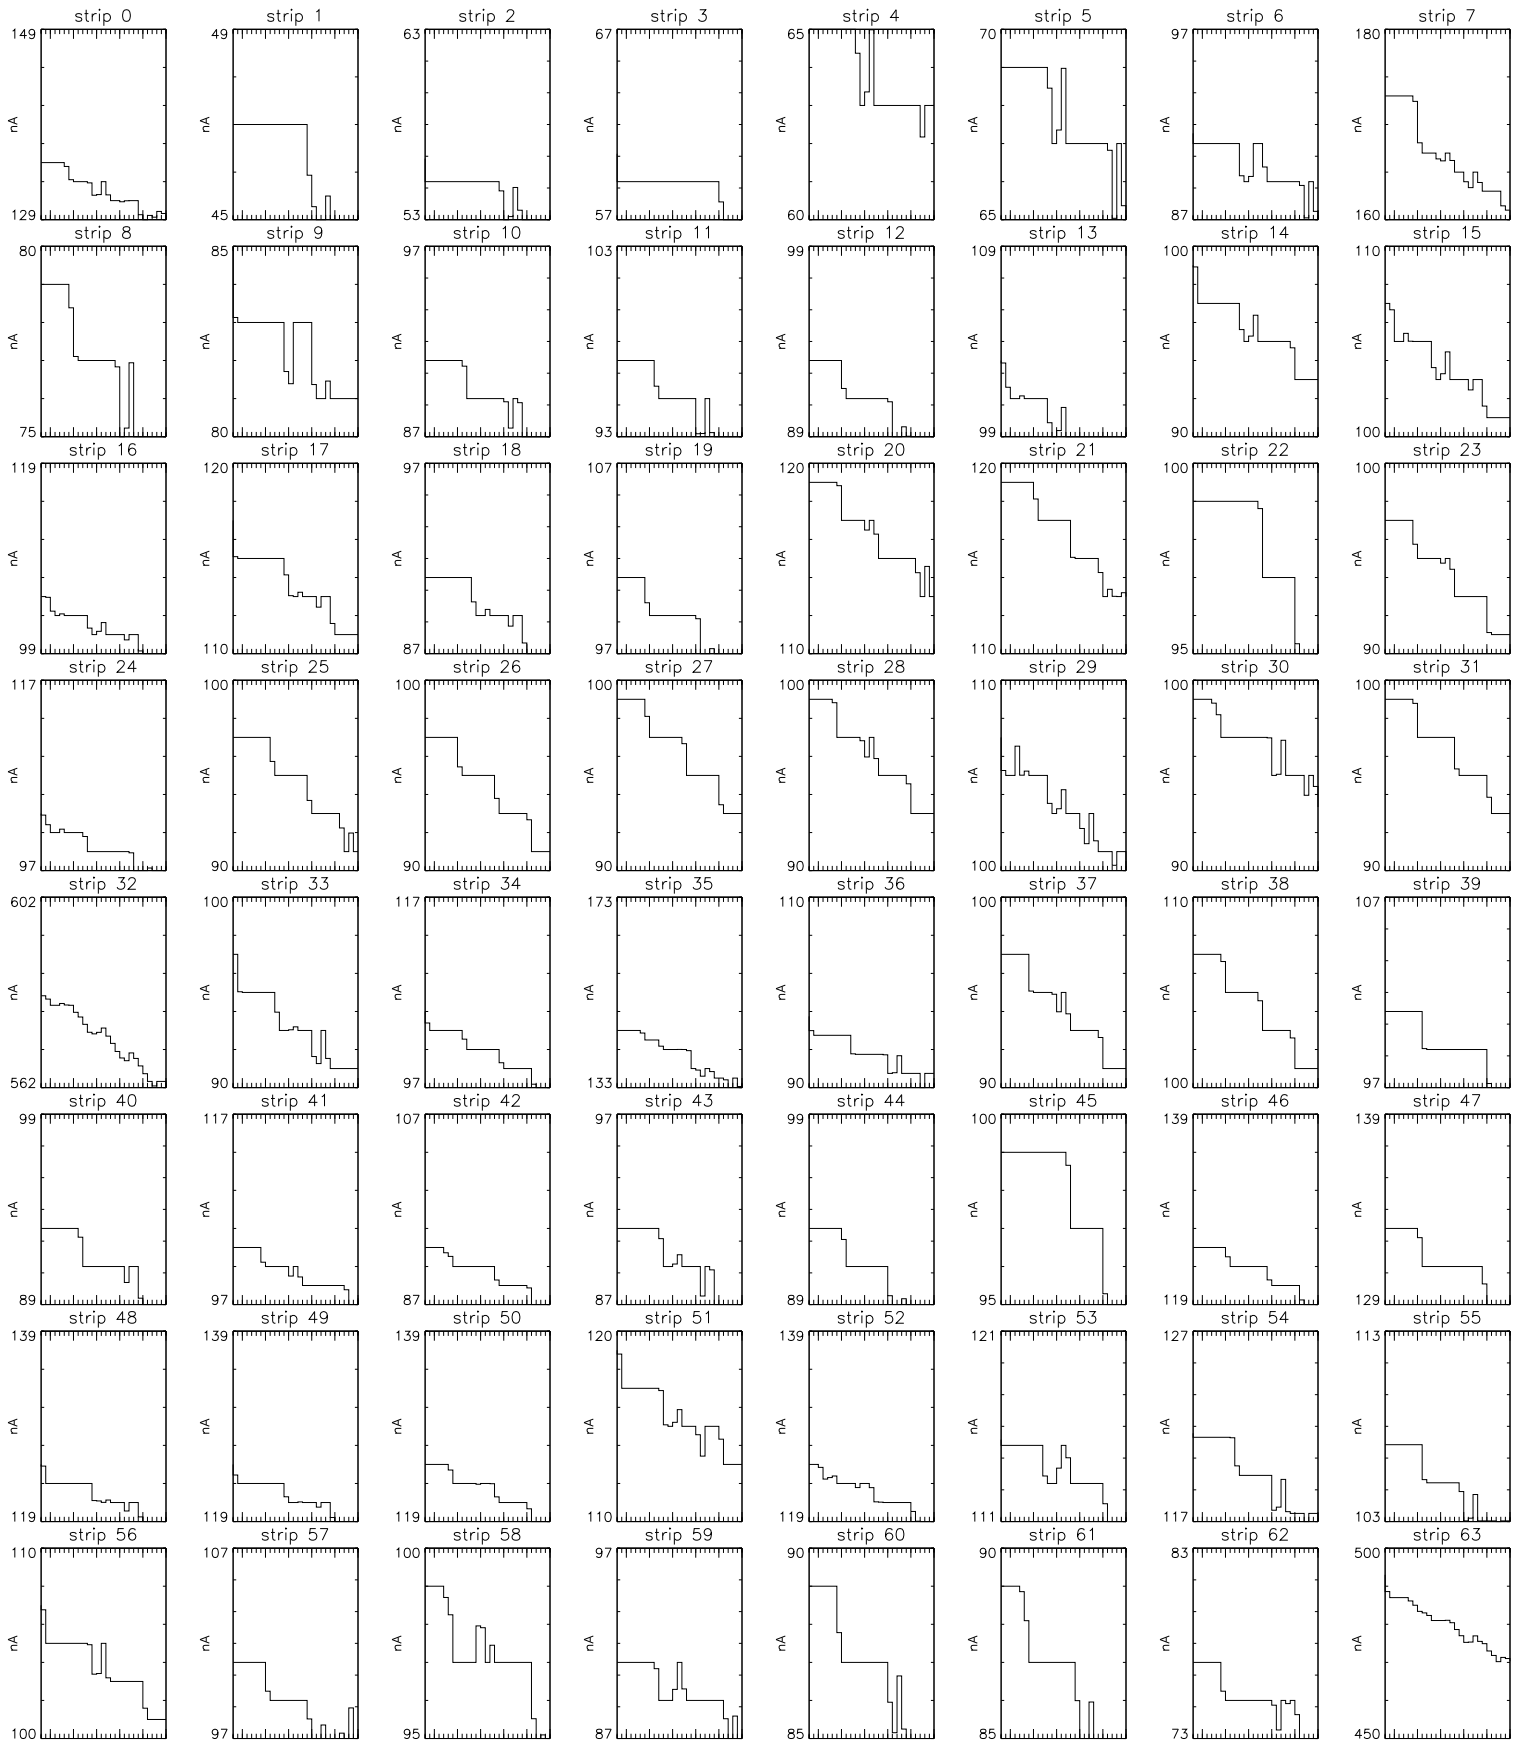



6 11 16 21 26 31  
time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
 Leakage Current – M1B – Ground Side  
 (04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

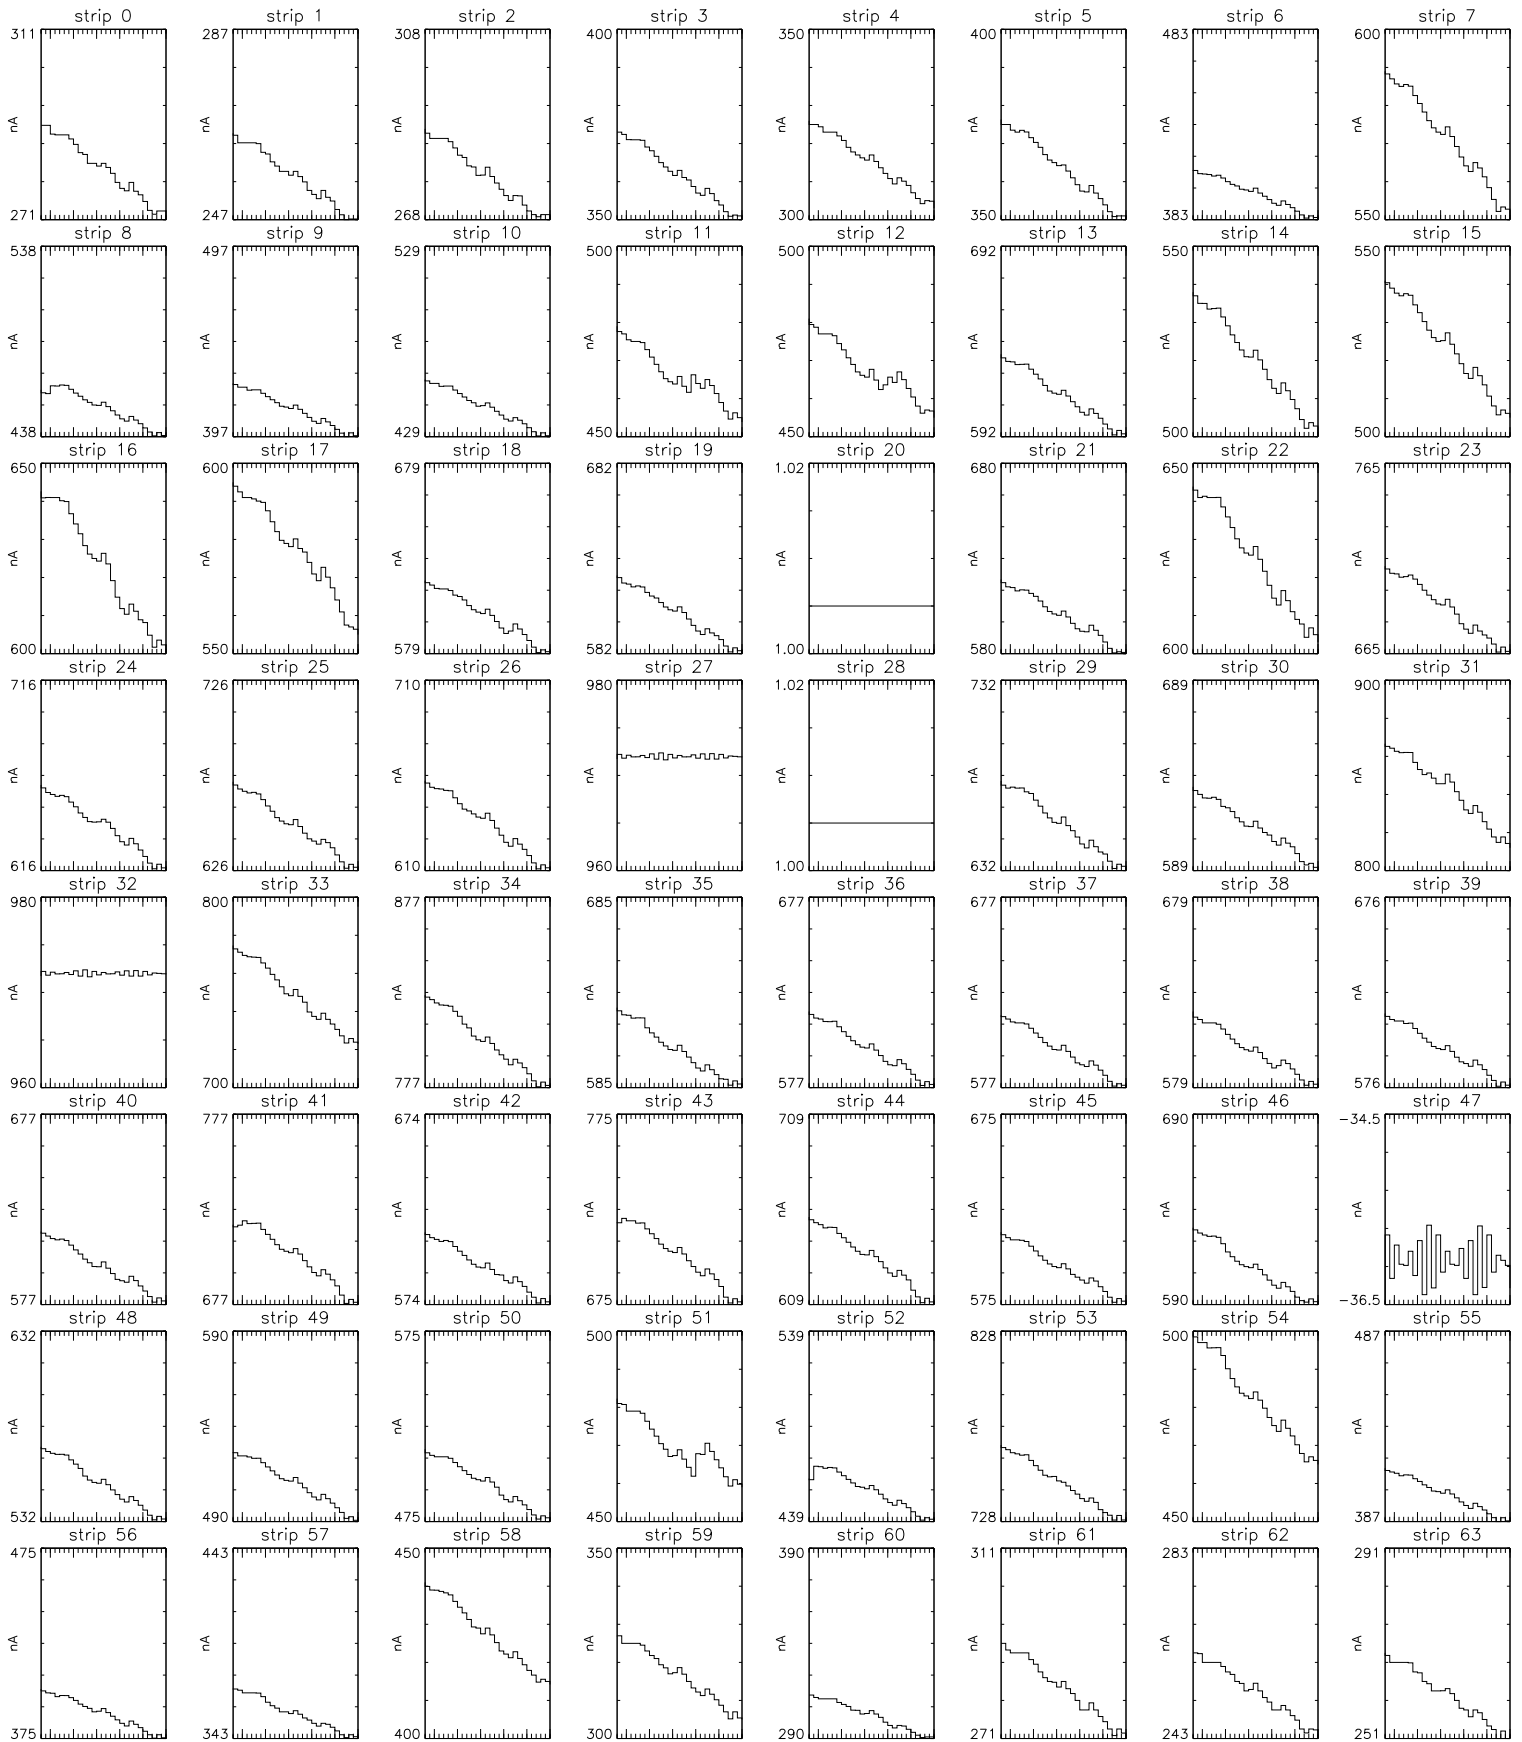


6 11 16 21 26 31  
 time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
 Leakage Current – M1B – High Voltage Side  
 (04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

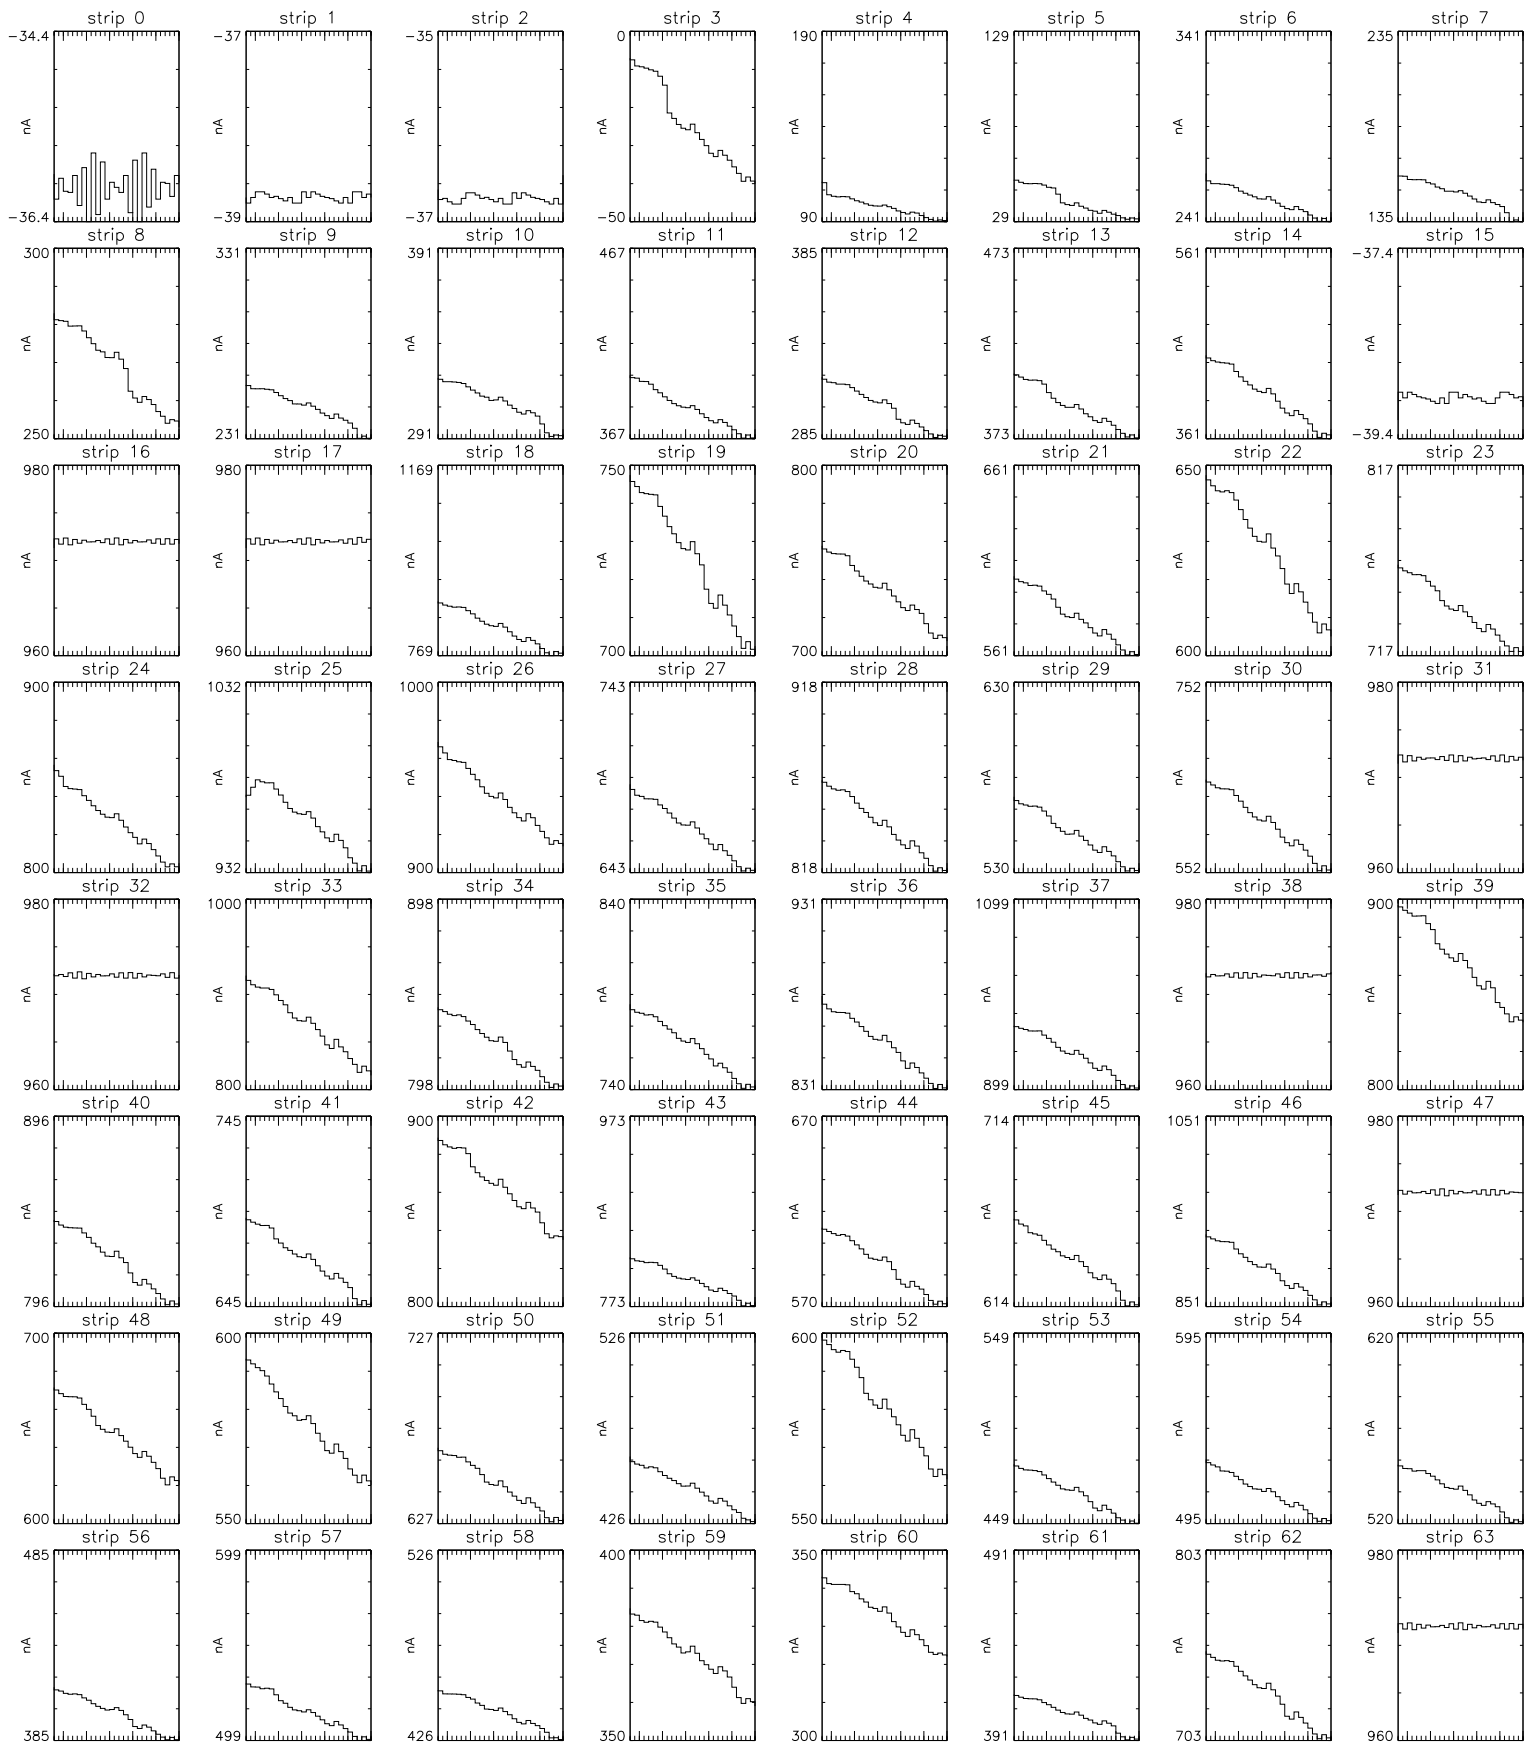


time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
Leakage Current – M2B – Ground Side  
(04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

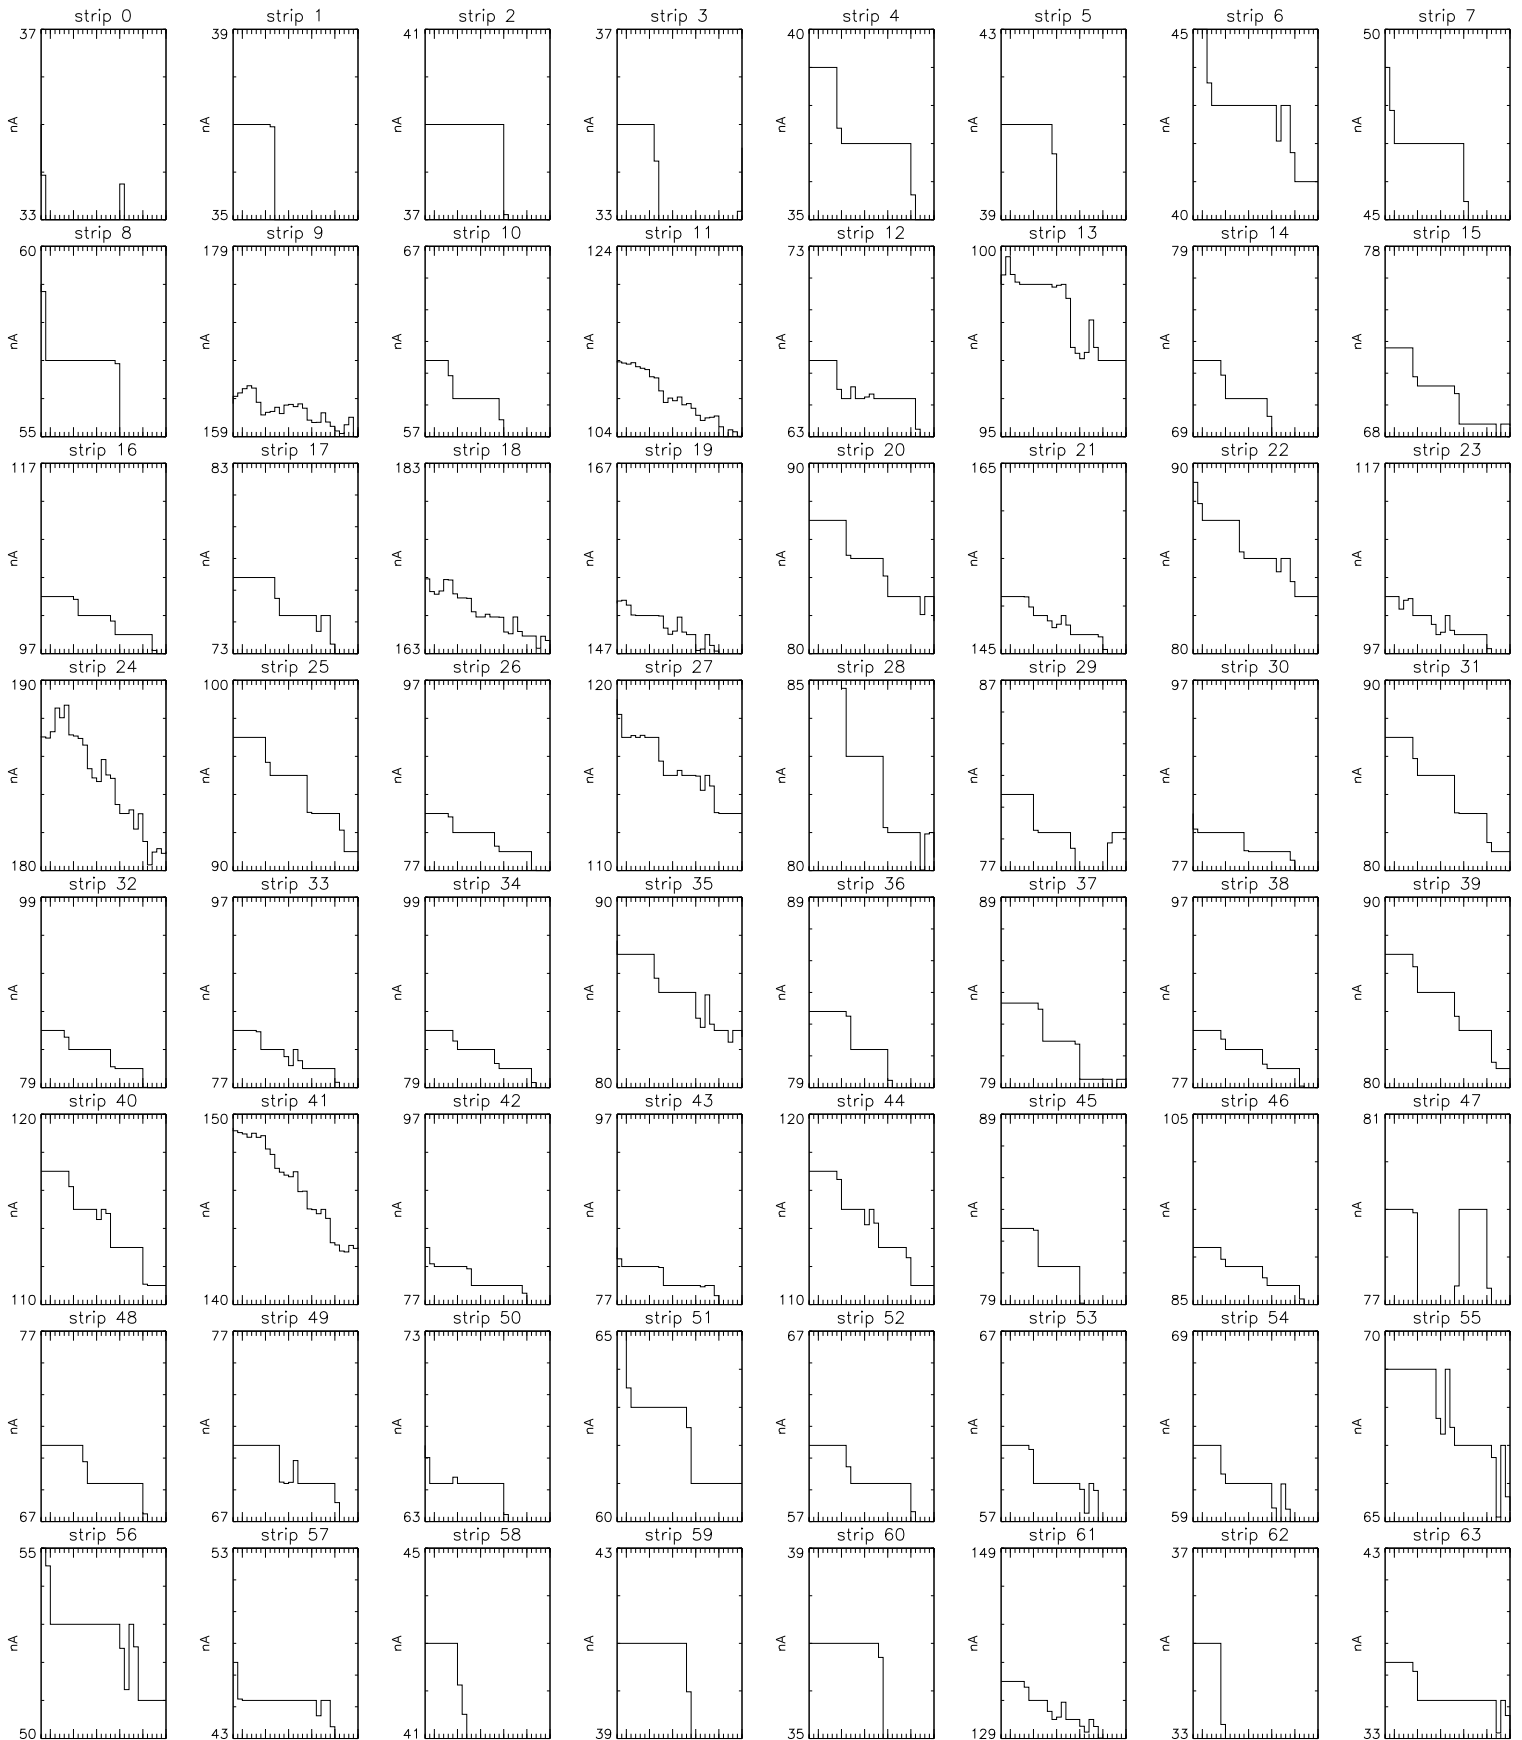

6 11 16 21 26 31  
time (04-Mar-2016 to 31-Mar-2016)

Bartels Rotation 2491 – Daily Averages  
 Leakage Current – M2B – High Voltage Side  
 (04-Mar-2016 thru 30-Mar-2016) (064/2016 thru 090/2016)

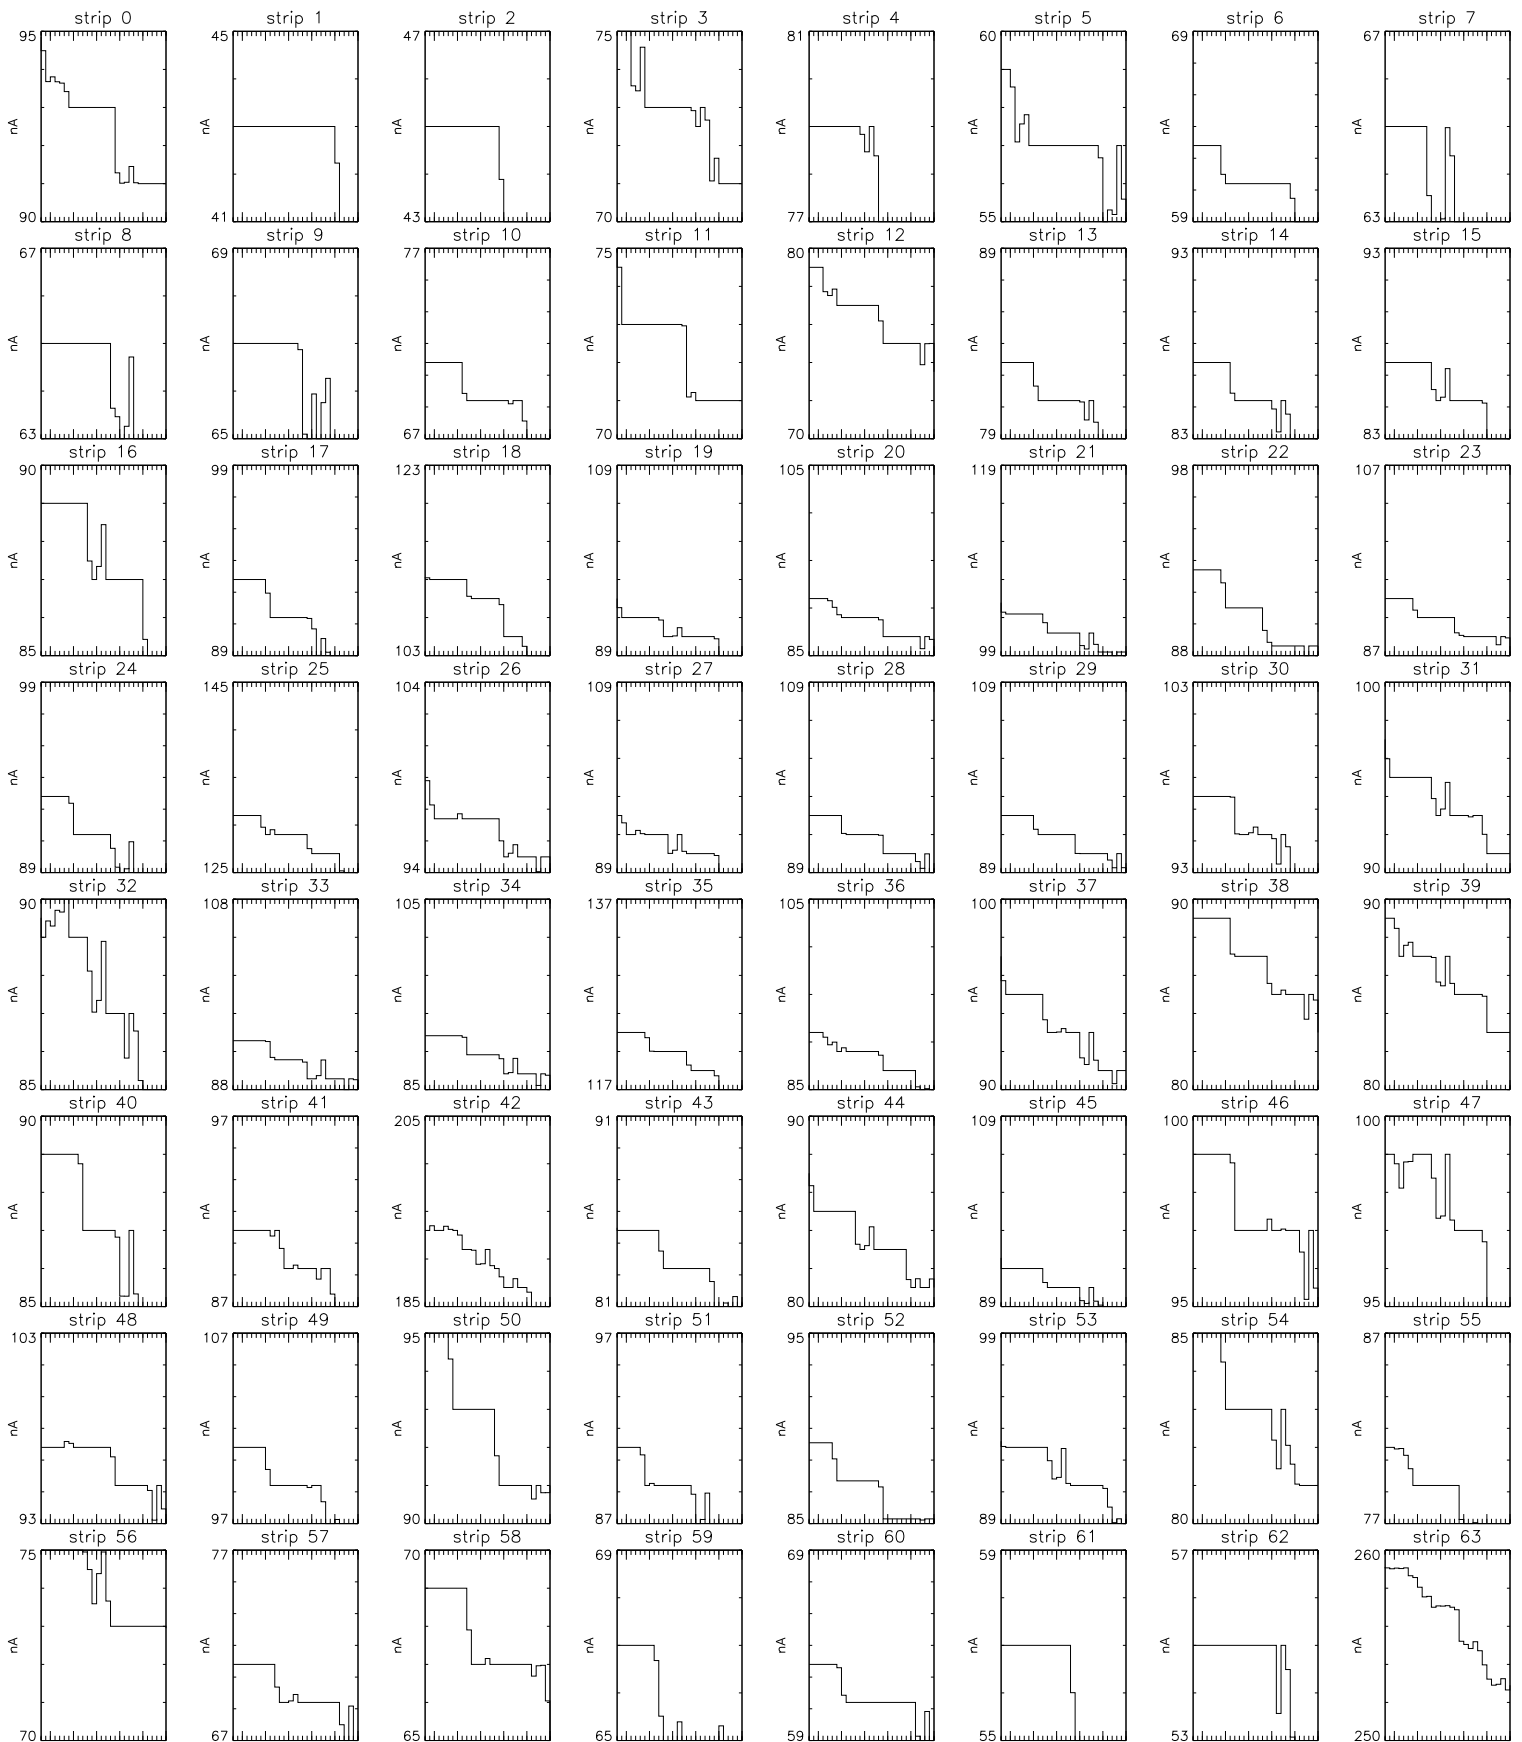

6 11 16 21 26 31  
 time (04-Mar-2016 to 31-Mar-2016)