



Bartels Rotation 2616 – Daily Averages
 Leakage Current – M1A – Ground Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

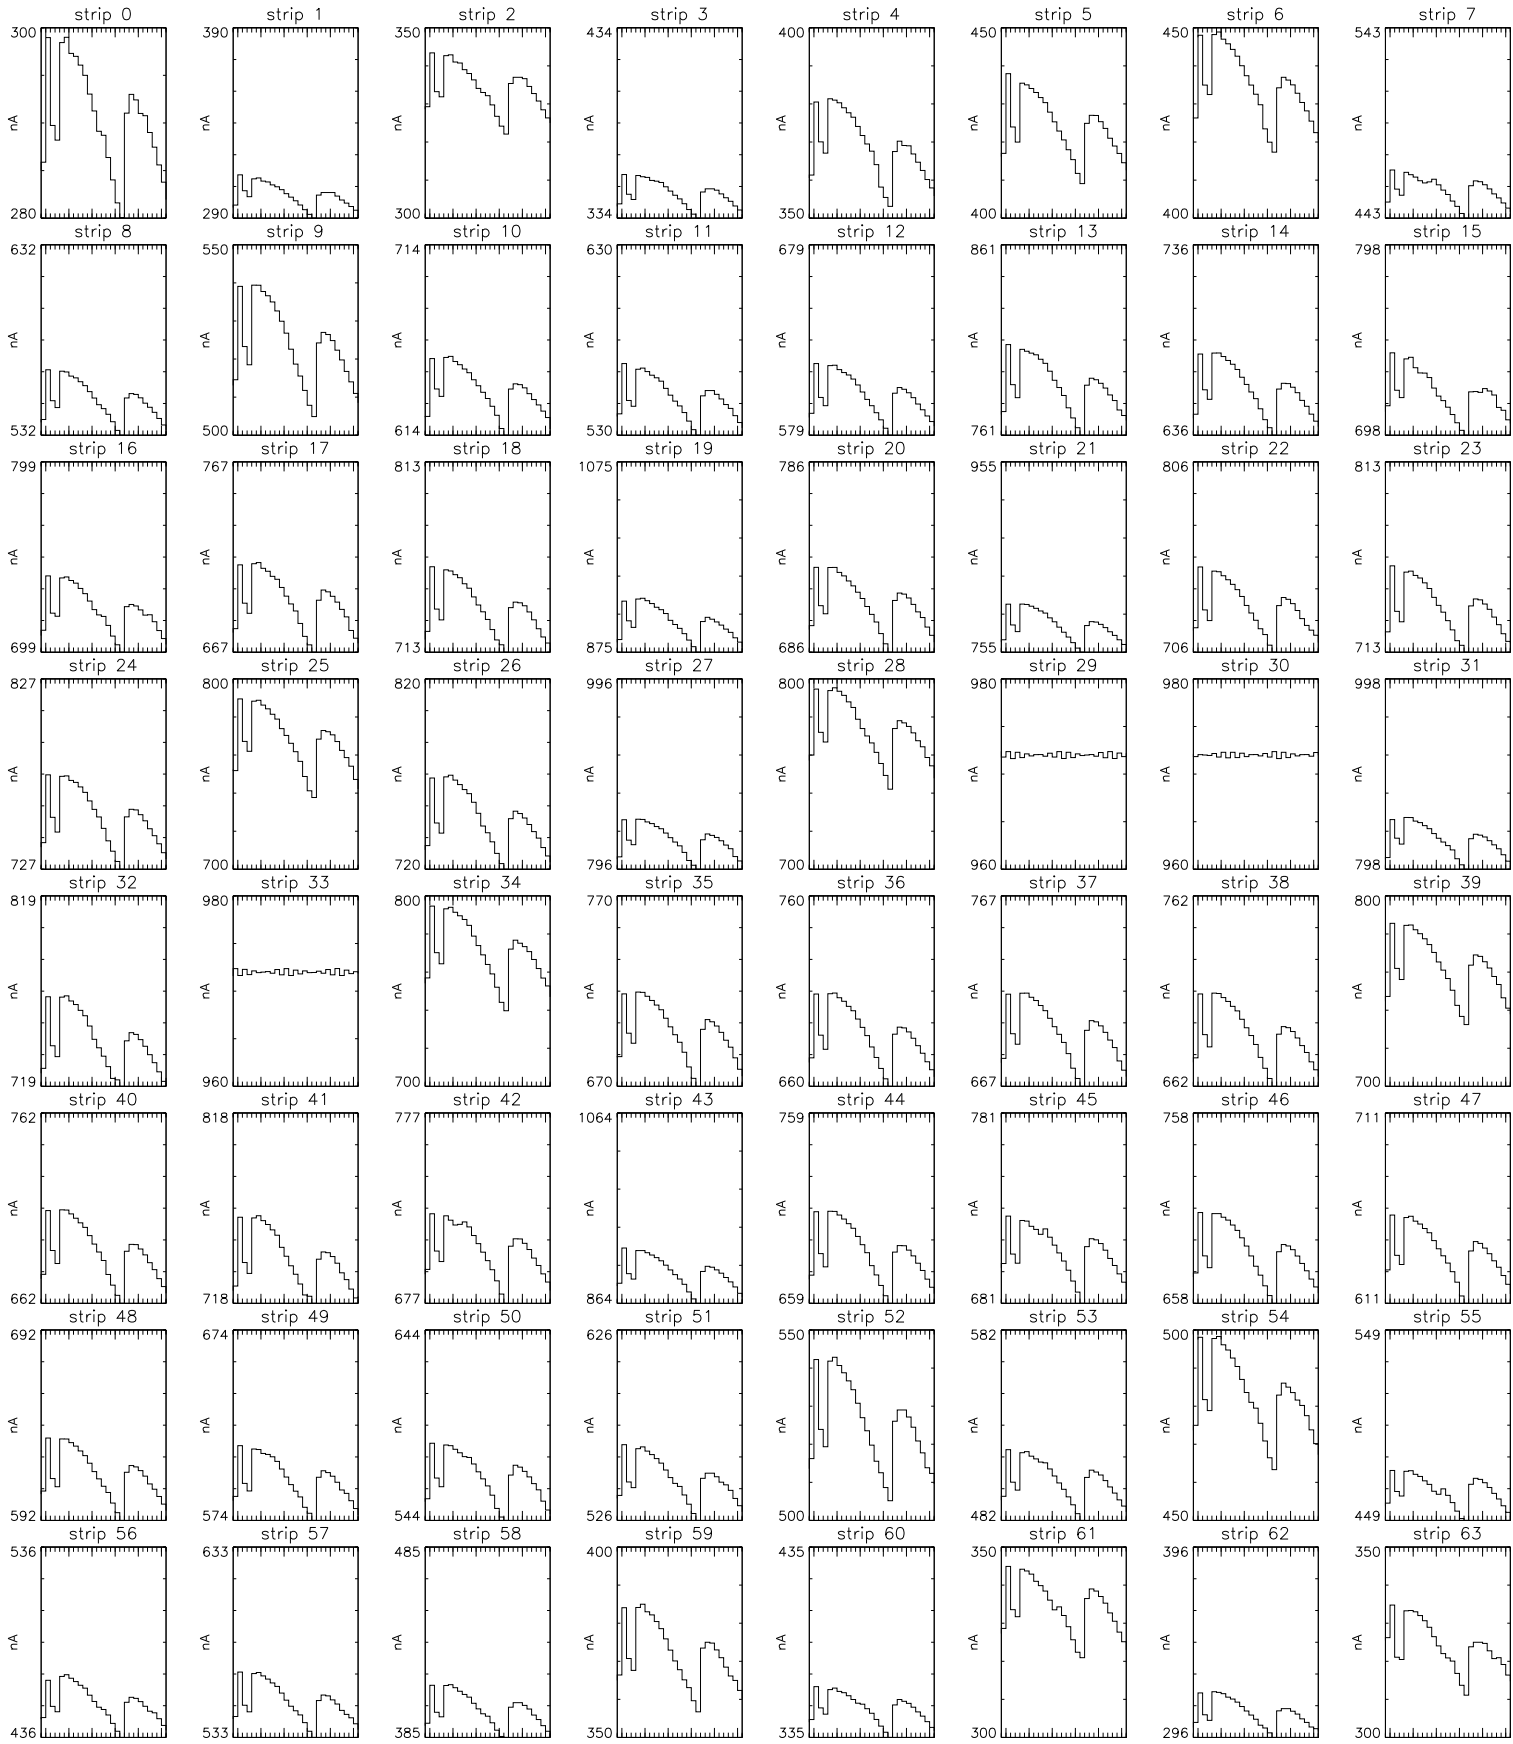


Jun 1 6 11 16 21 26
 time (31-May-2025 to 27-Jun-2025)


Bartels Rotation 2616 – Daily Averages
Leakage Current – M1A – High Voltage Side
(31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

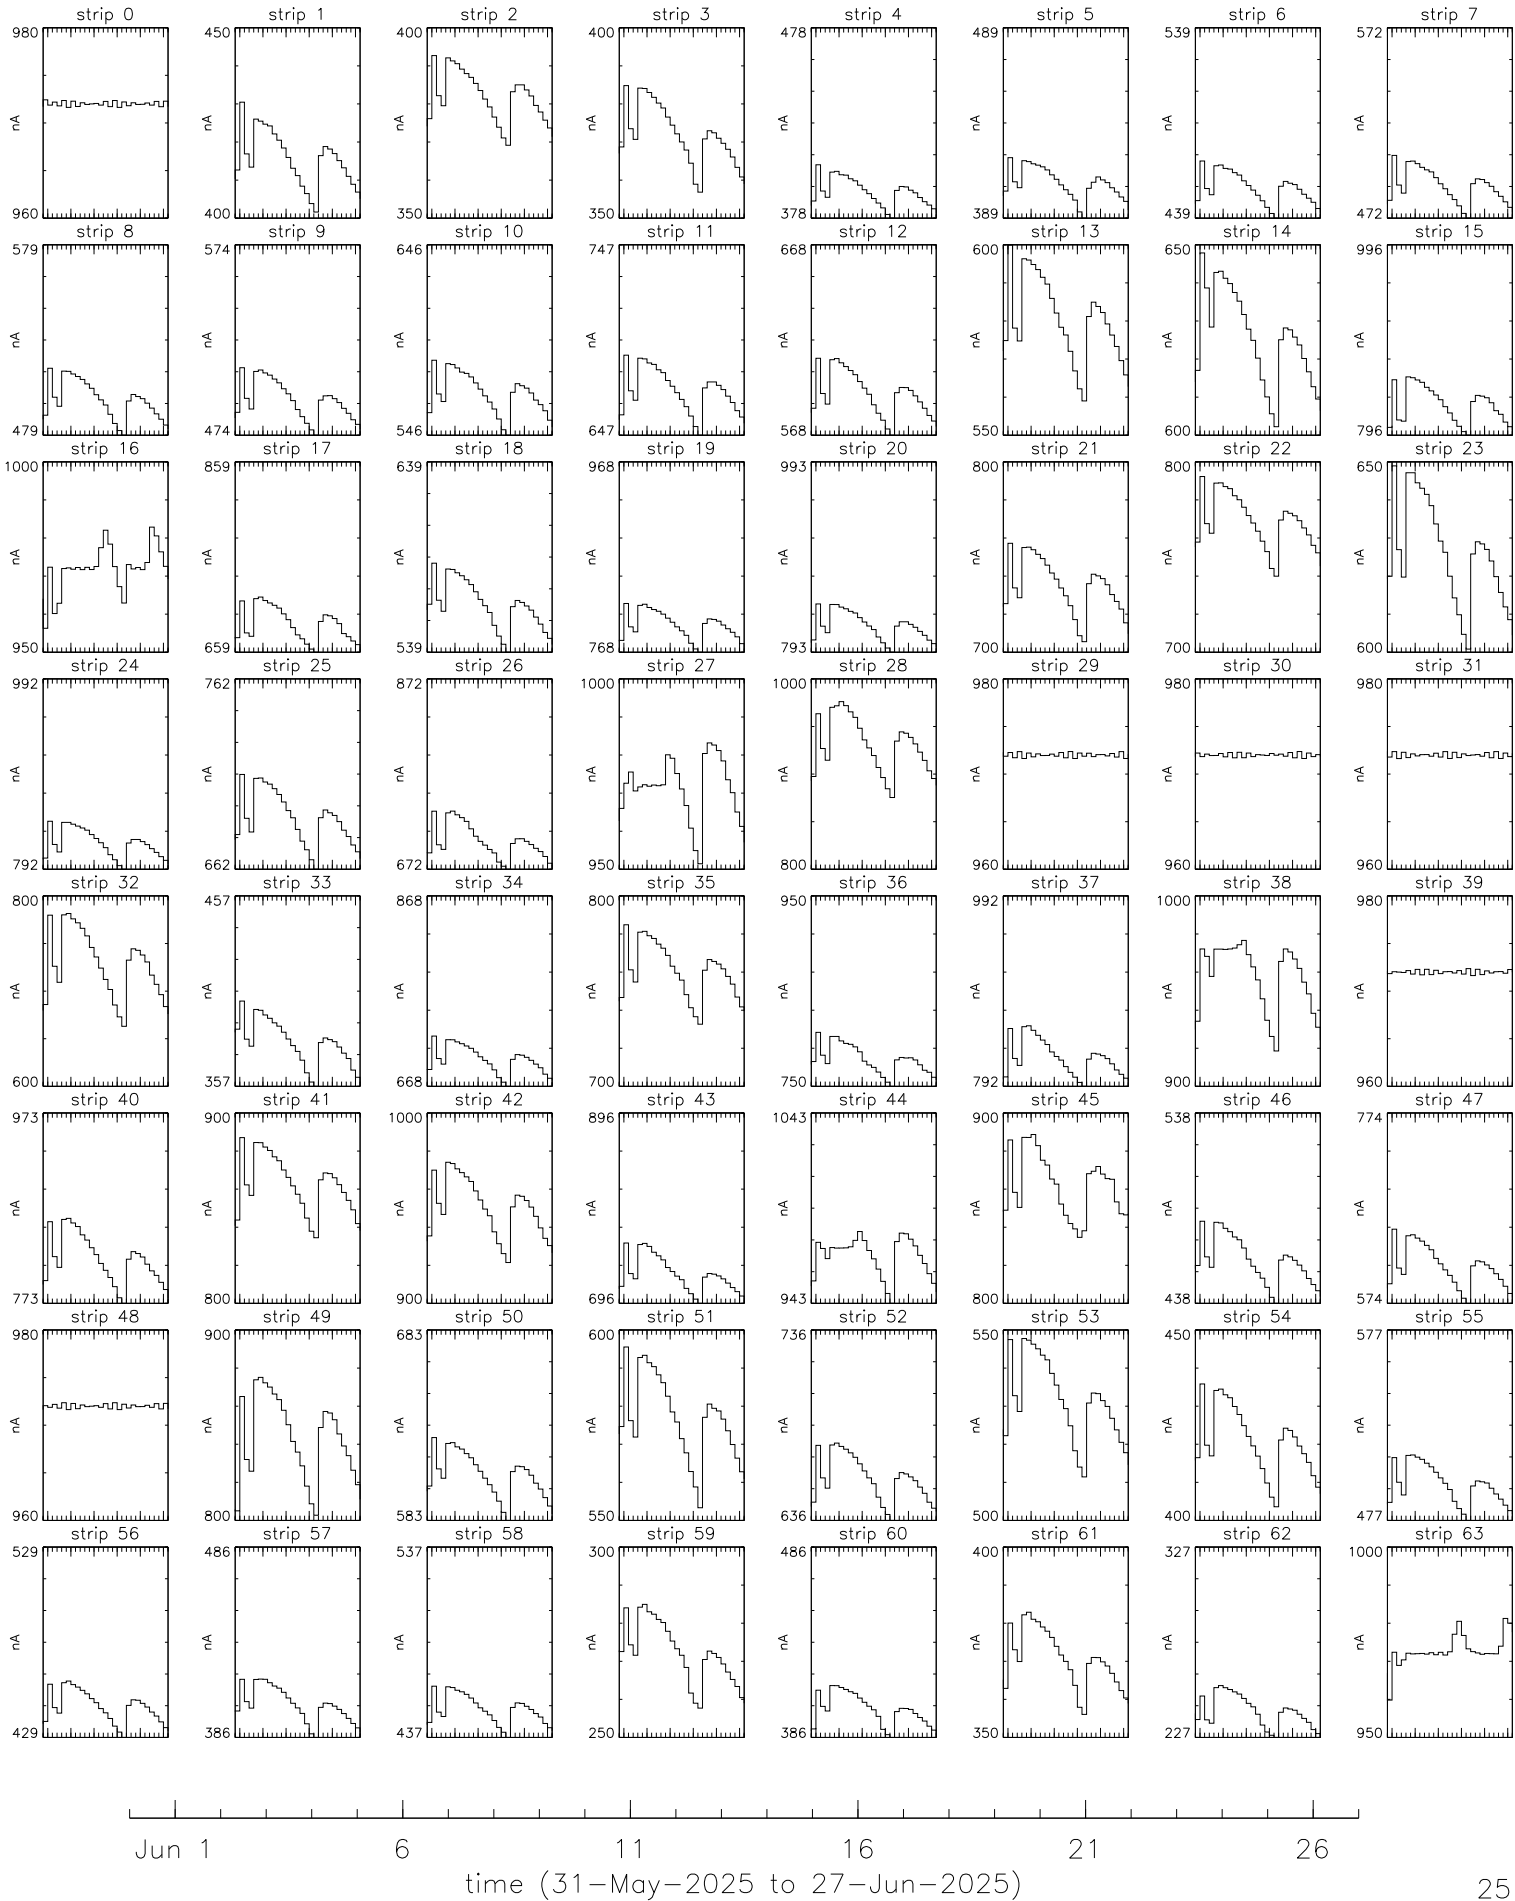


Bartels Rotation 2616 – Daily Averages
 Leakage Current – M2A – Ground Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

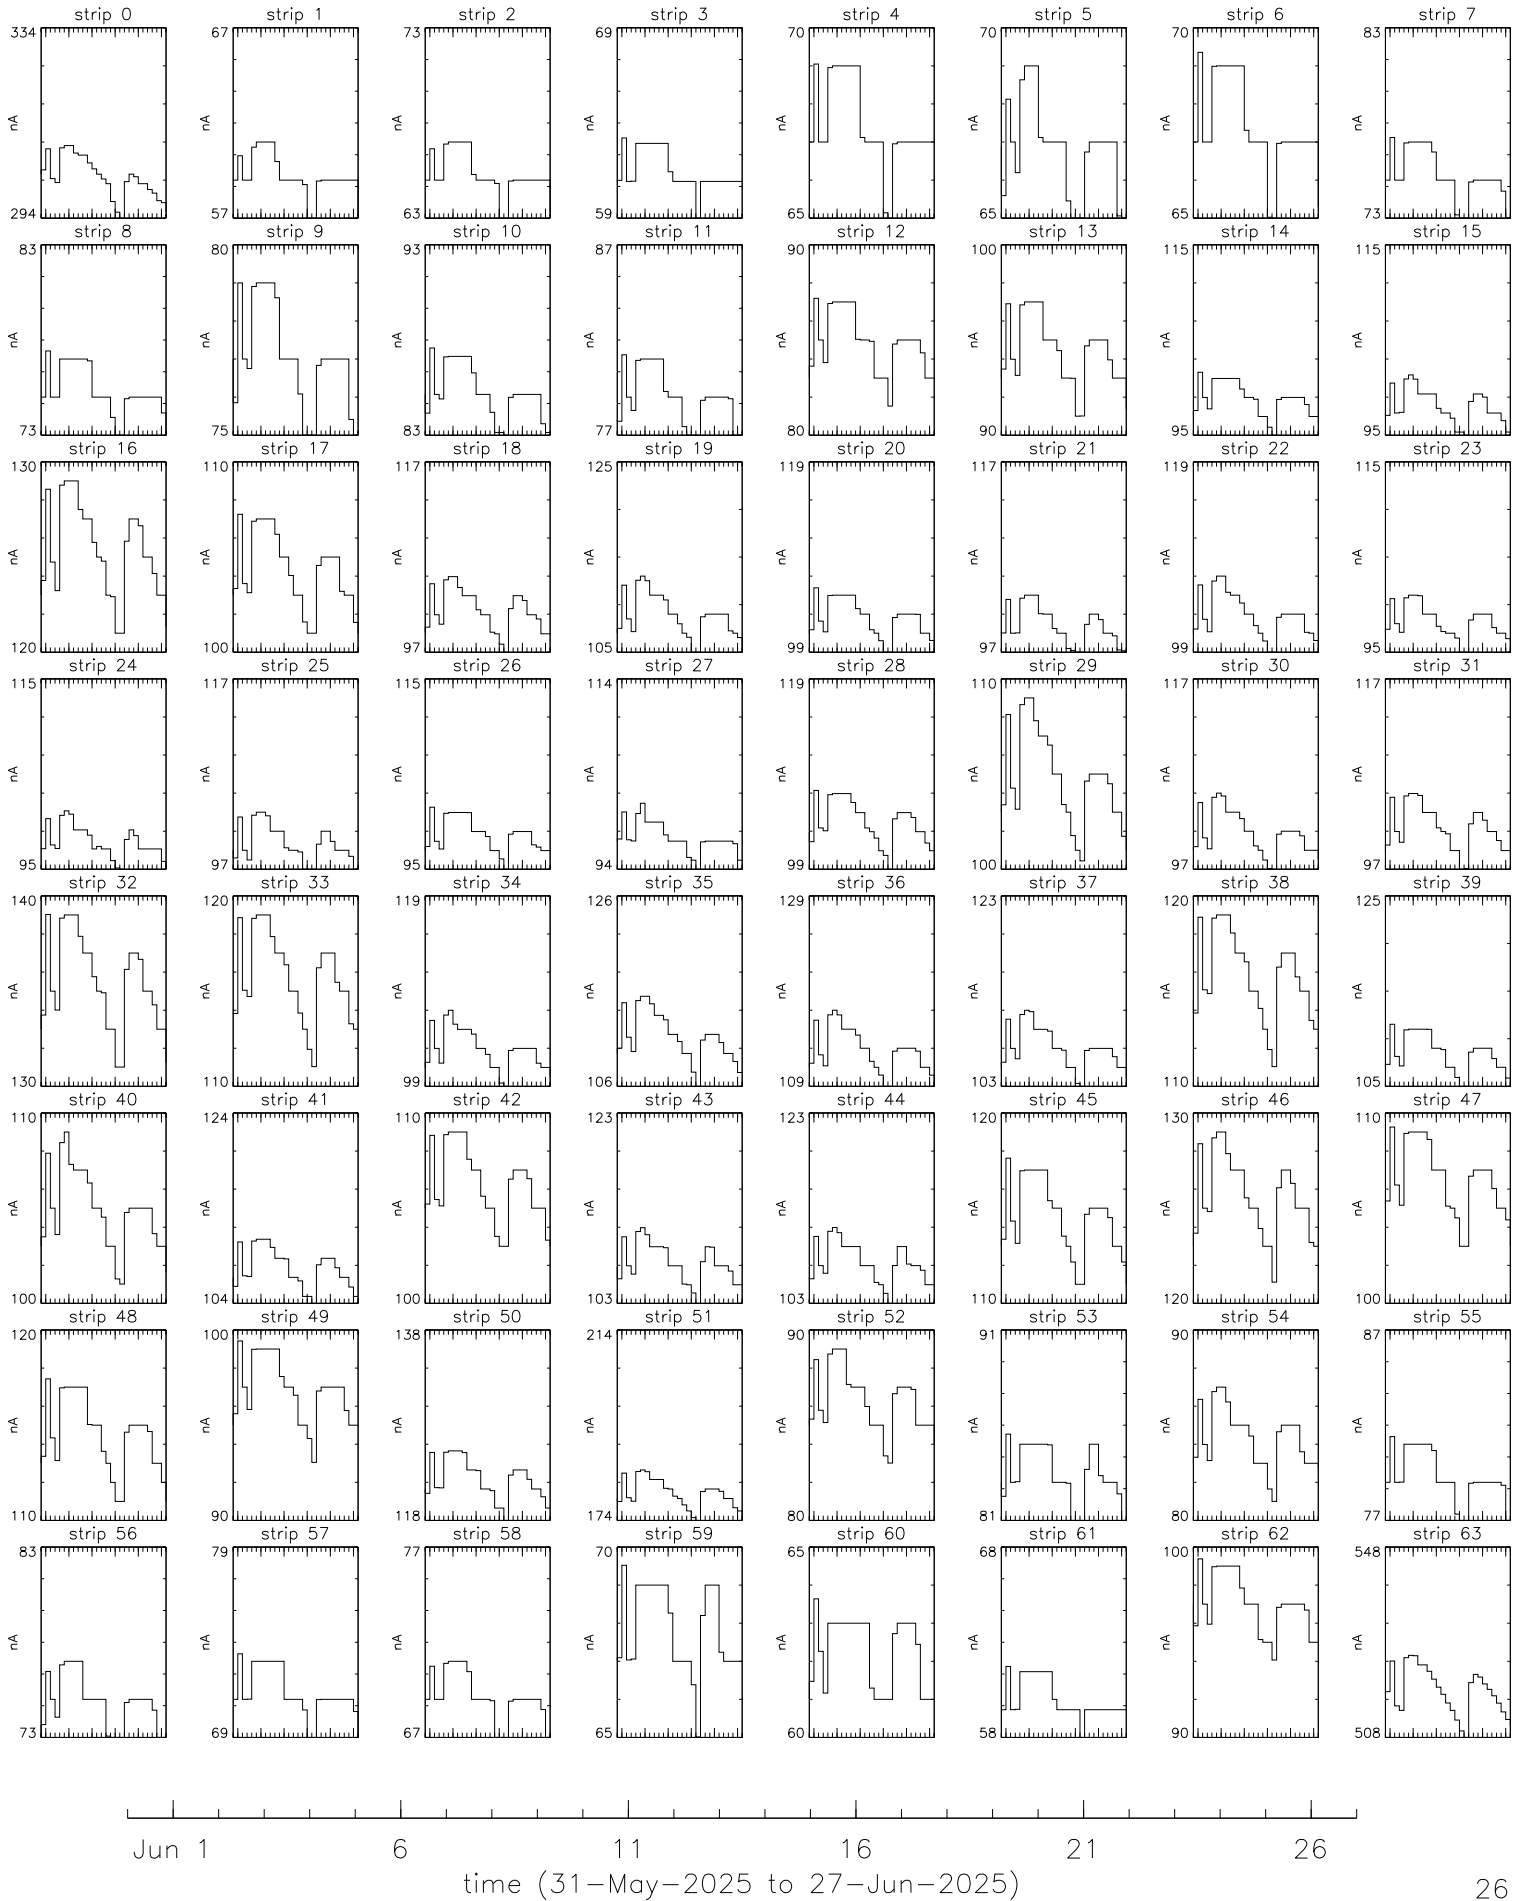


Bartels Rotation 2616 – Daily Averages
 Leakage Current – M2A – High Voltage Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

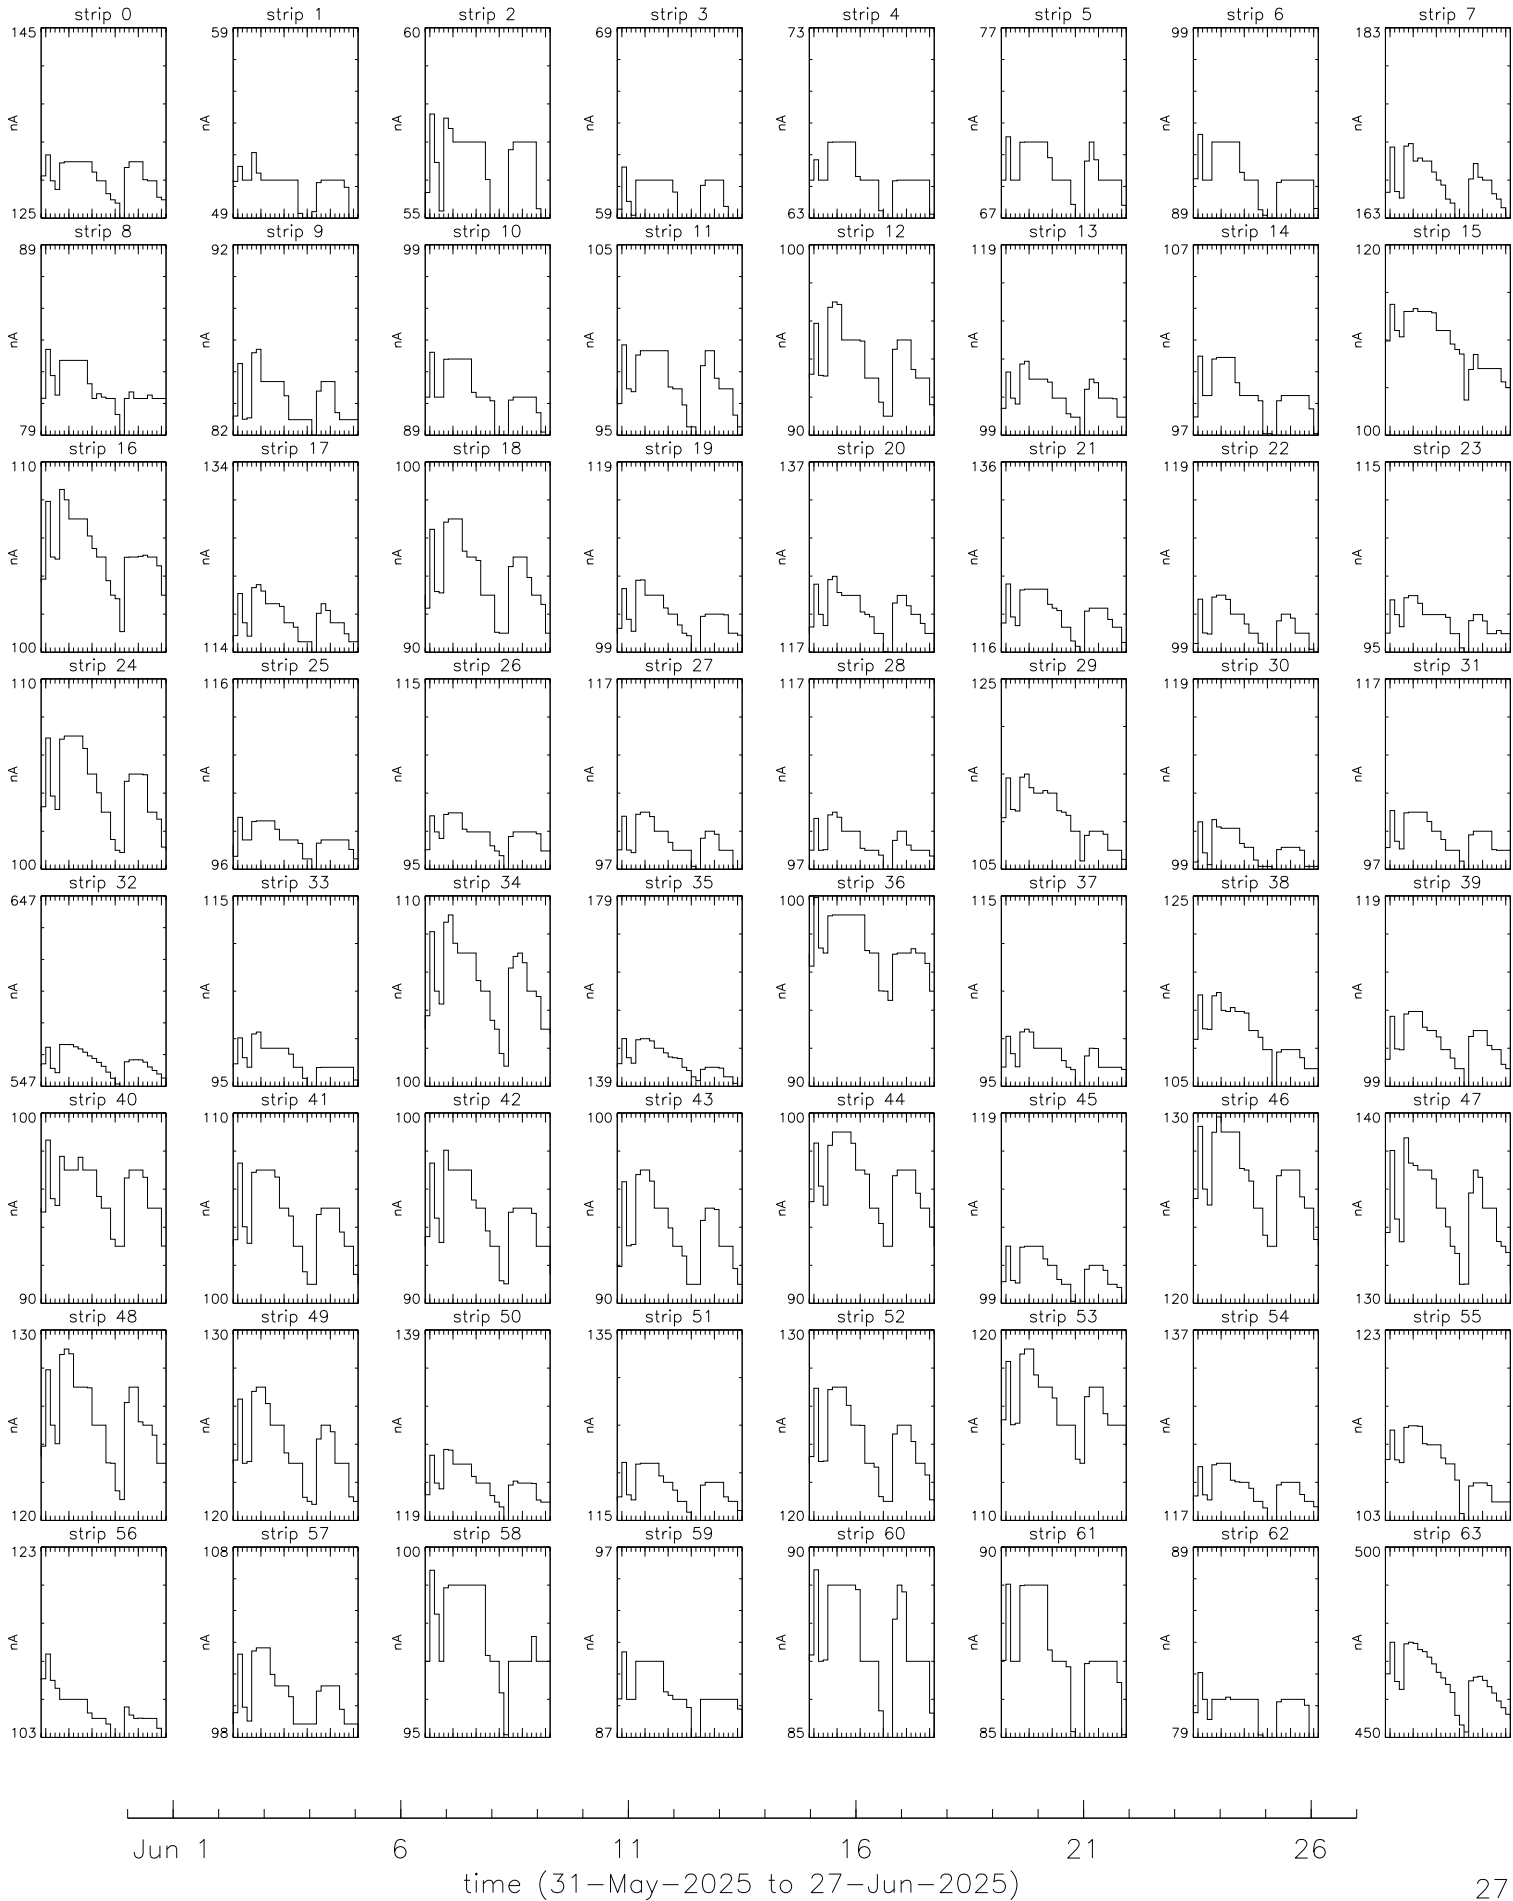


Bartels Rotation 2616 – Daily Averages
 Leakage Current – M1B – Ground Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

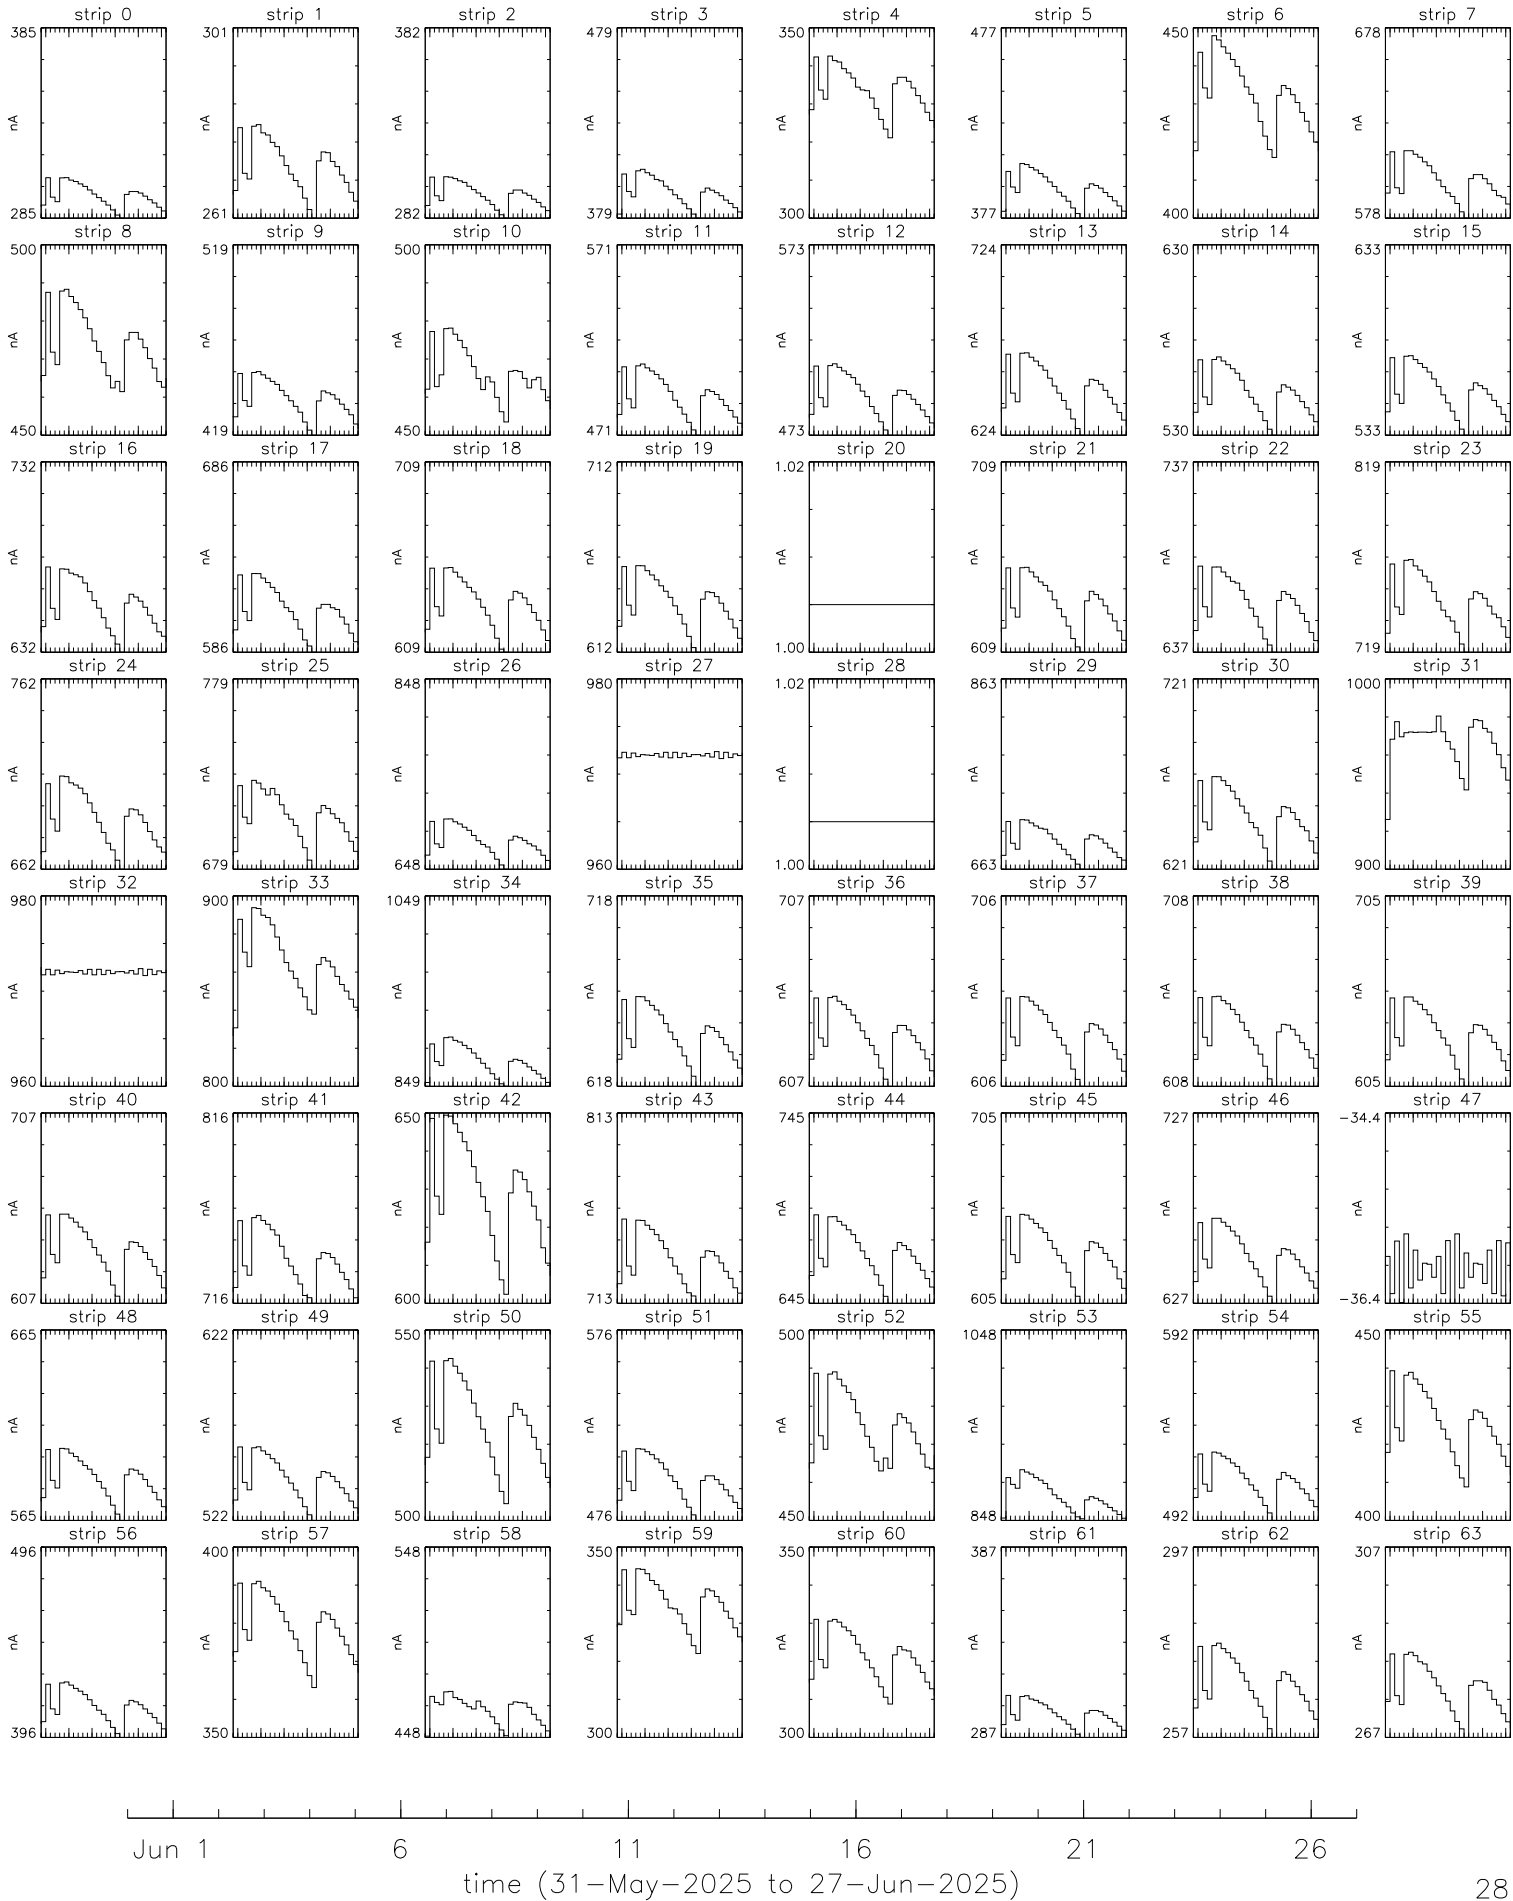

Bartels Rotation 2616 – Daily Averages
 Leakage Current – M1B – High Voltage Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

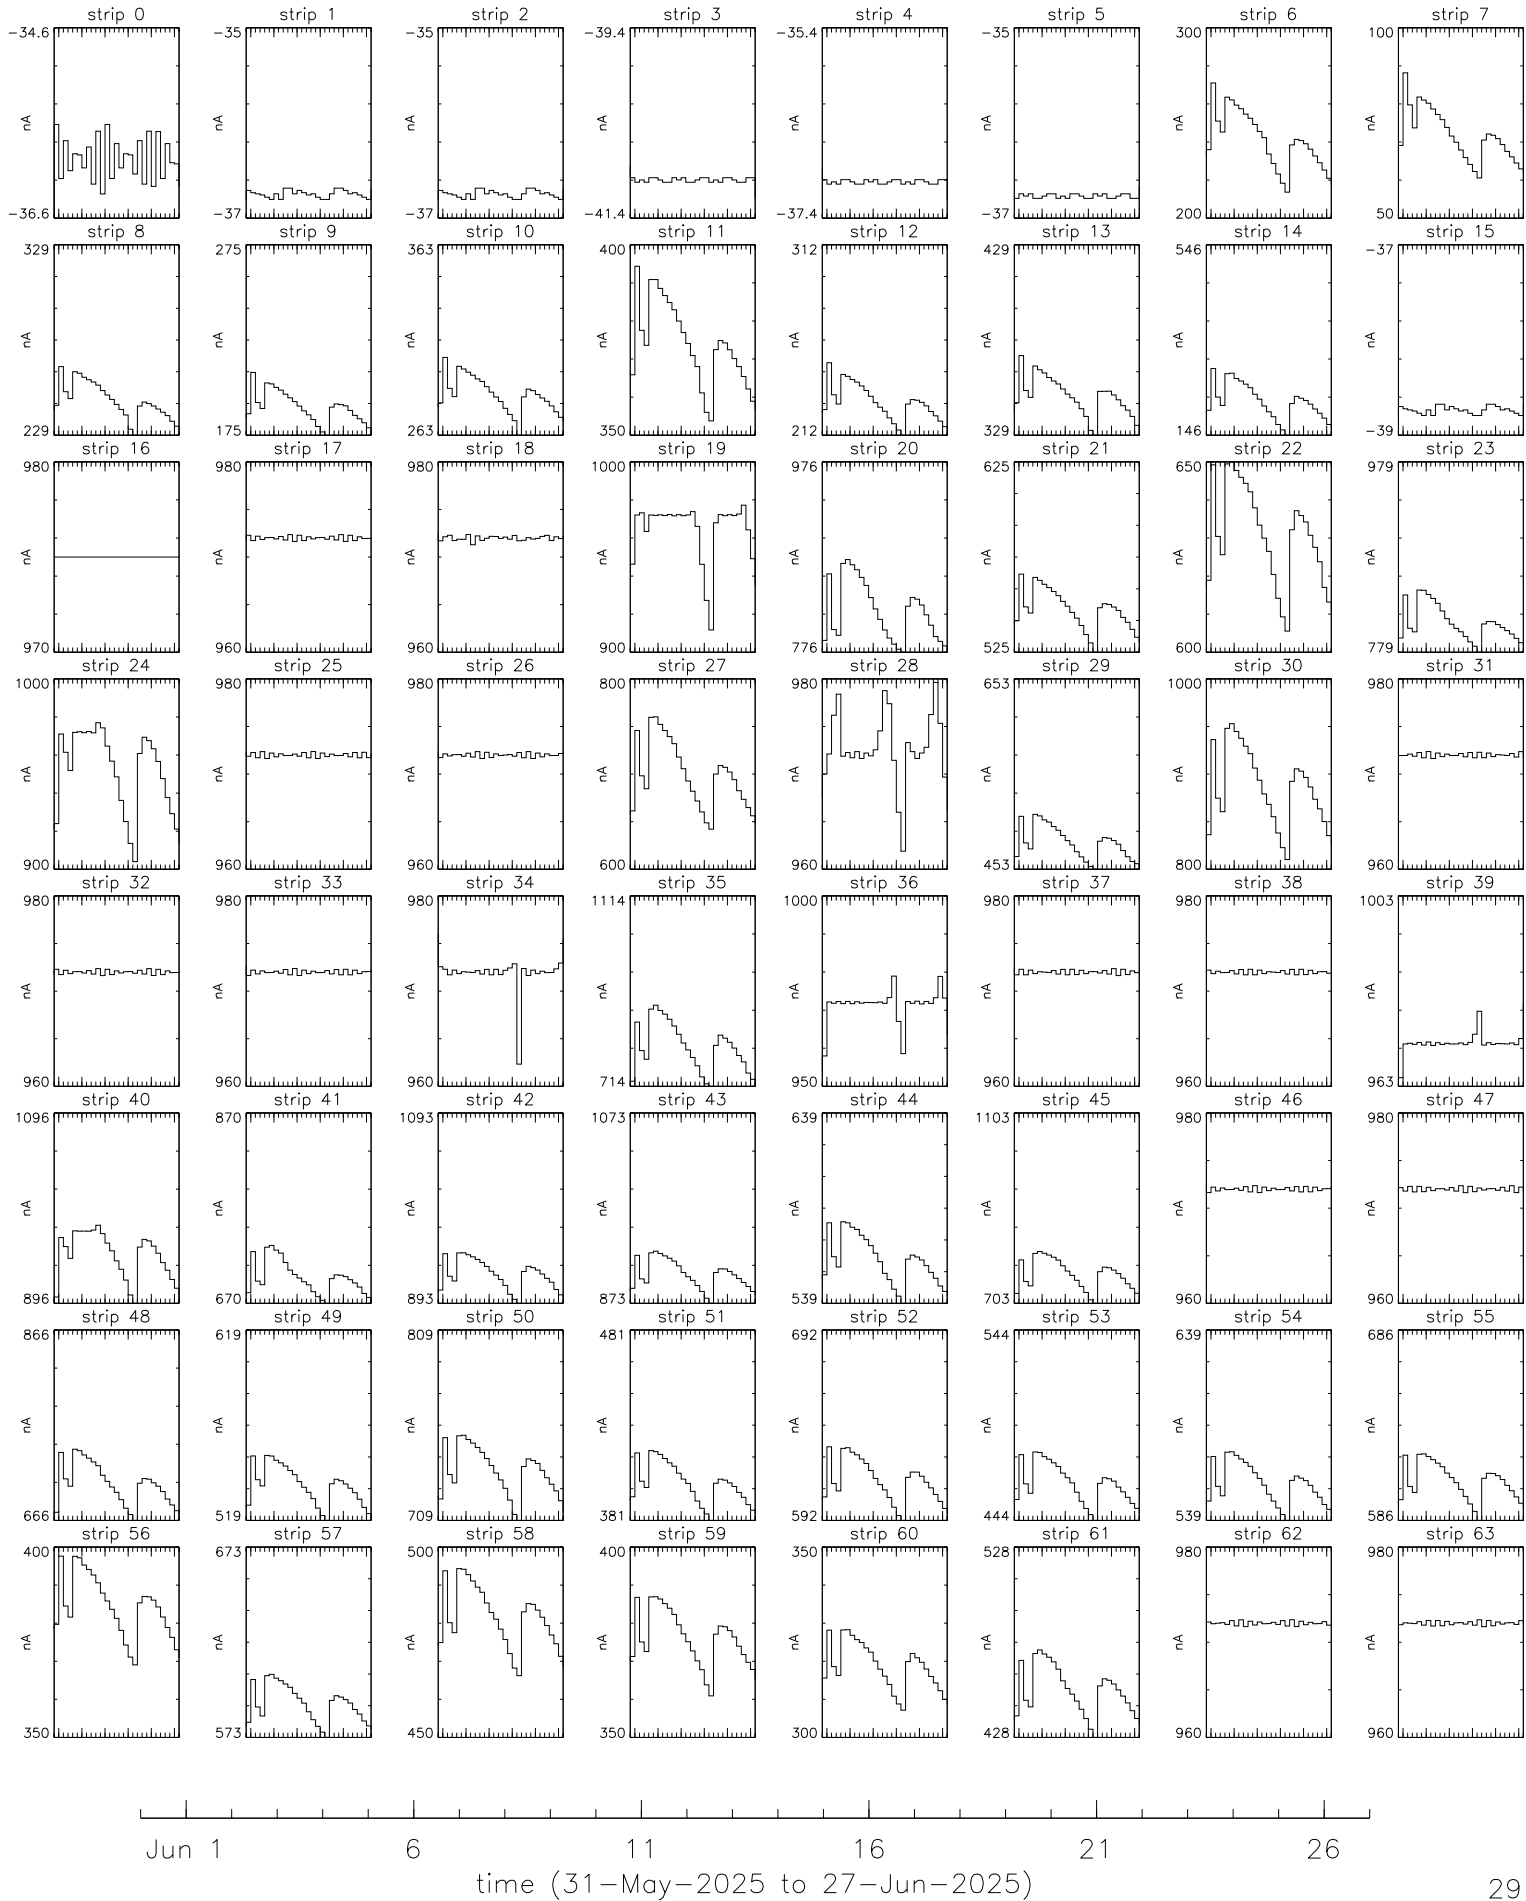

Bartels Rotation 2616 – Daily Averages
 Leakage Current – M2B – Ground Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

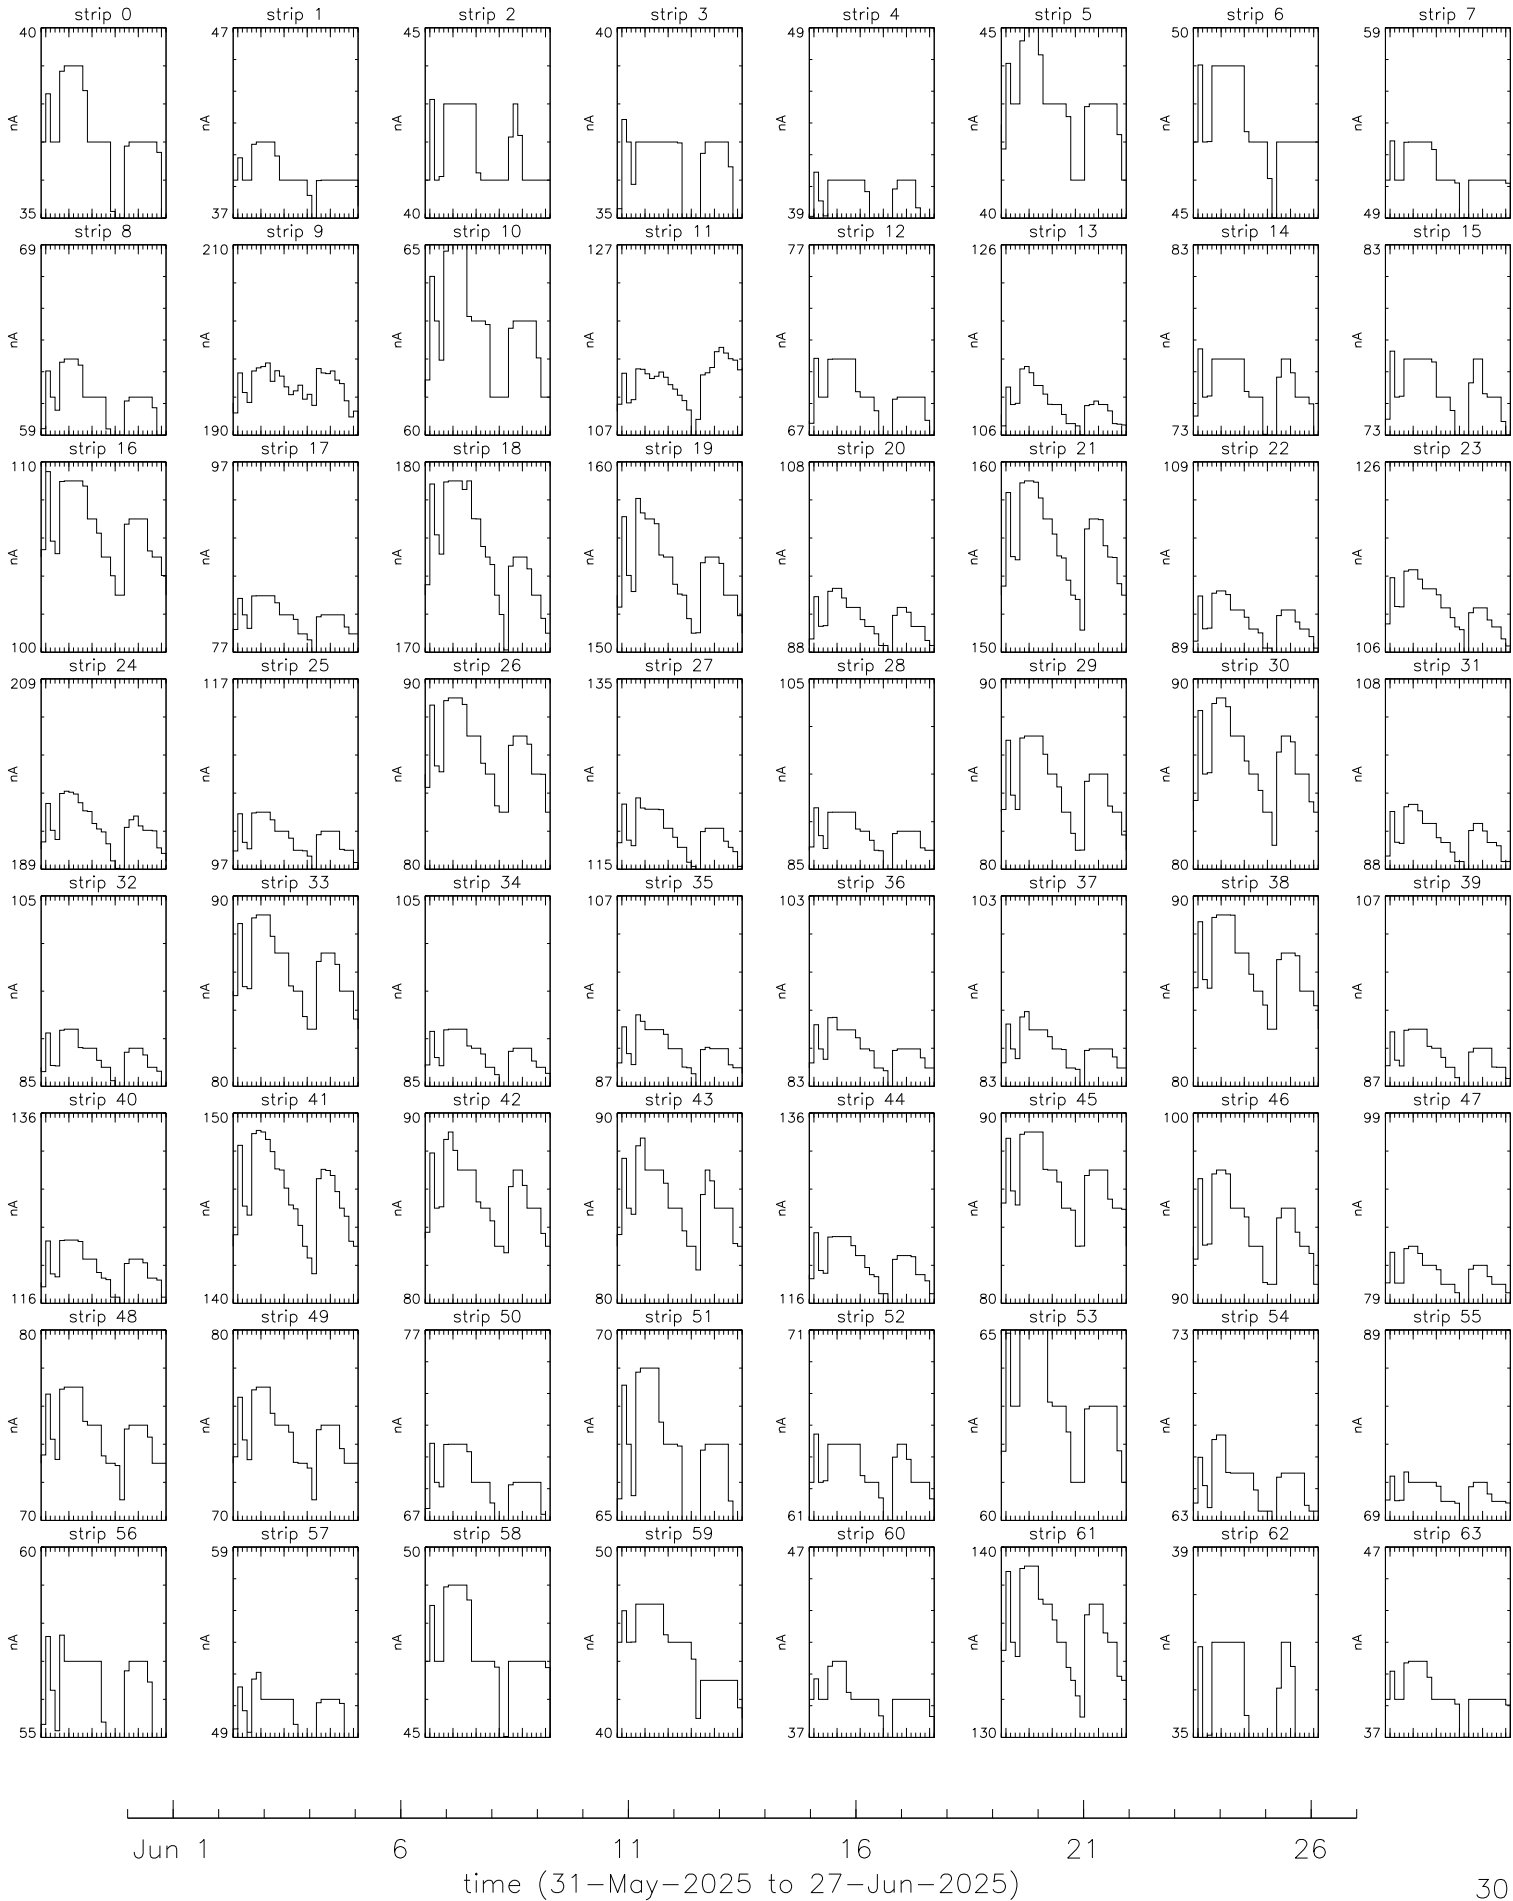

Bartels Rotation 2616 – Daily Averages
 Leakage Current – M2B – High Voltage Side
 (31-May-2025 thru 26-Jun-2025) (151/2025 thru 177/2025)

