




Bartels Rotation 2629 – Daily Averages
 Leakage Current – M1A – Ground Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

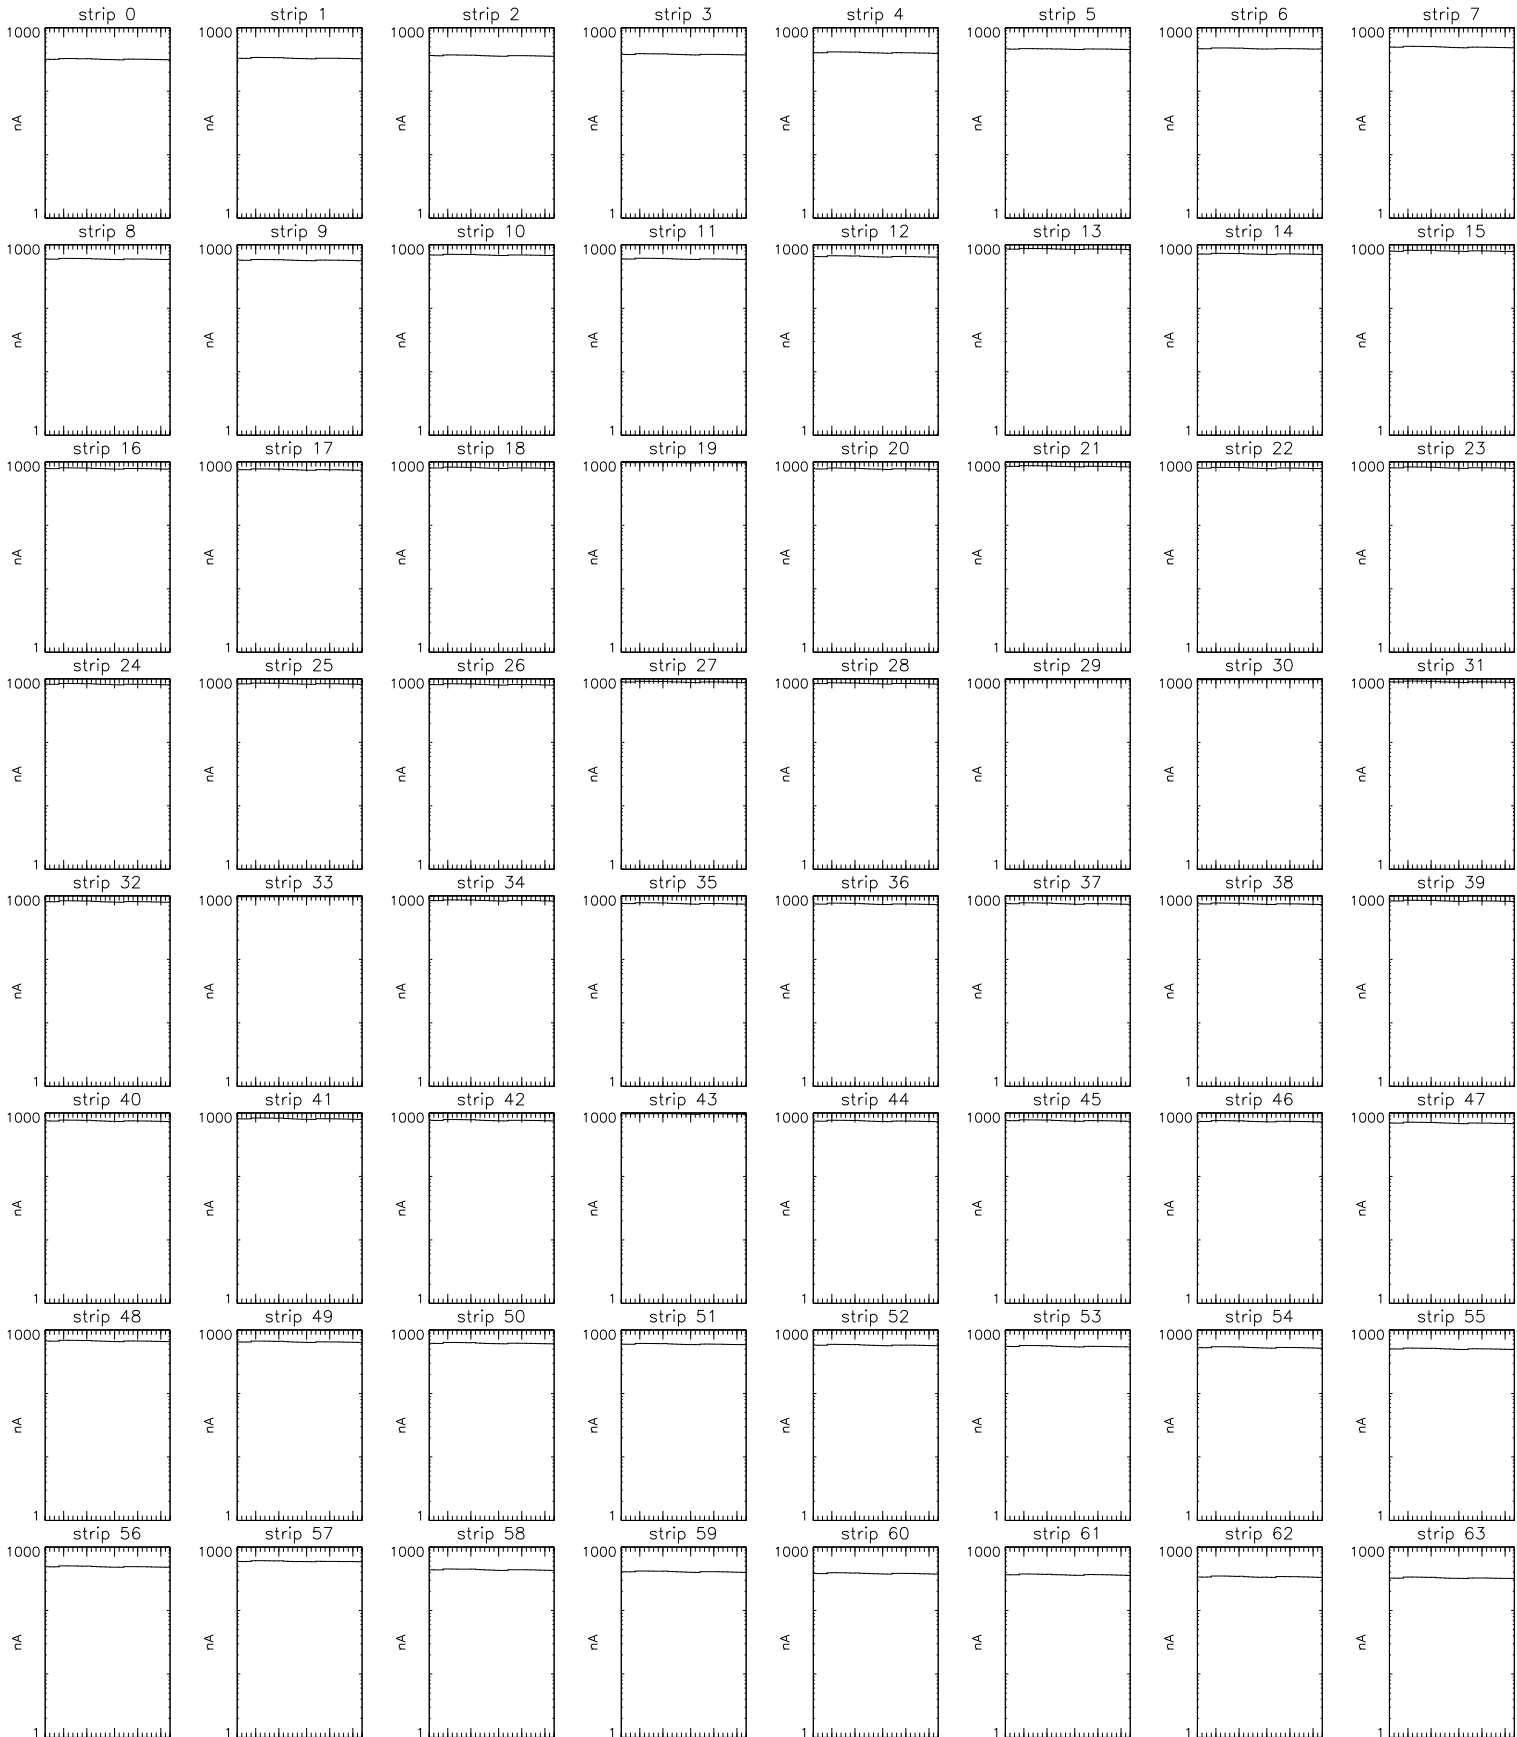


Bartels Rotation 2629 – Daily Averages
 Leakage Current – M1A – High Voltage Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

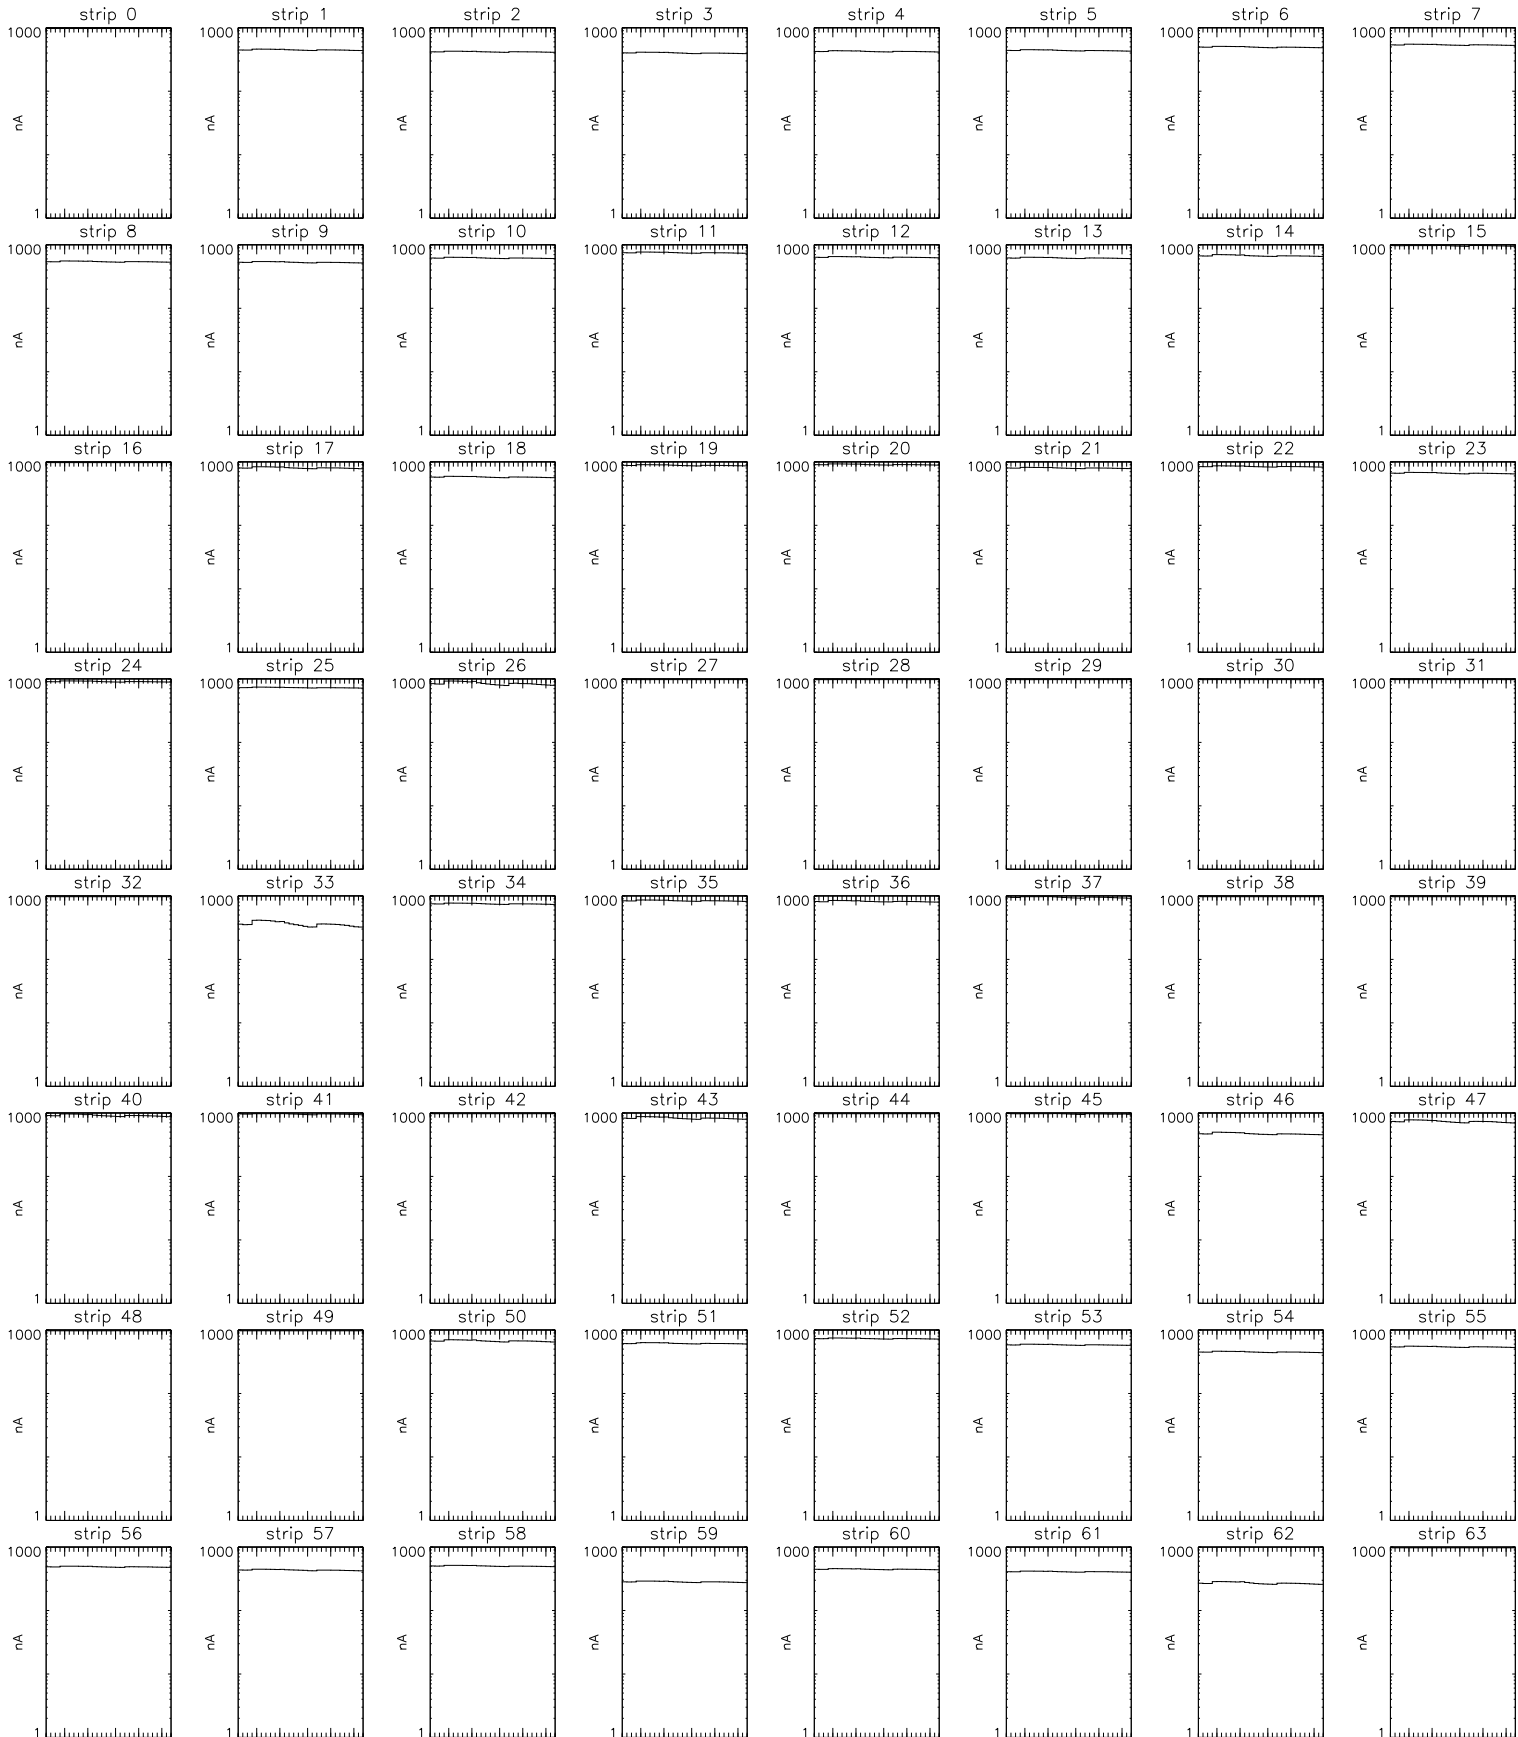


Bartels Rotation 2629 – Daily Averages
 Leakage Current – M2A – Ground Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

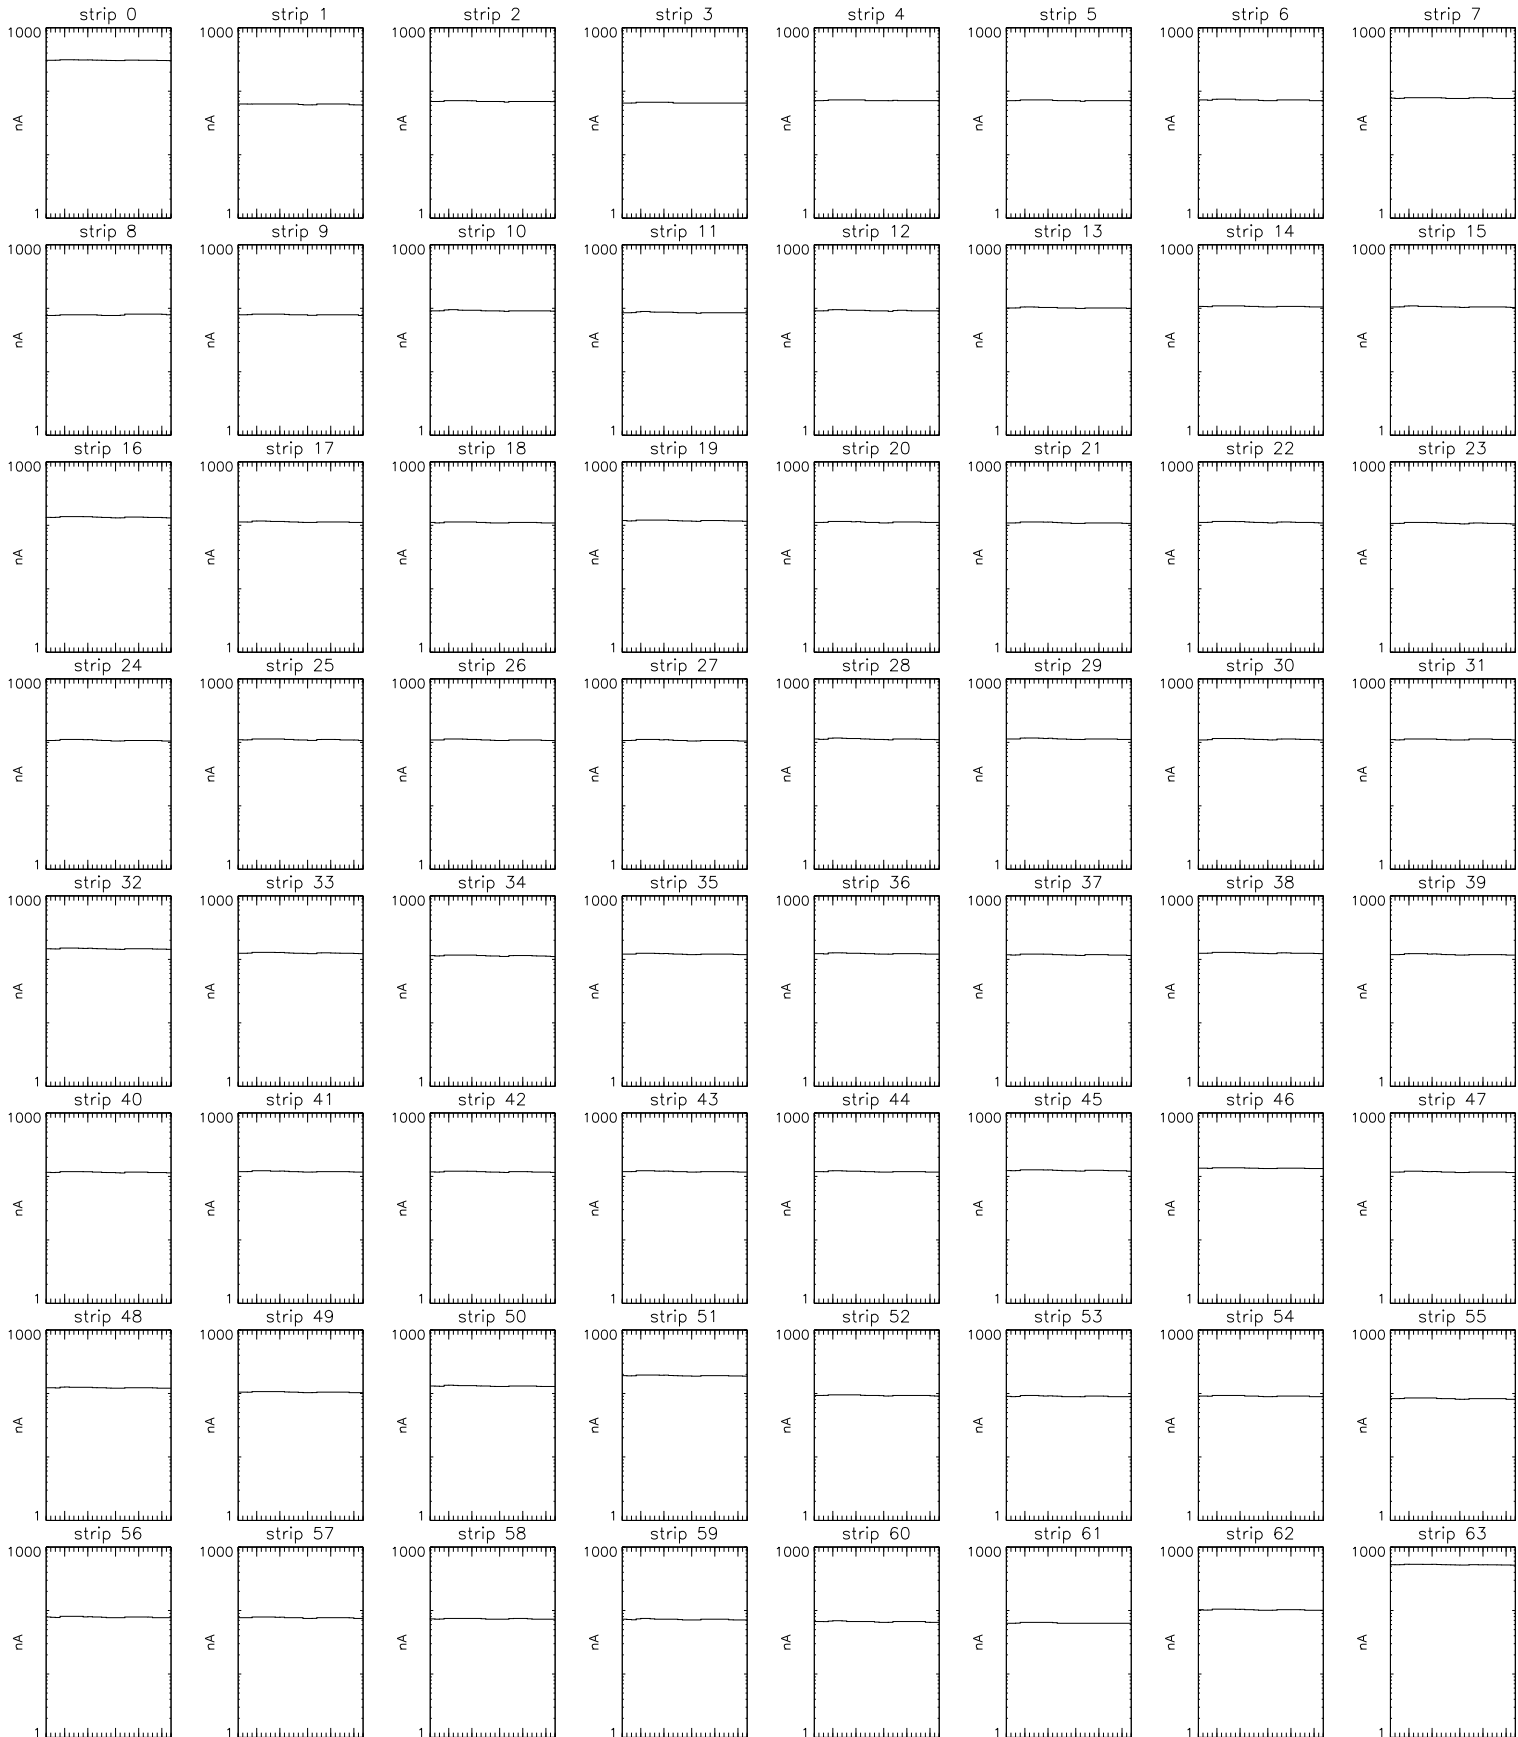


Bartels Rotation 2629 – Daily Averages
 Leakage Current – M2A – High Voltage Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

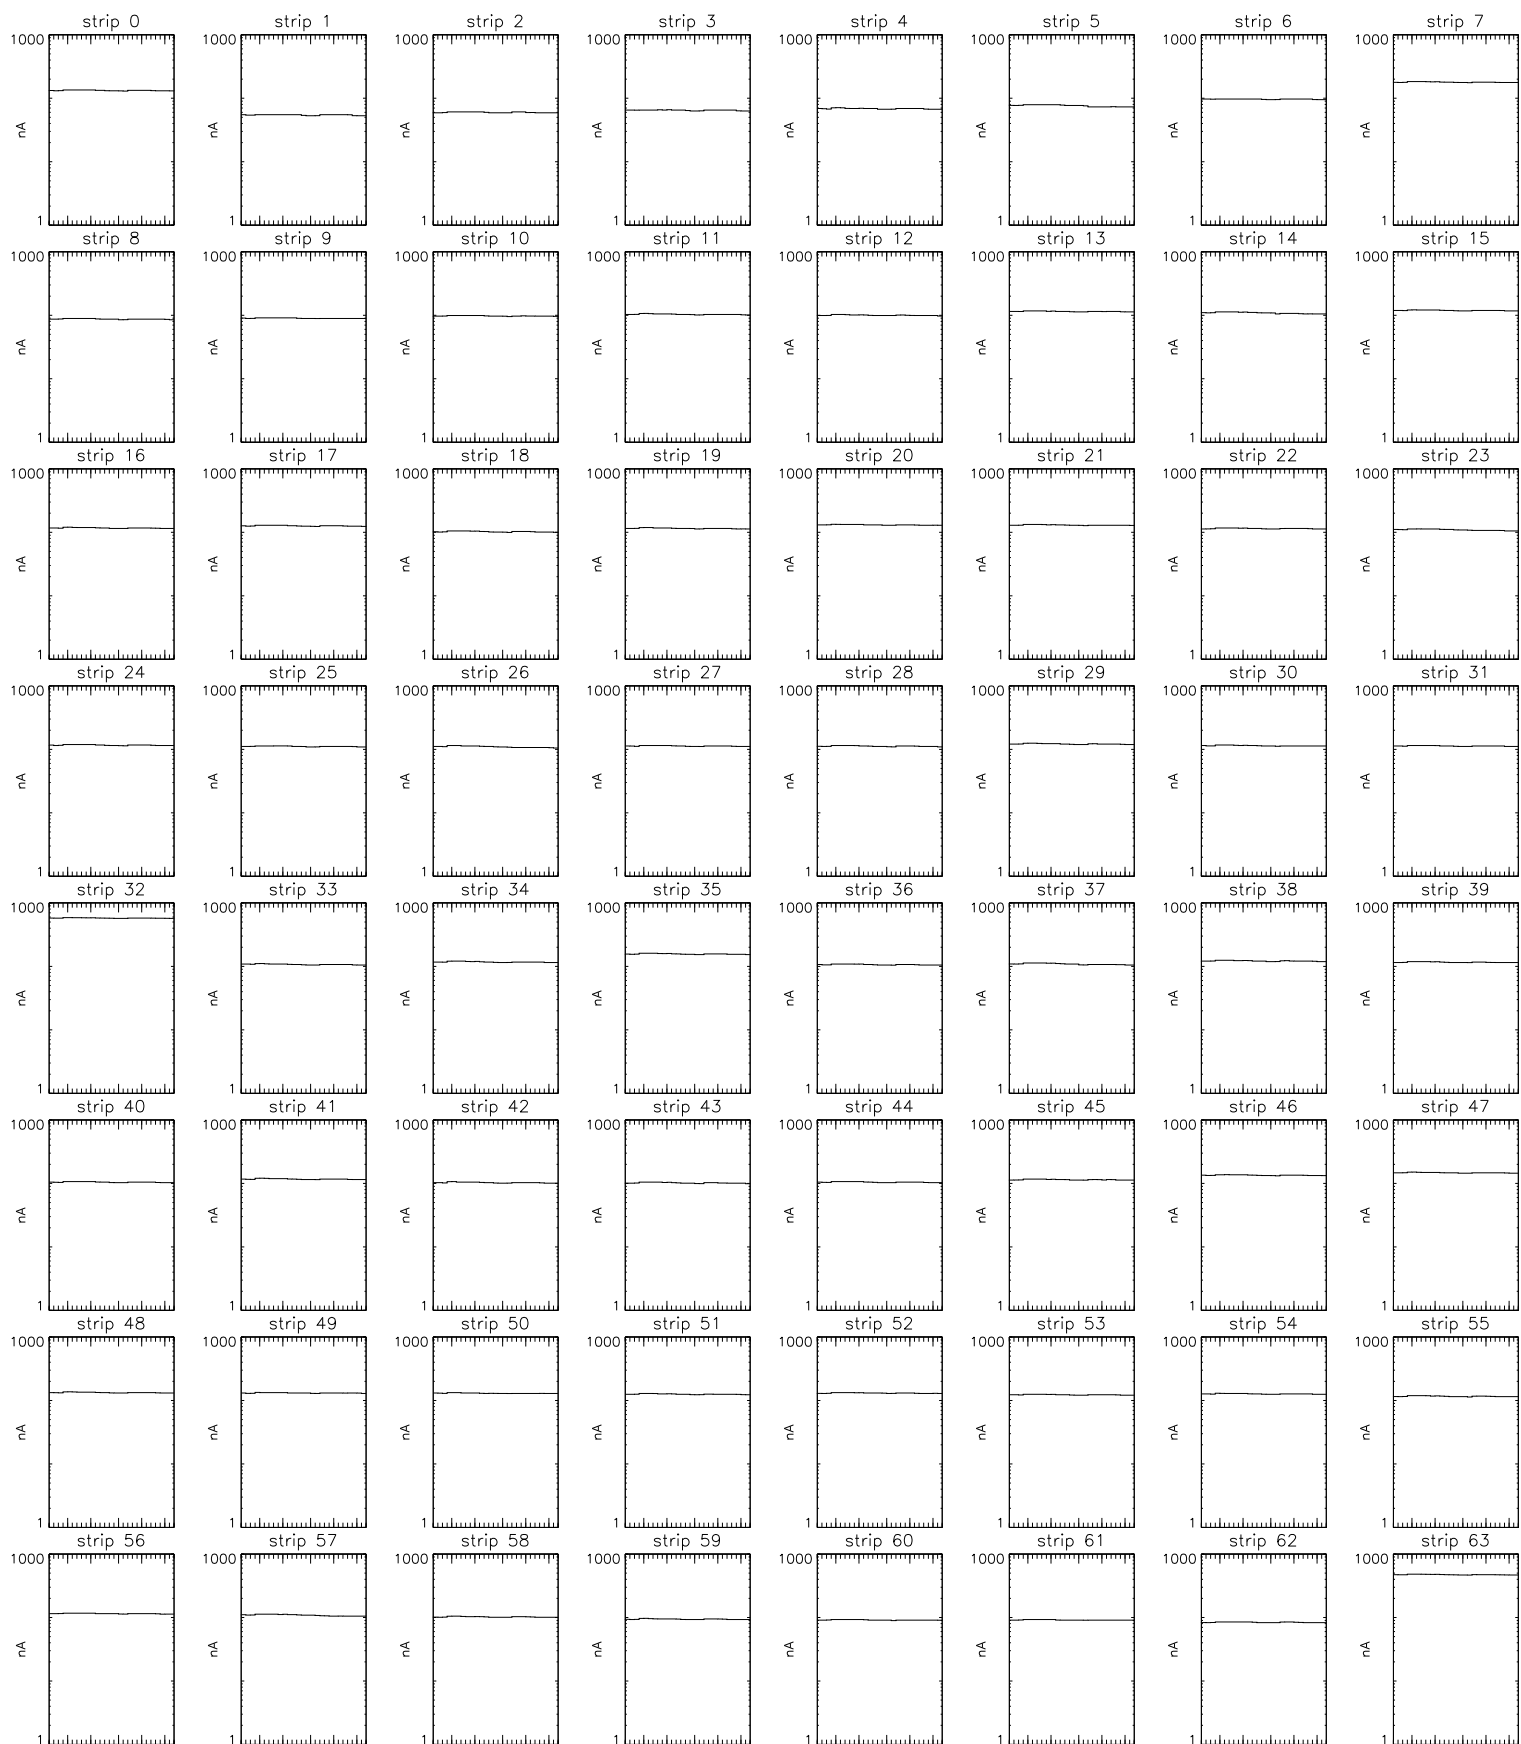

Bartels Rotation 2629 – Daily Averages
 Leakage Current – M1B – Ground Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

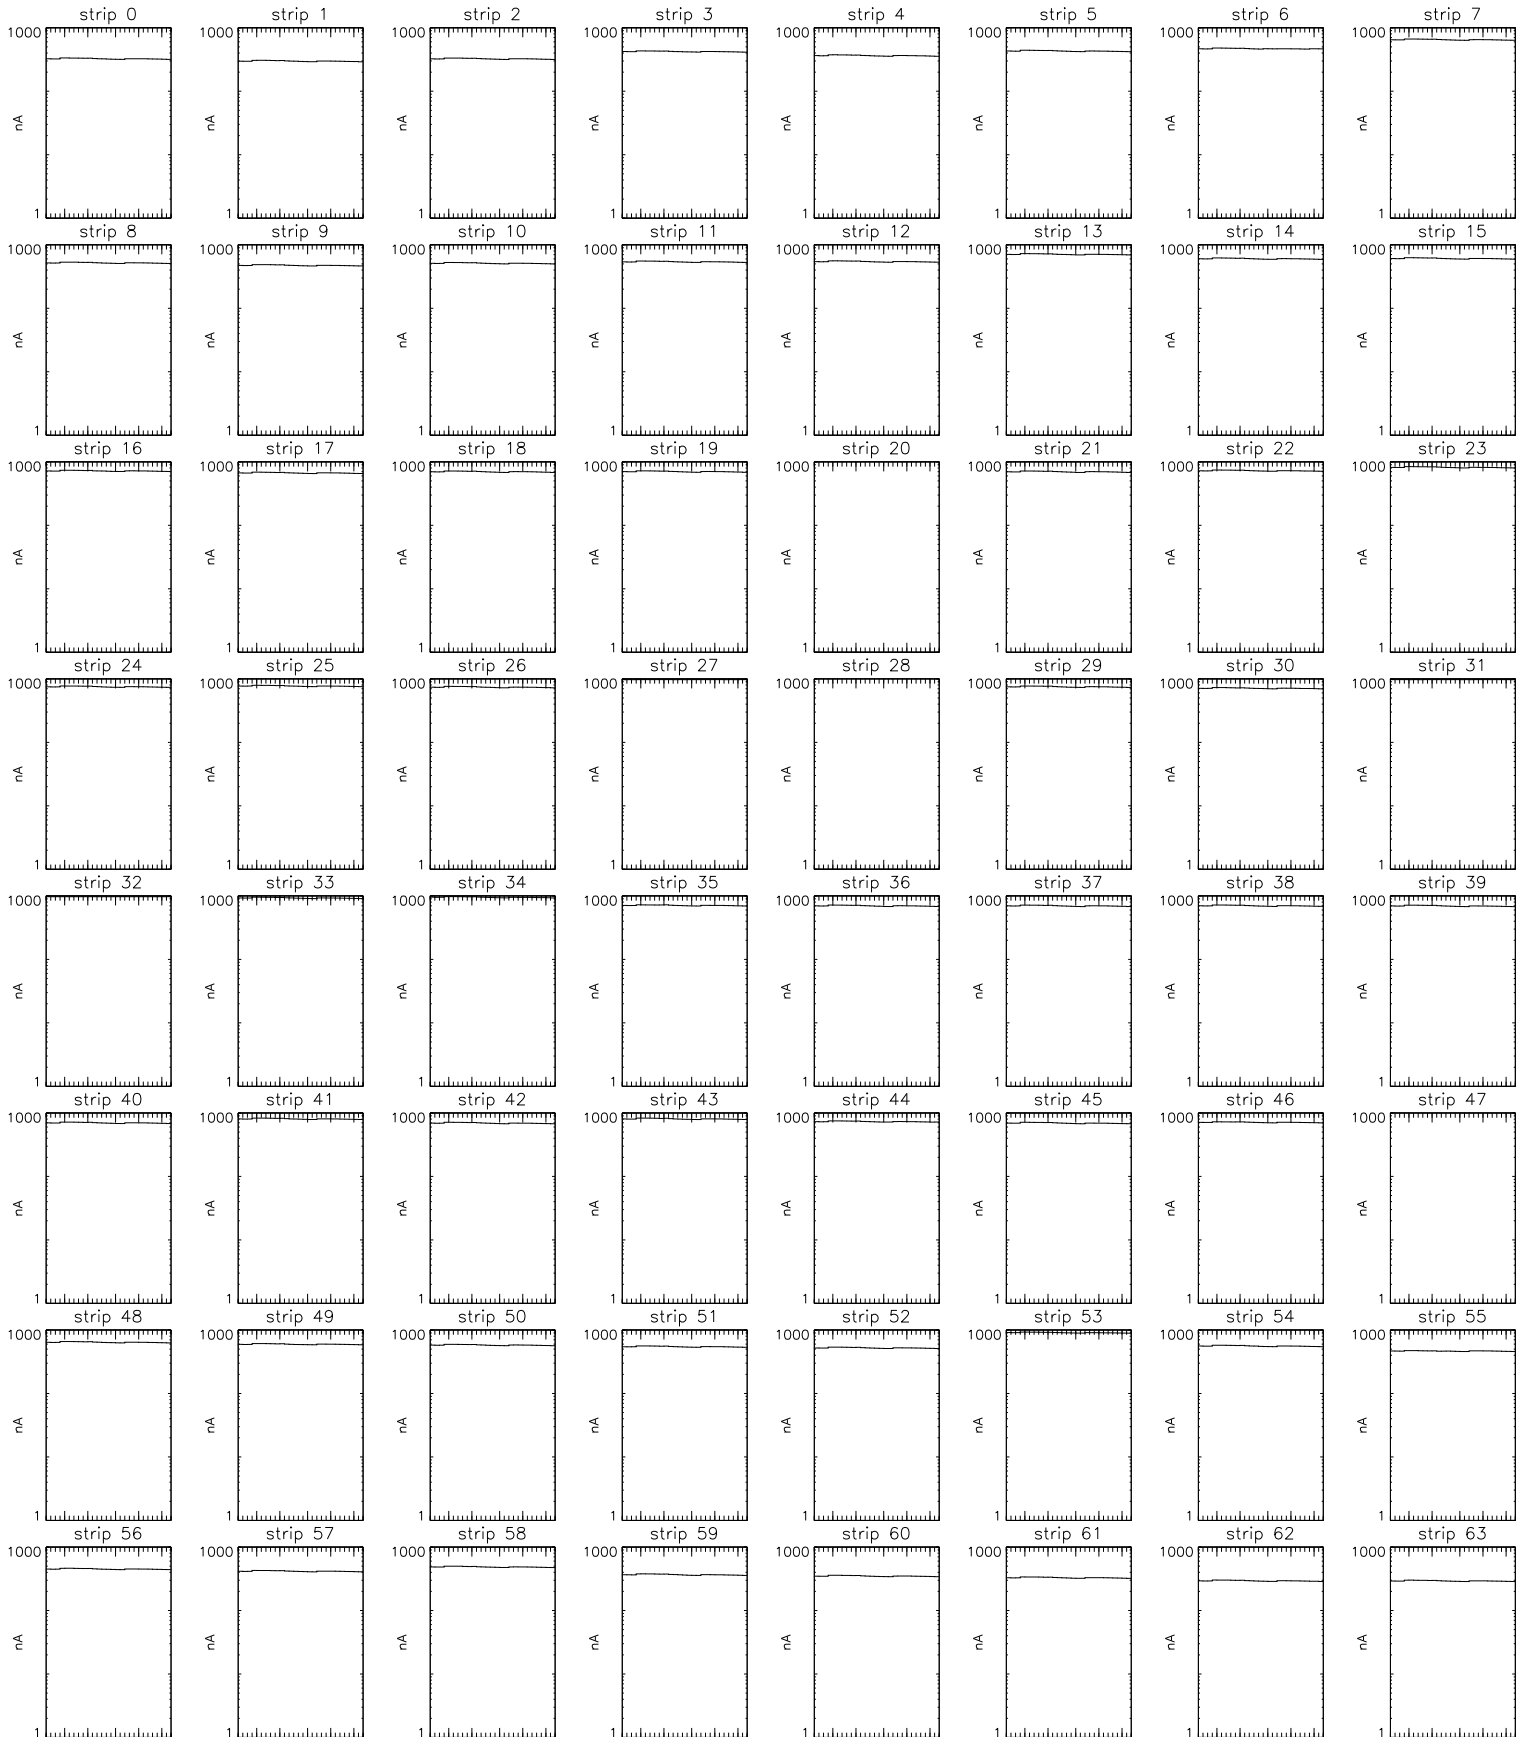


Bartels Rotation 2629 – Daily Averages
 Leakage Current – M1B – High Voltage Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

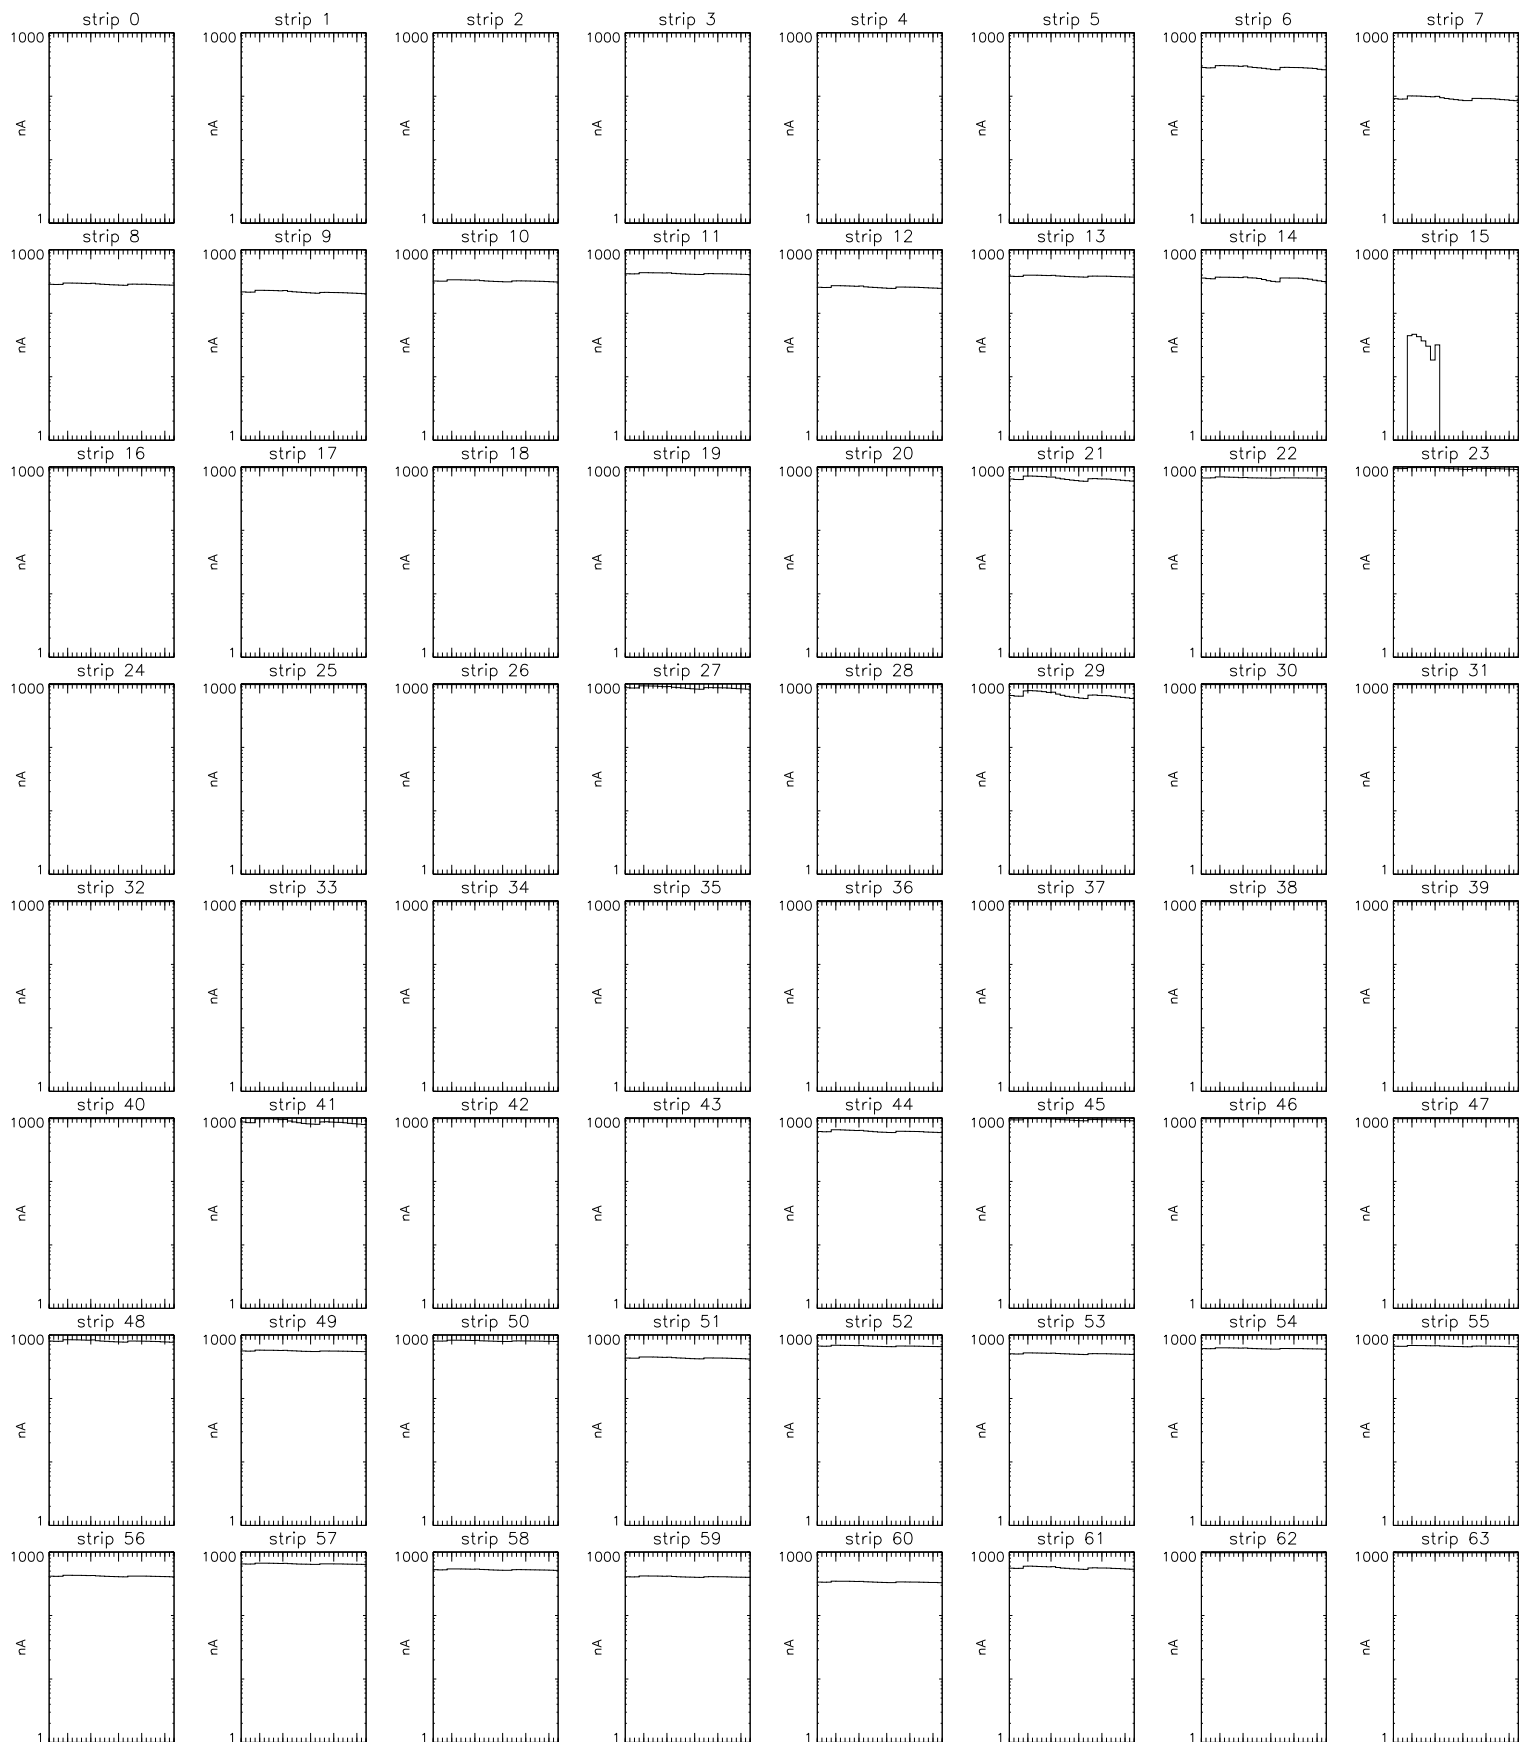

time (17-May-2026 to 13-Jun-2026)

Bartels Rotation 2629 – Daily Averages
 Leakage Current – M2B – Ground Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

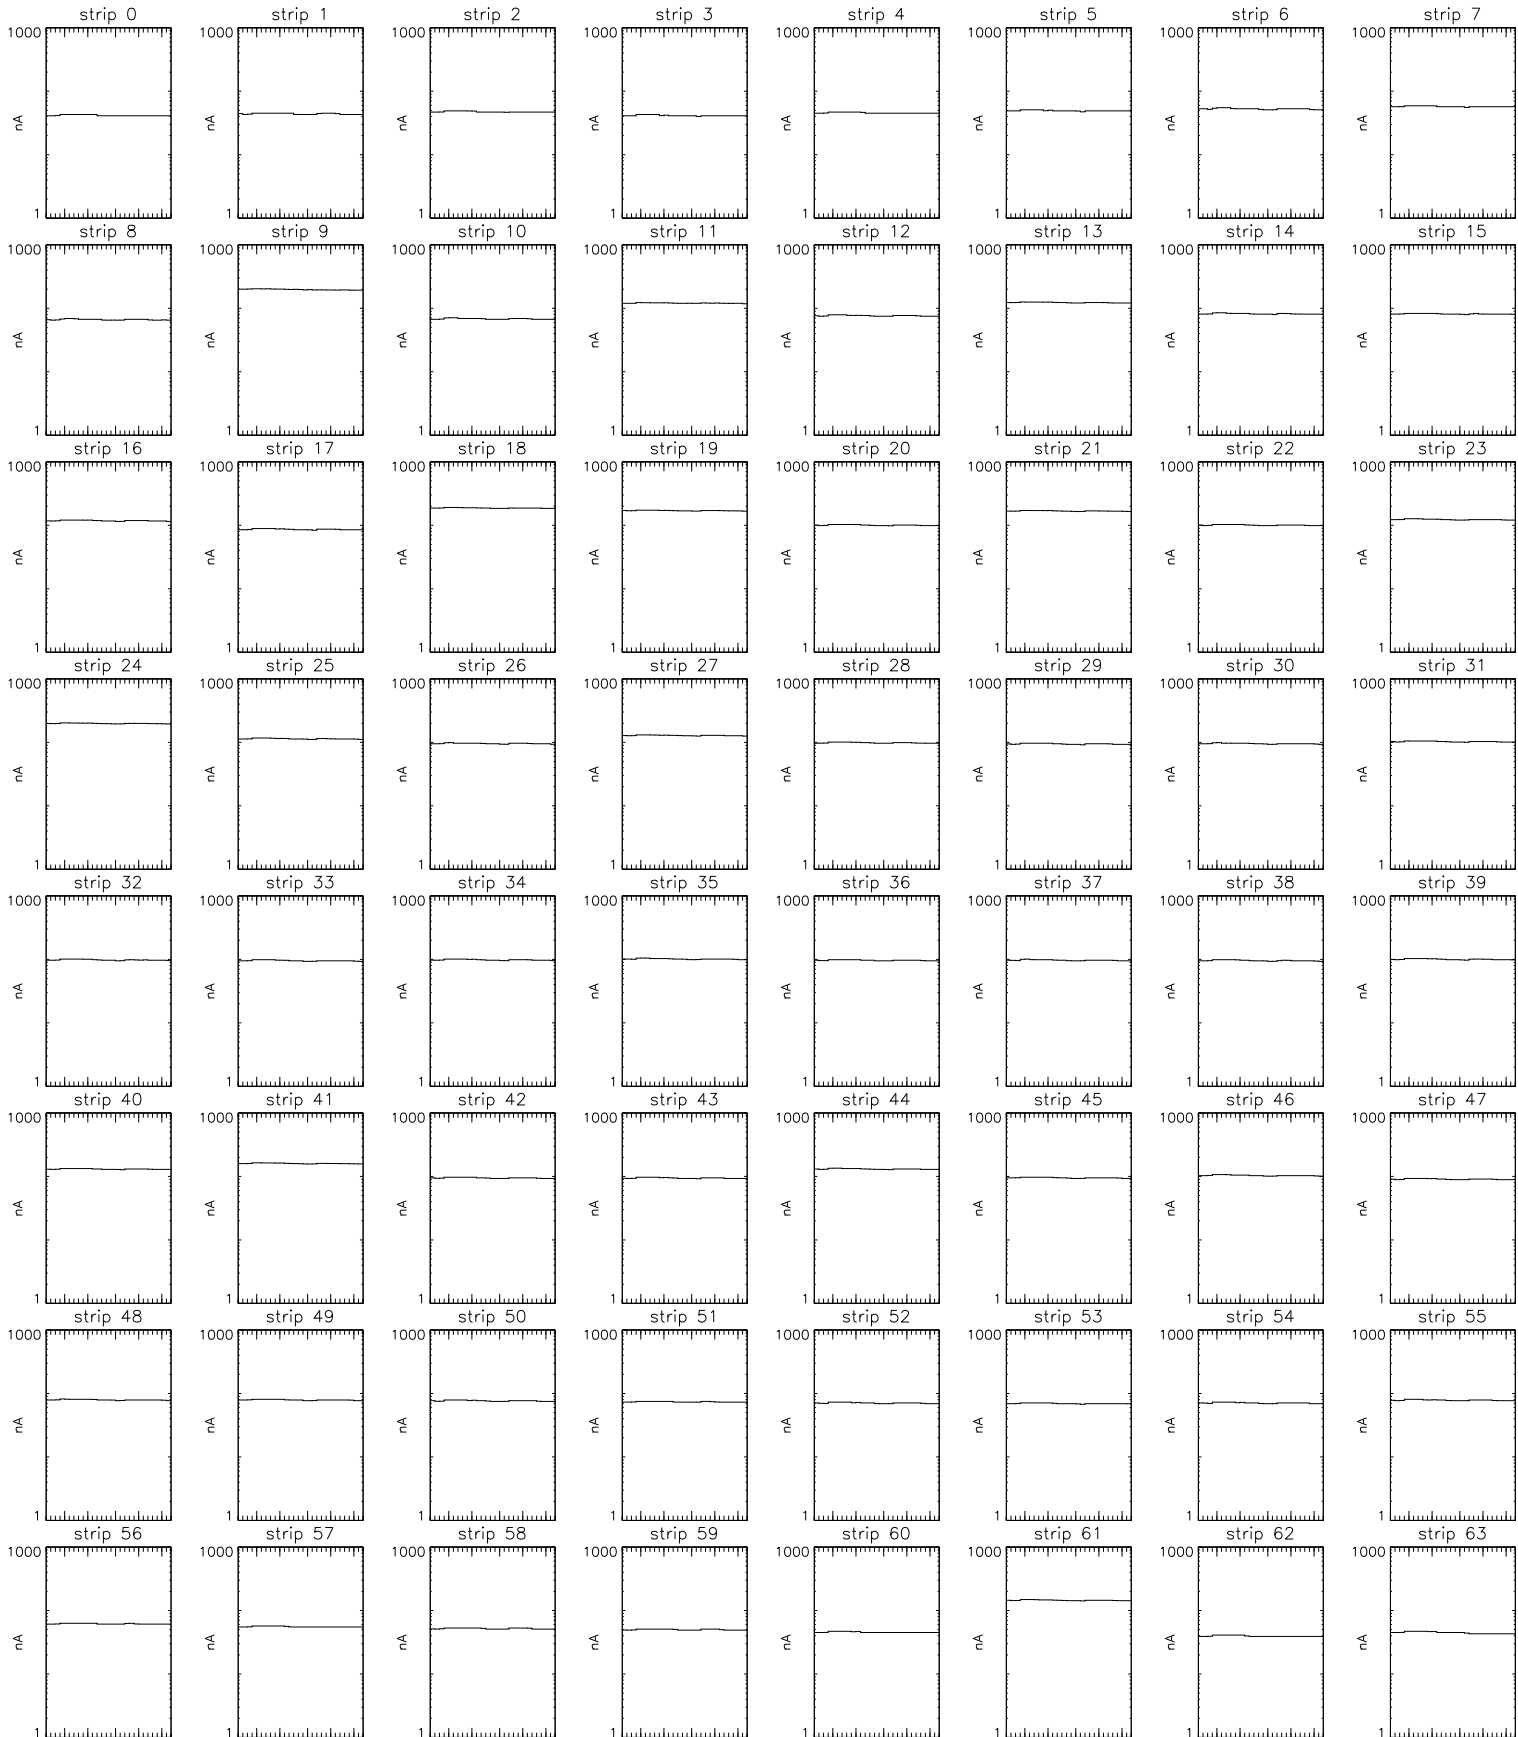

Bartels Rotation 2629 – Daily Averages
 Leakage Current – M2B – High Voltage Side
 (17-May-2026 thru 12-Jun-2026) (137/2026 thru 163/2026)

