





Bartels Rotation 2633 – Daily Averages
 Leakage Current – M1A – Ground Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

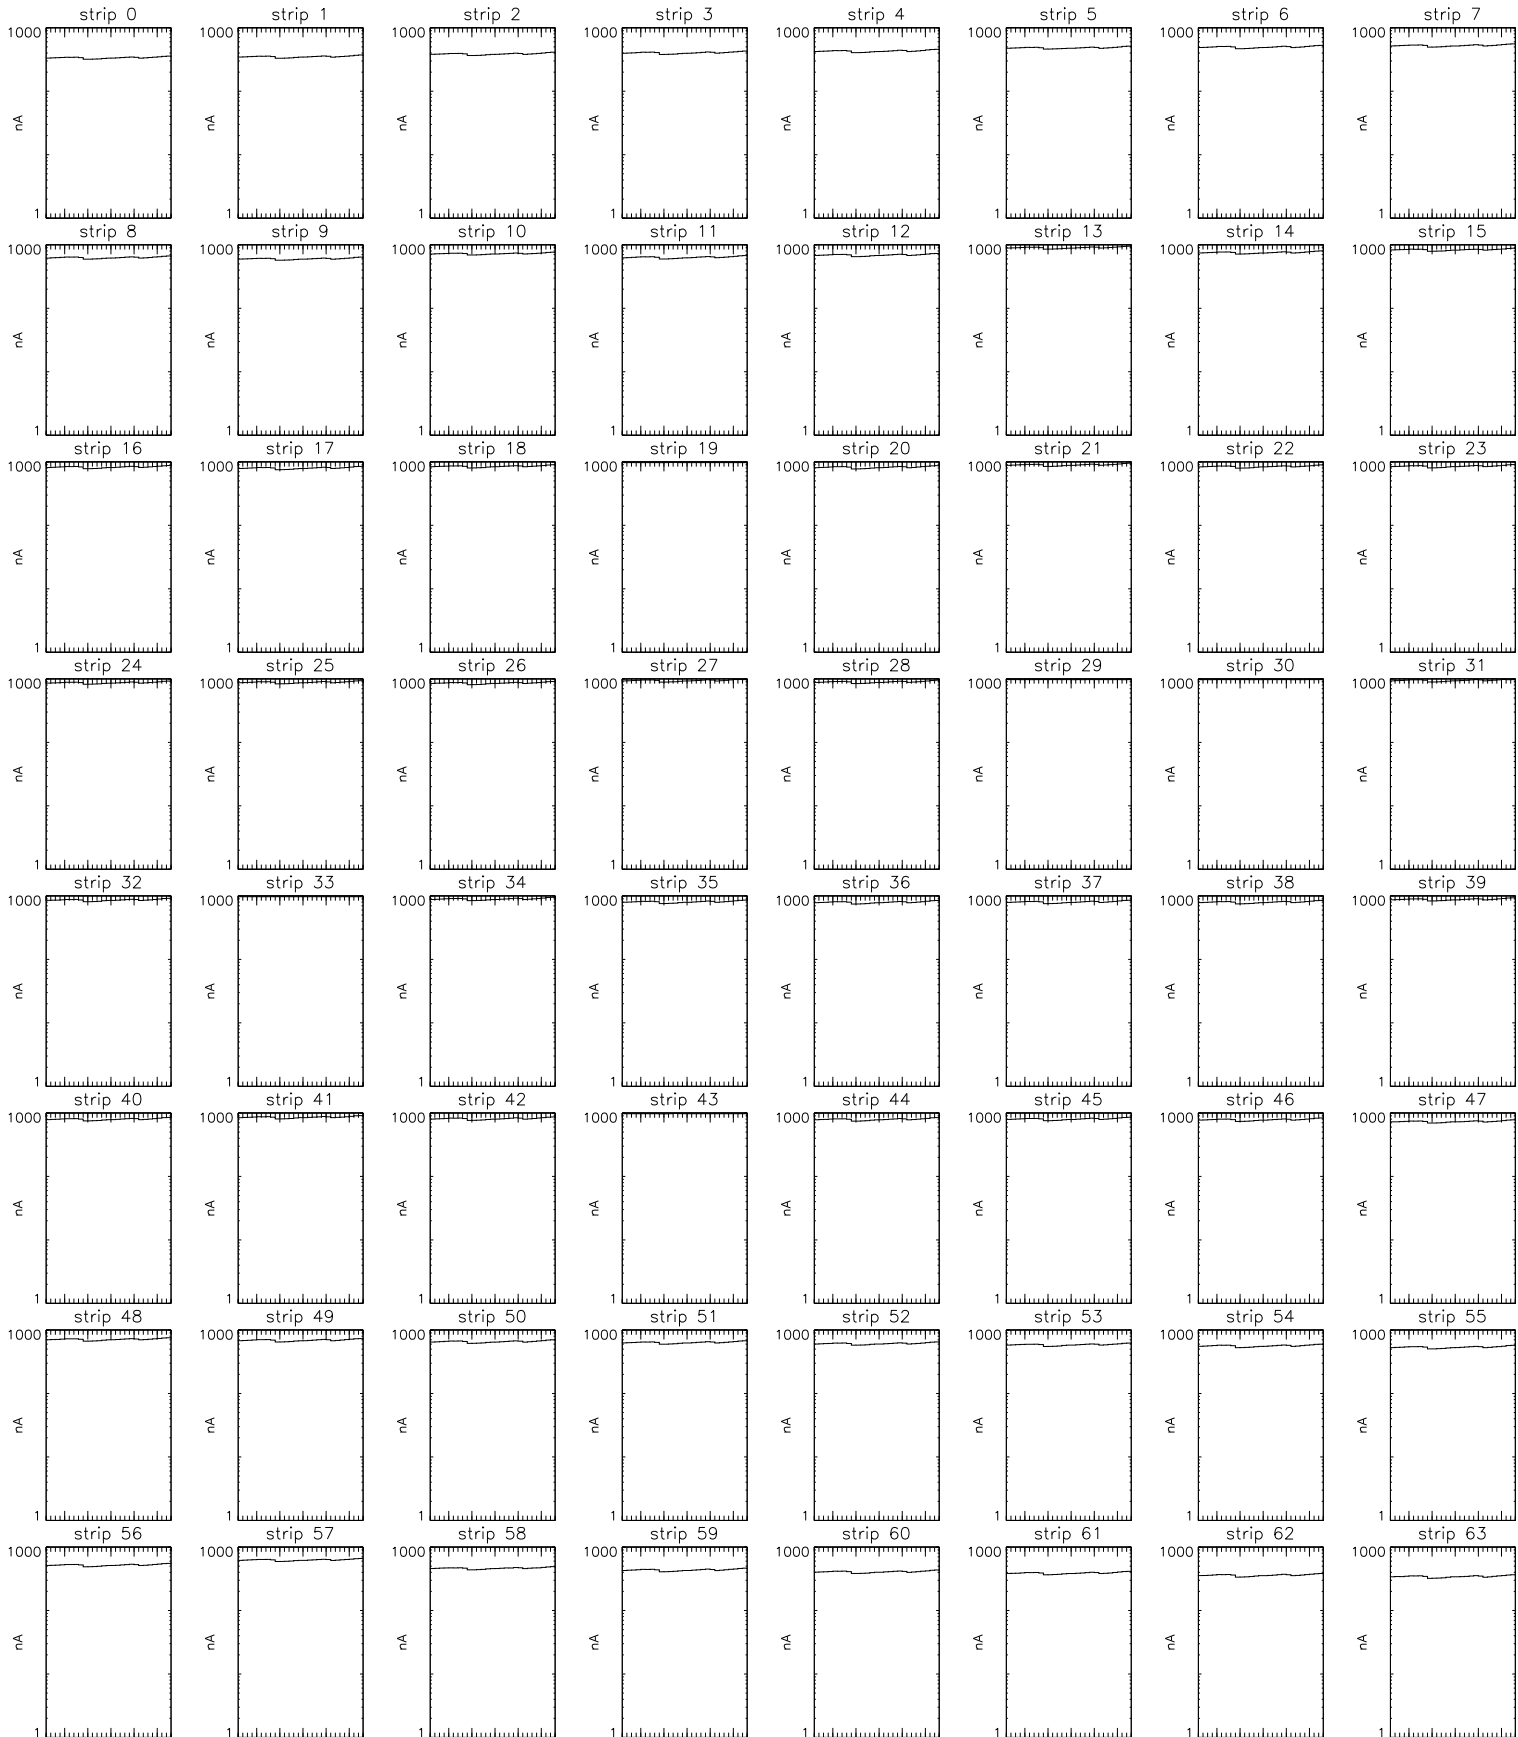



Bartels Rotation 2633 – Daily Averages
 Leakage Current – M1A – High Voltage Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

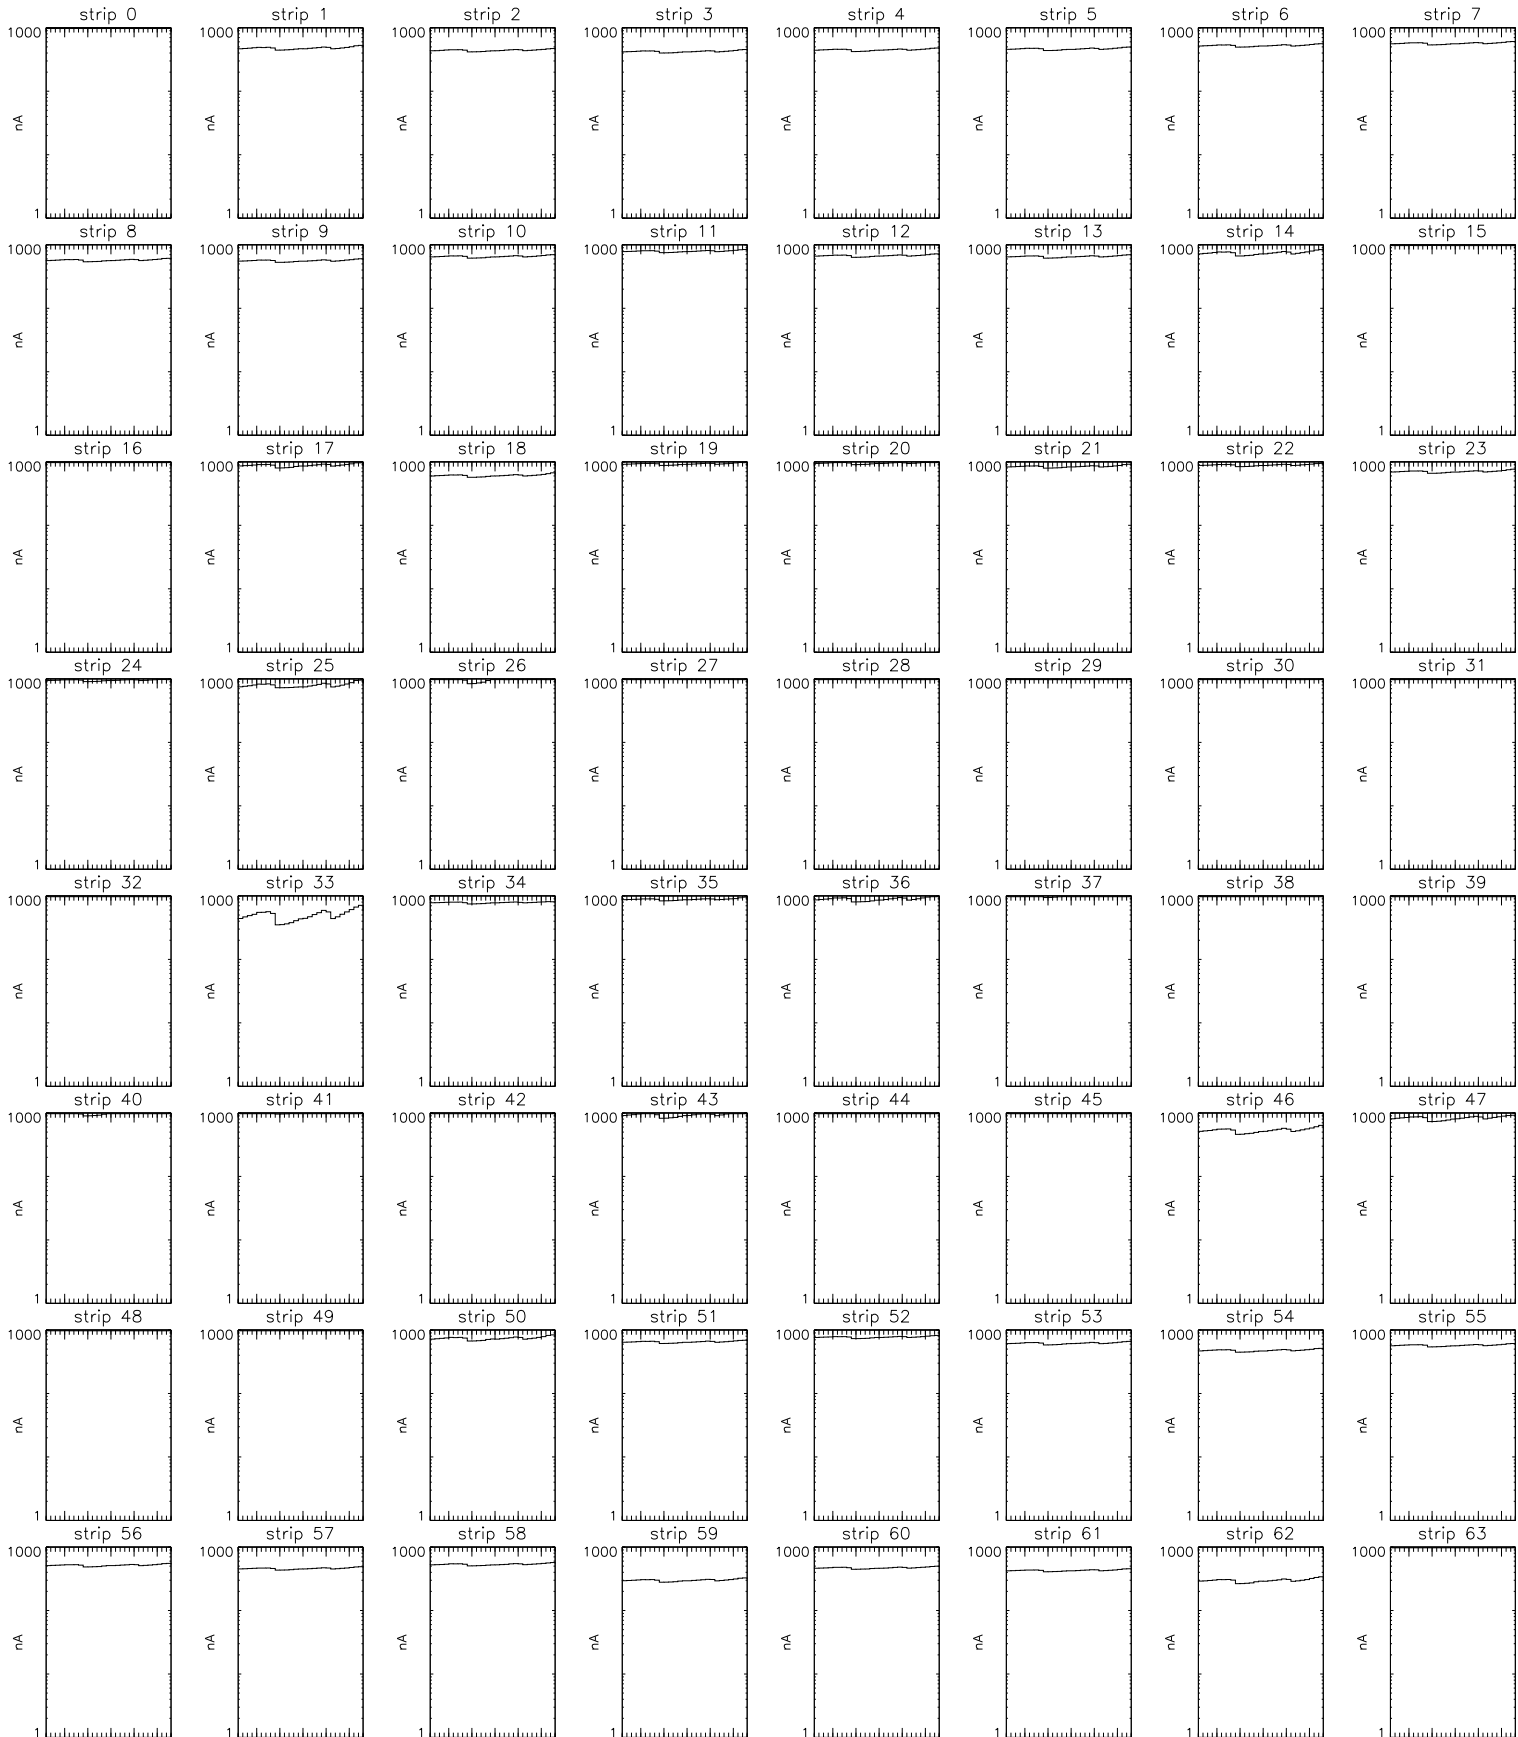



Bartels Rotation 2633 – Daily Averages
 Leakage Current – M2A – Ground Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

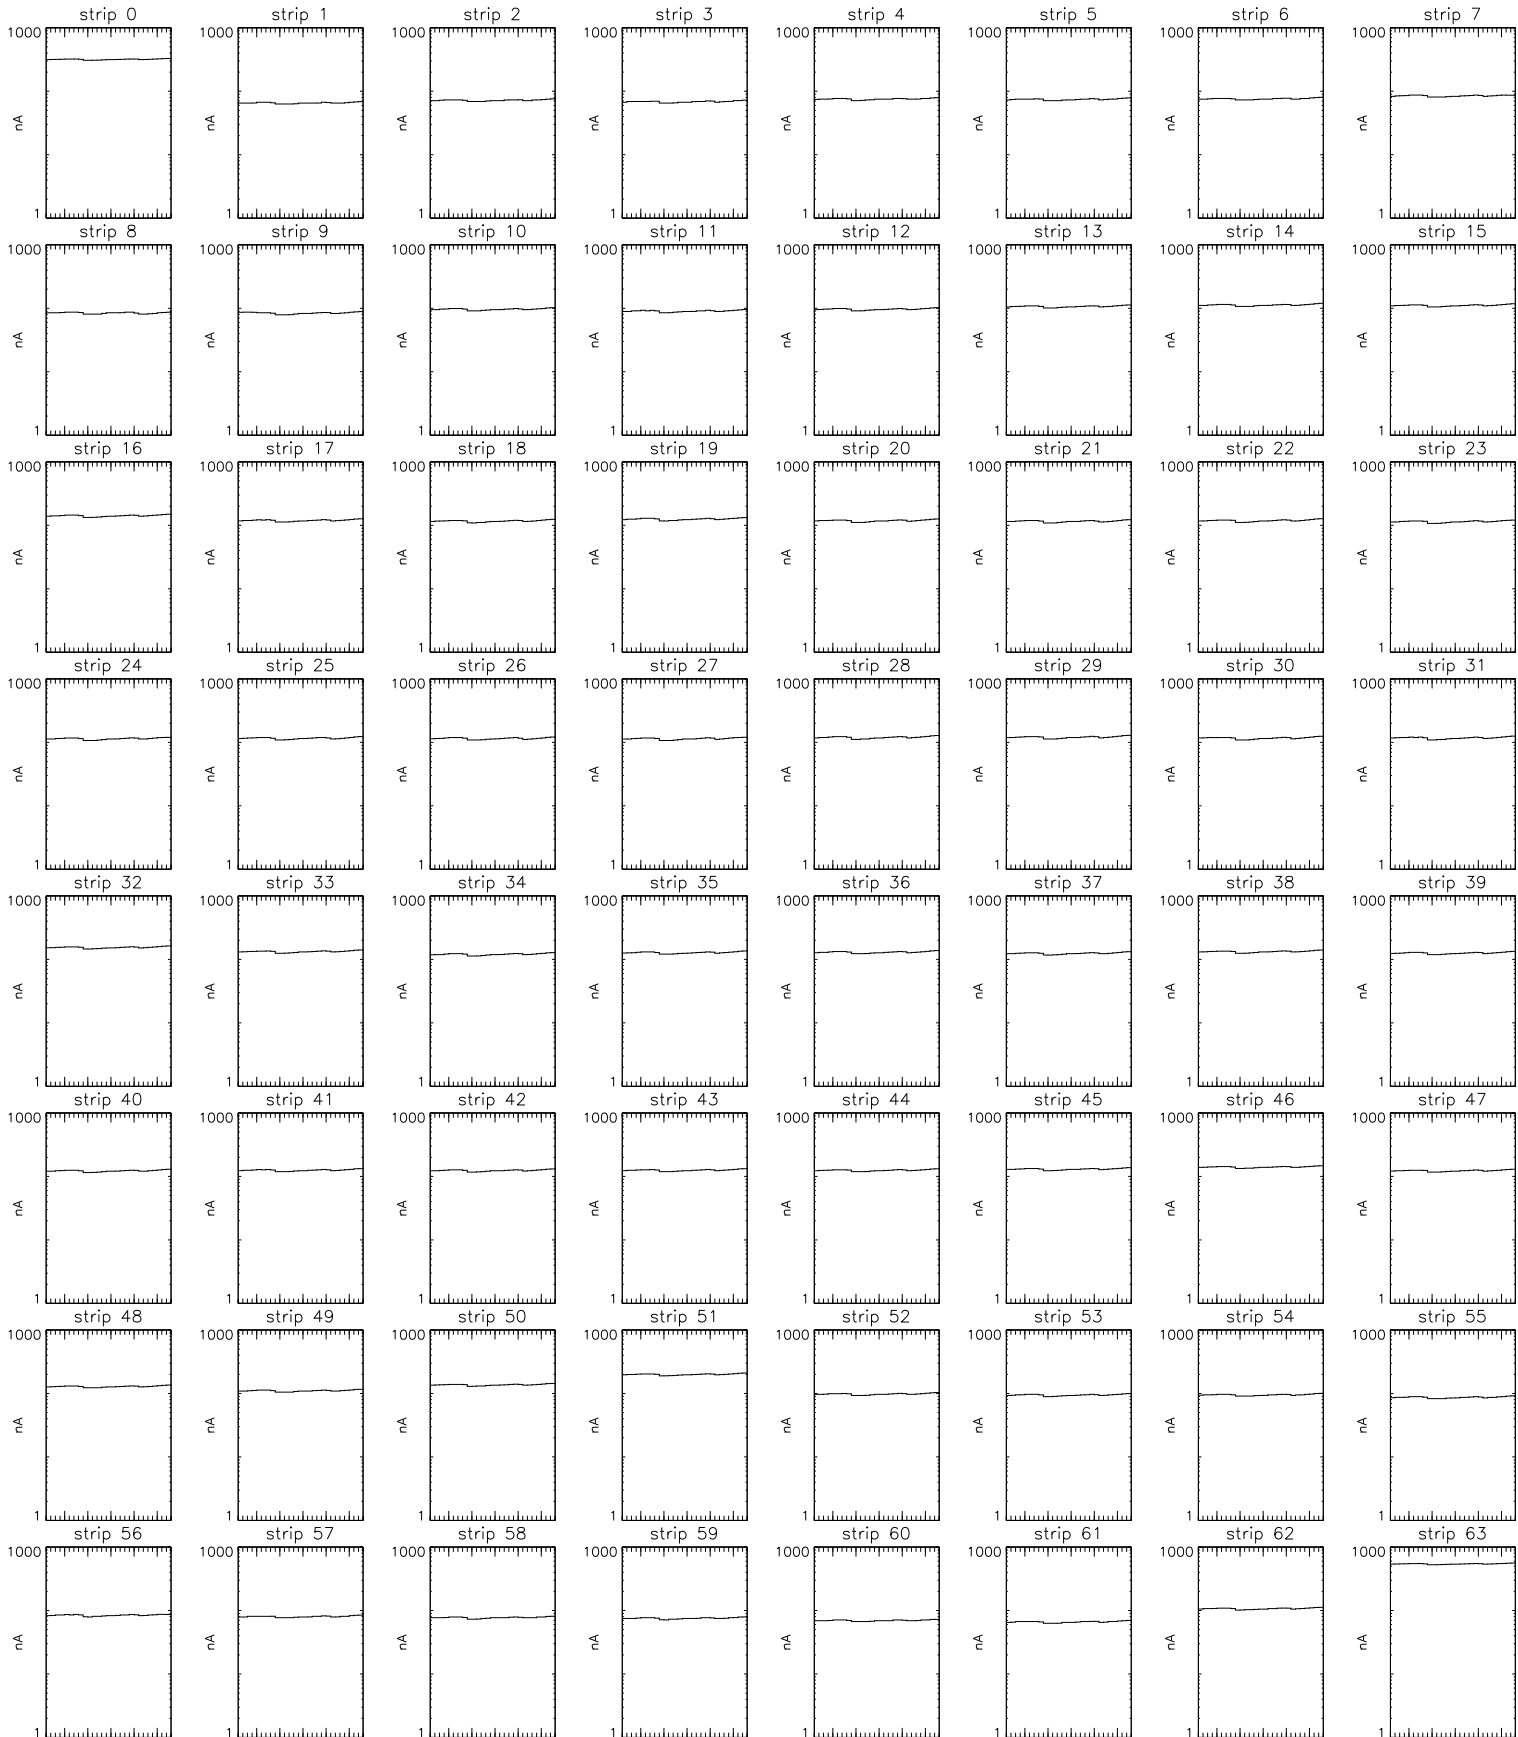



Bartels Rotation 2633 – Daily Averages
 Leakage Current – M2A – High Voltage Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

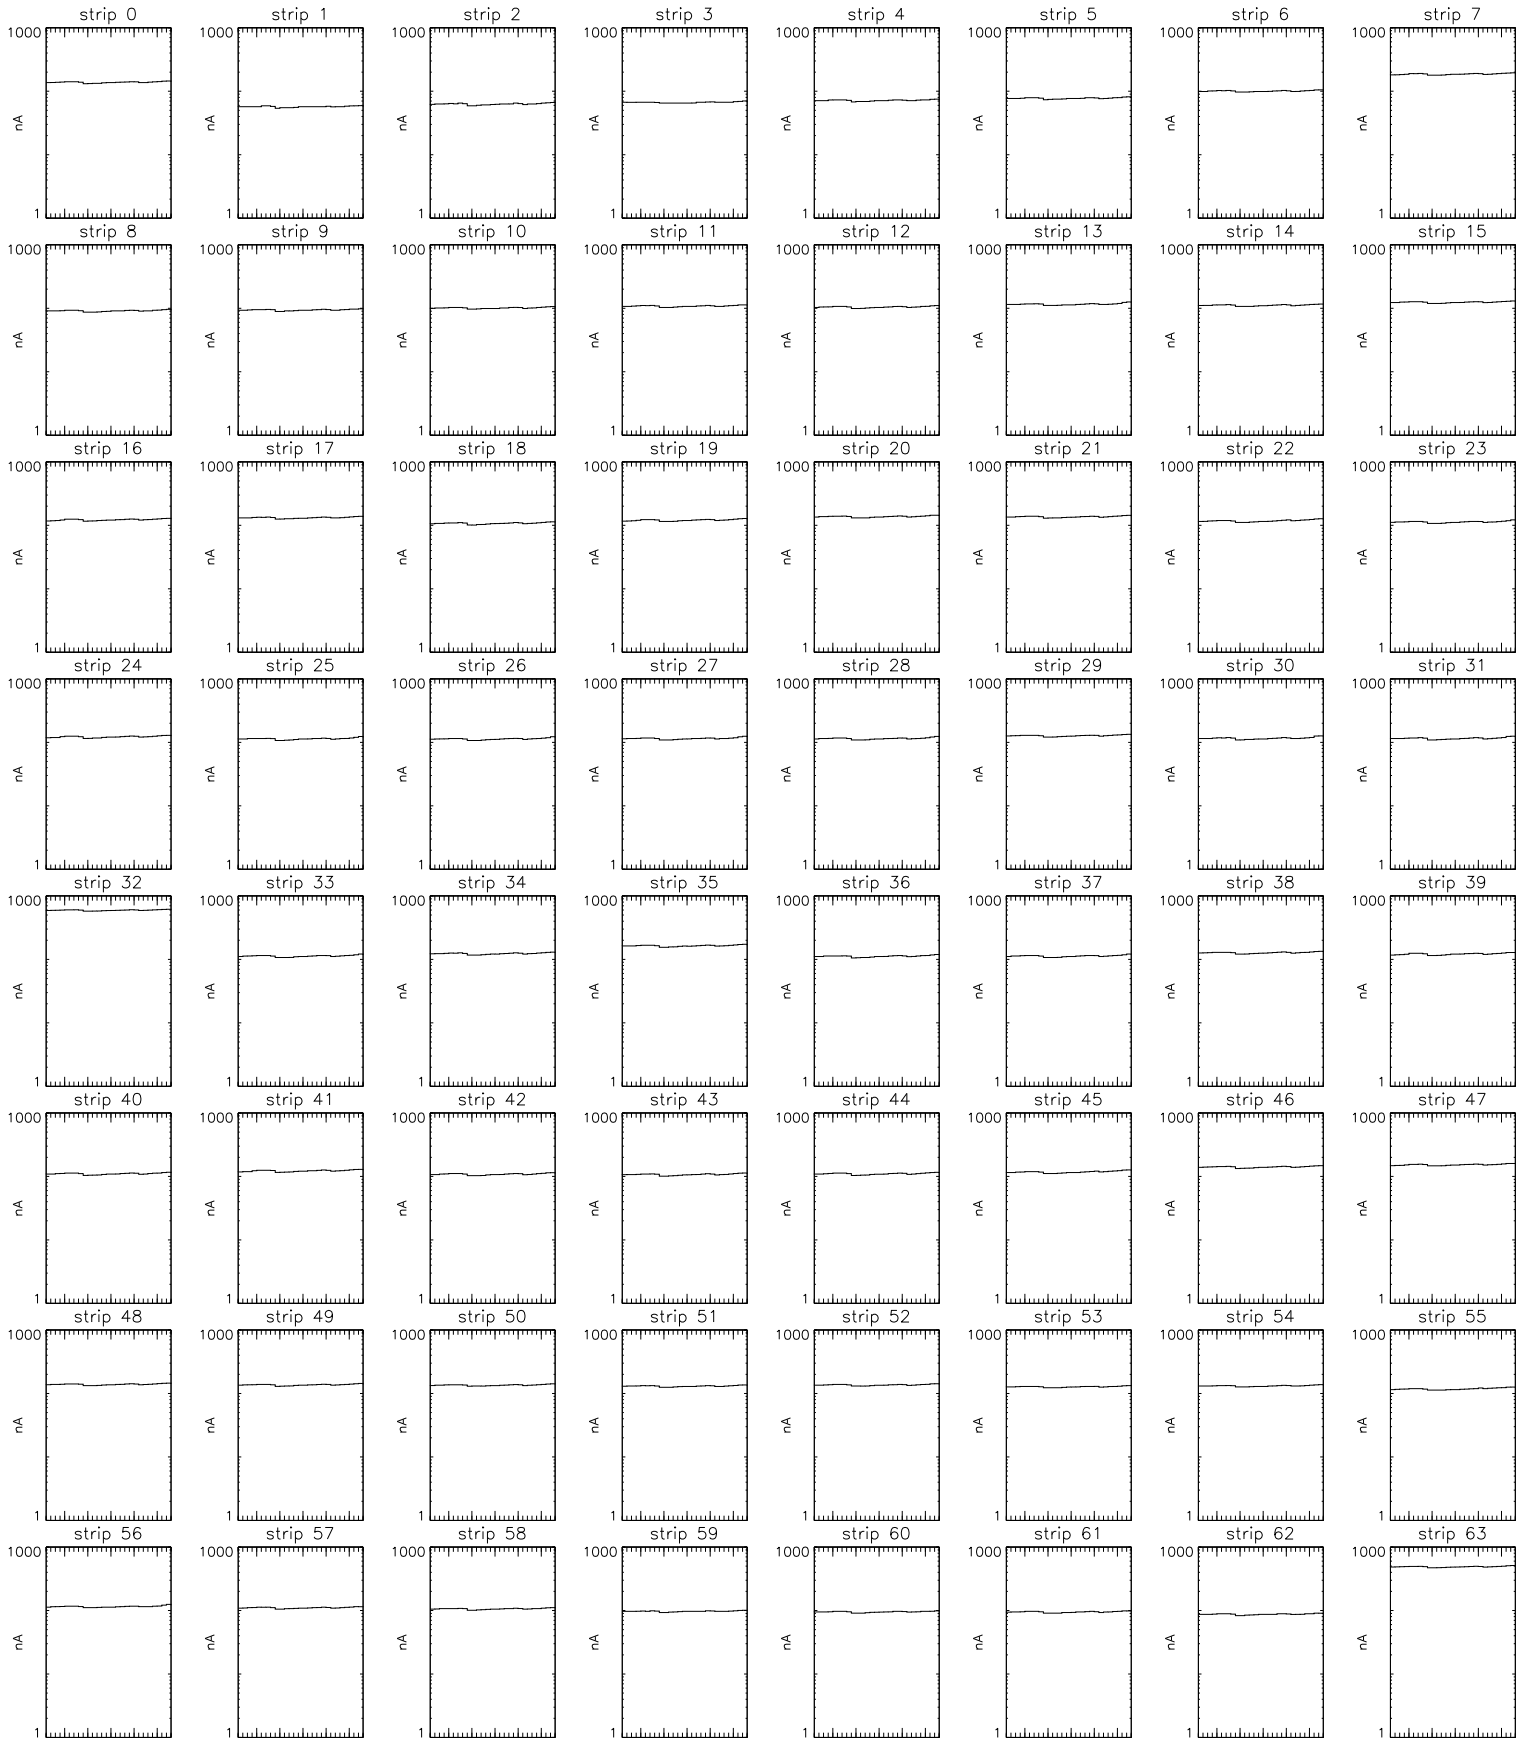


Bartels Rotation 2633 – Daily Averages
 Leakage Current – M1B – Ground Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

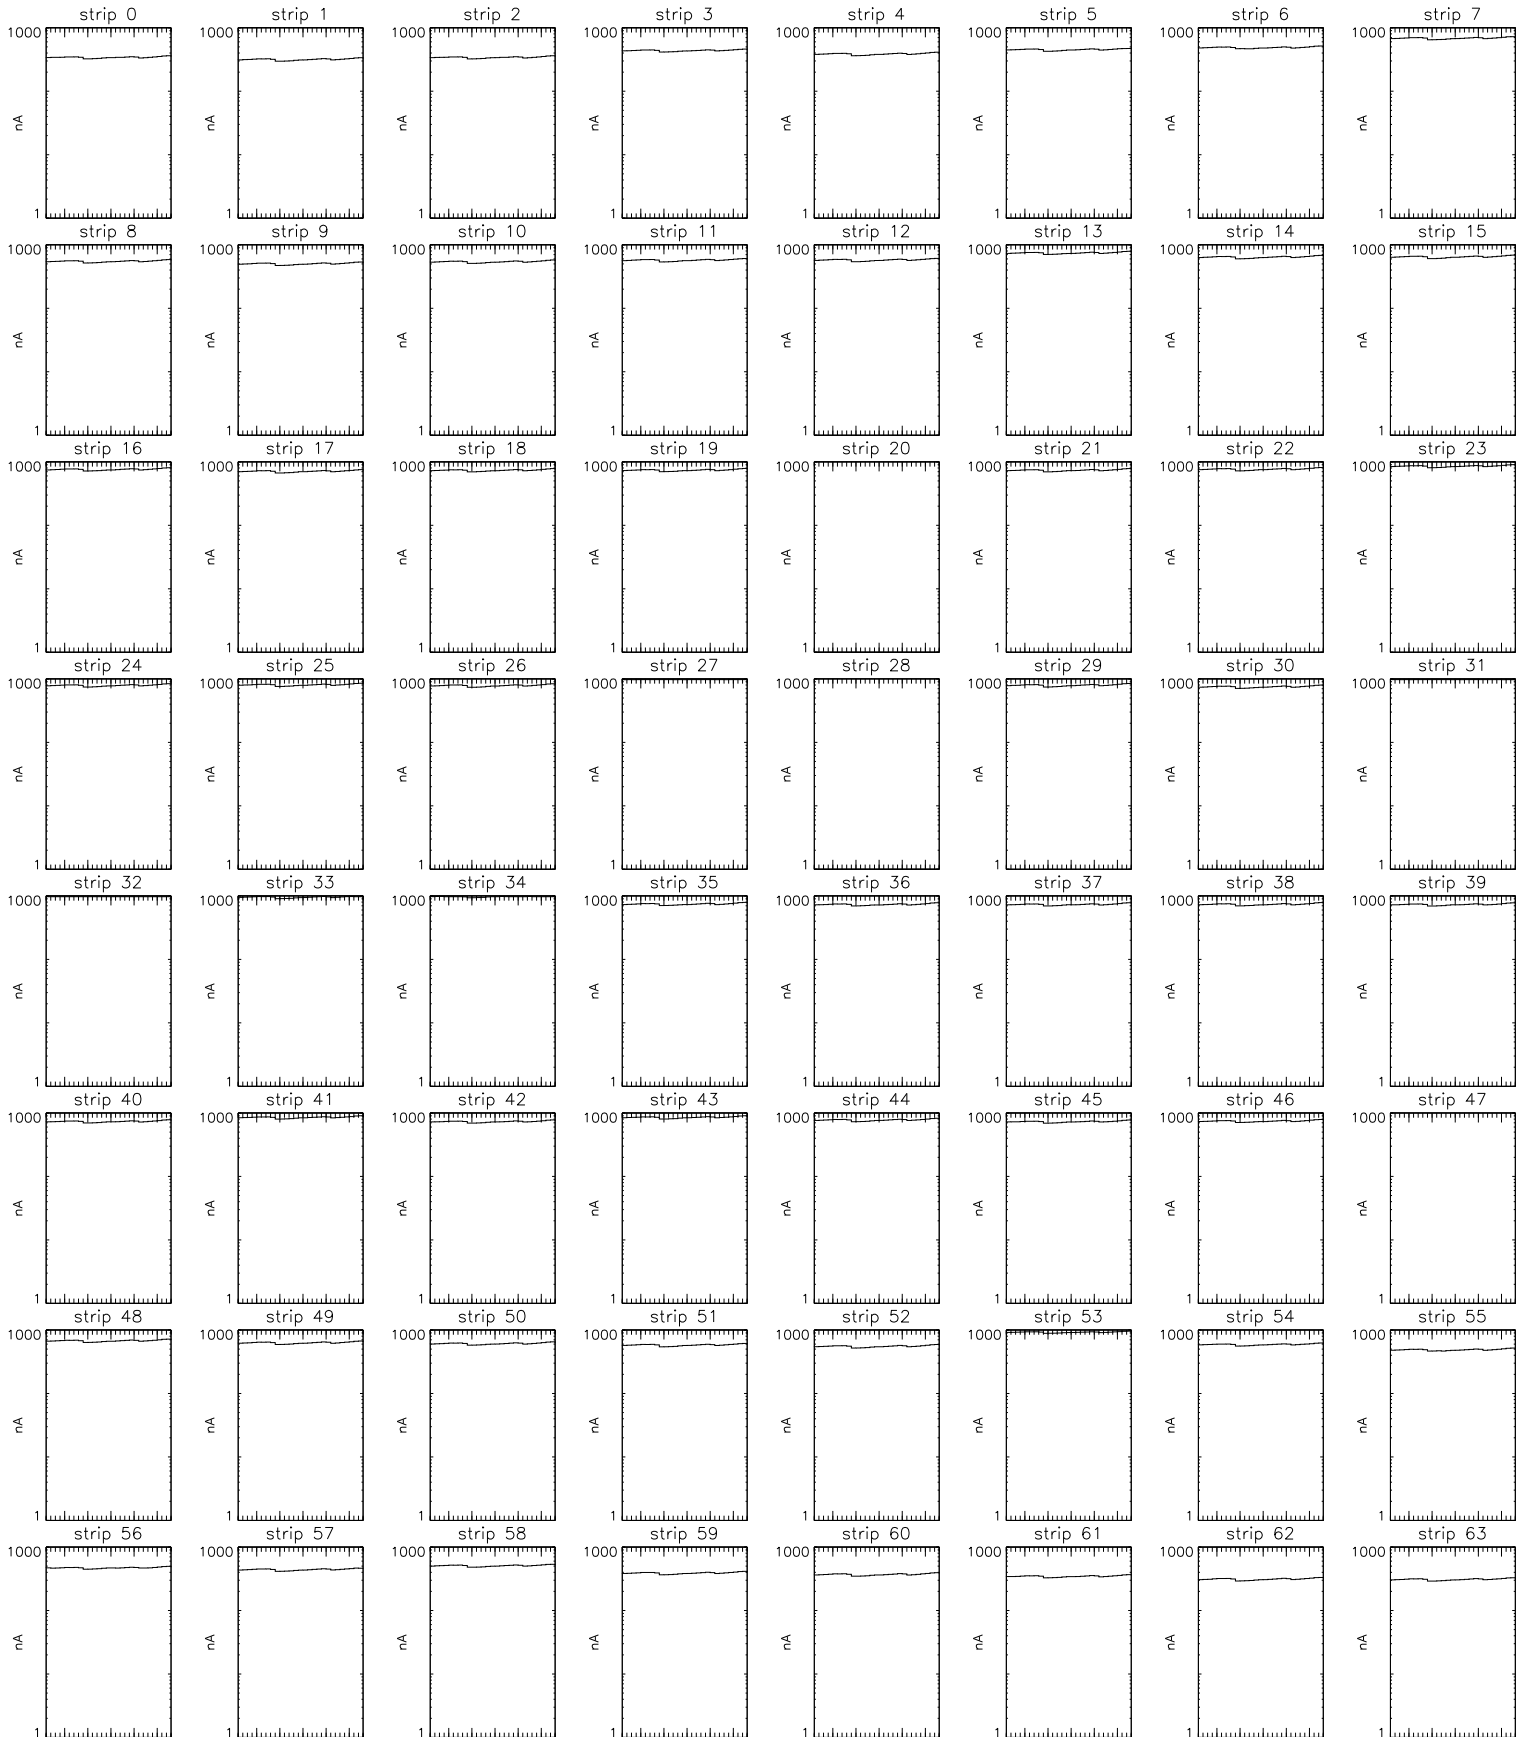

Bartels Rotation 2633 – Daily Averages
 Leakage Current – M1B – High Voltage Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

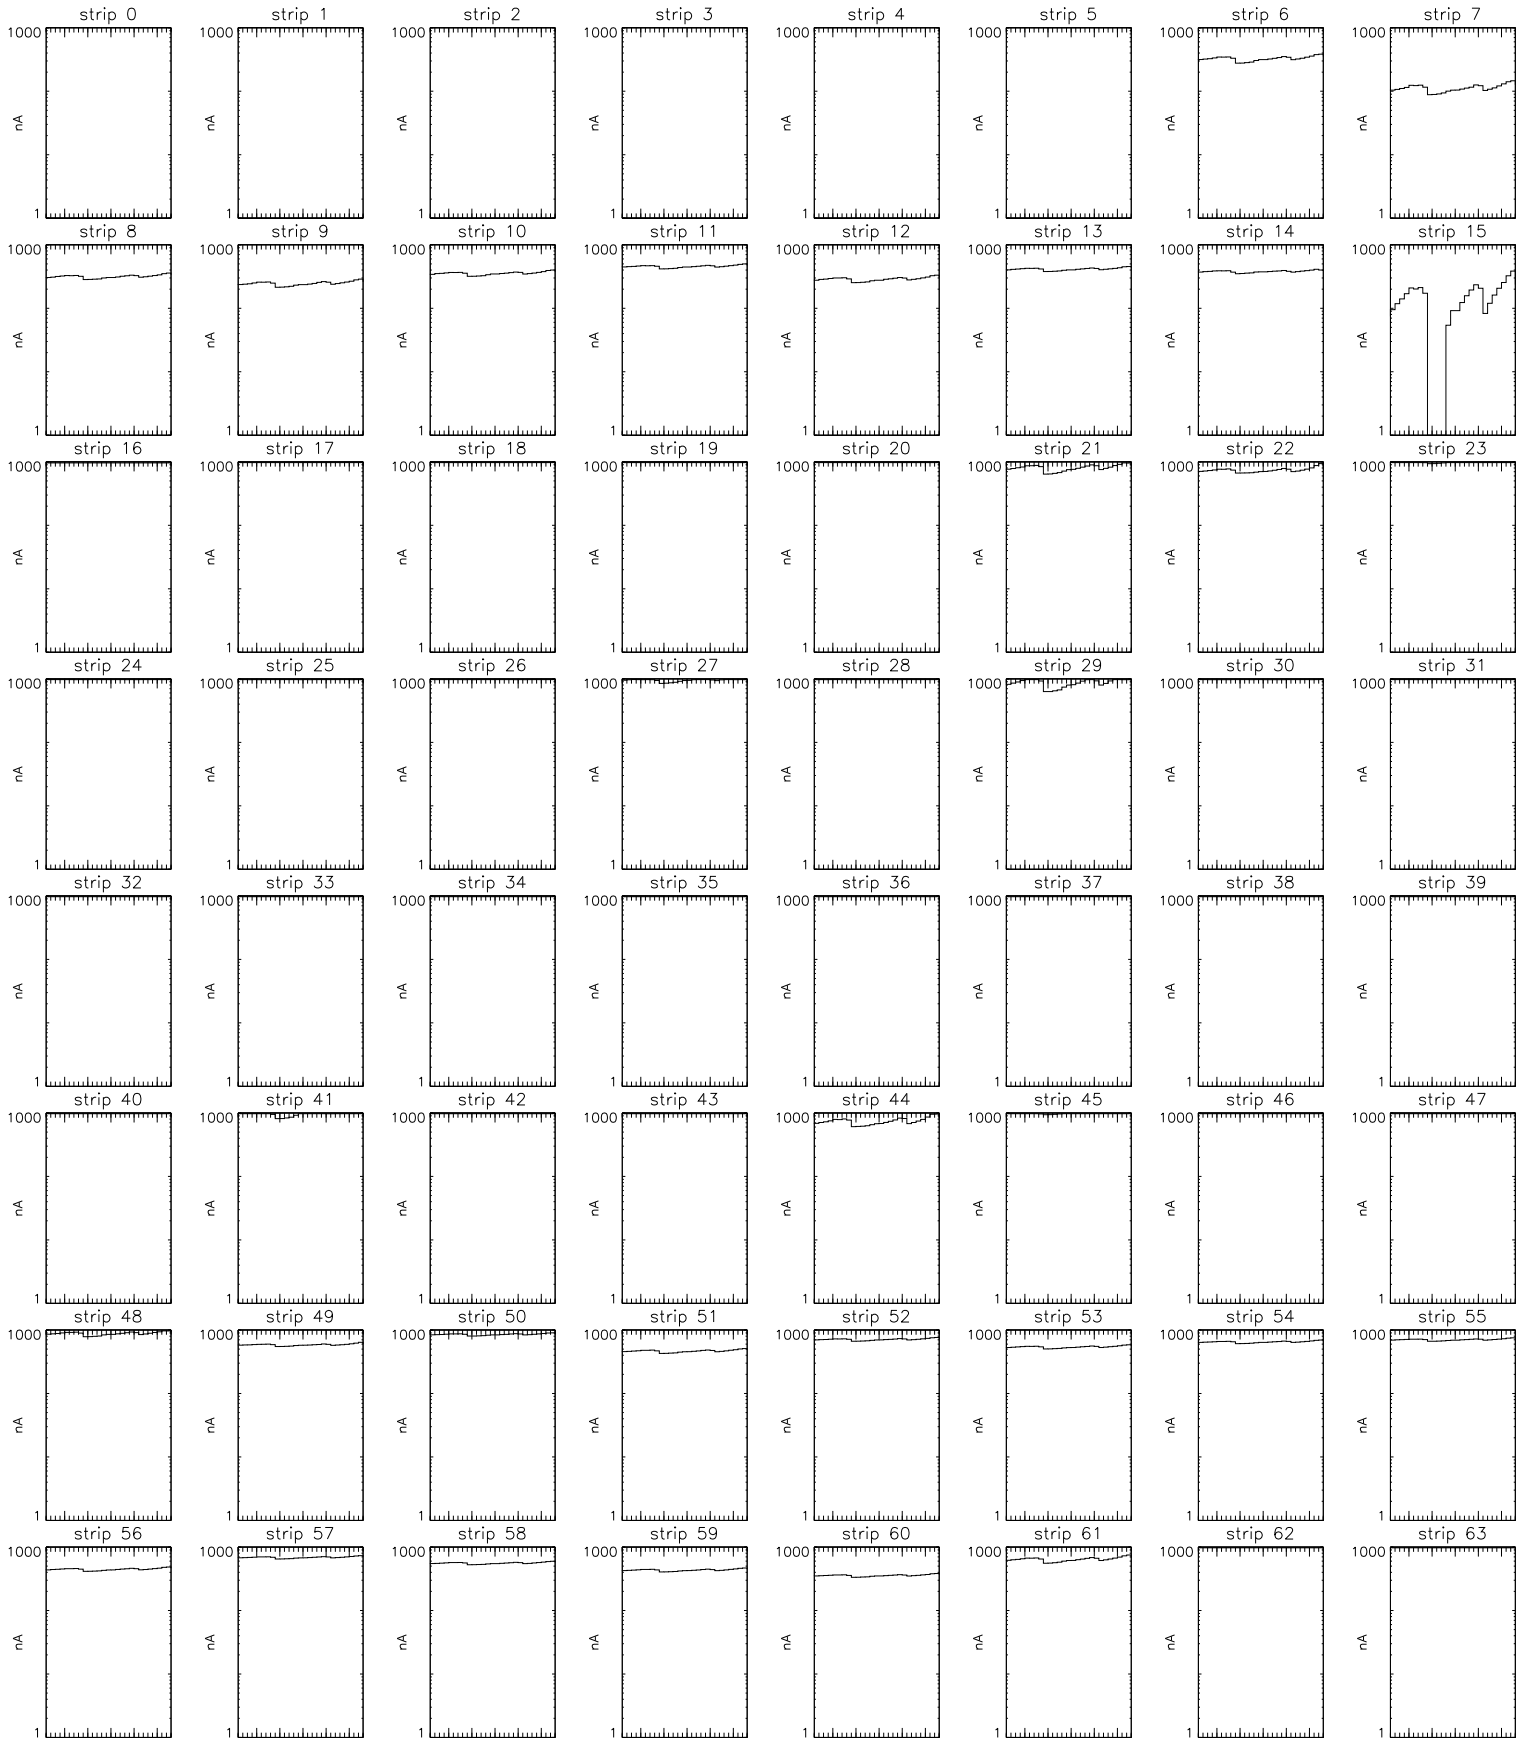

Bartels Rotation 2633 – Daily Averages
 Leakage Current – M2B – Ground Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

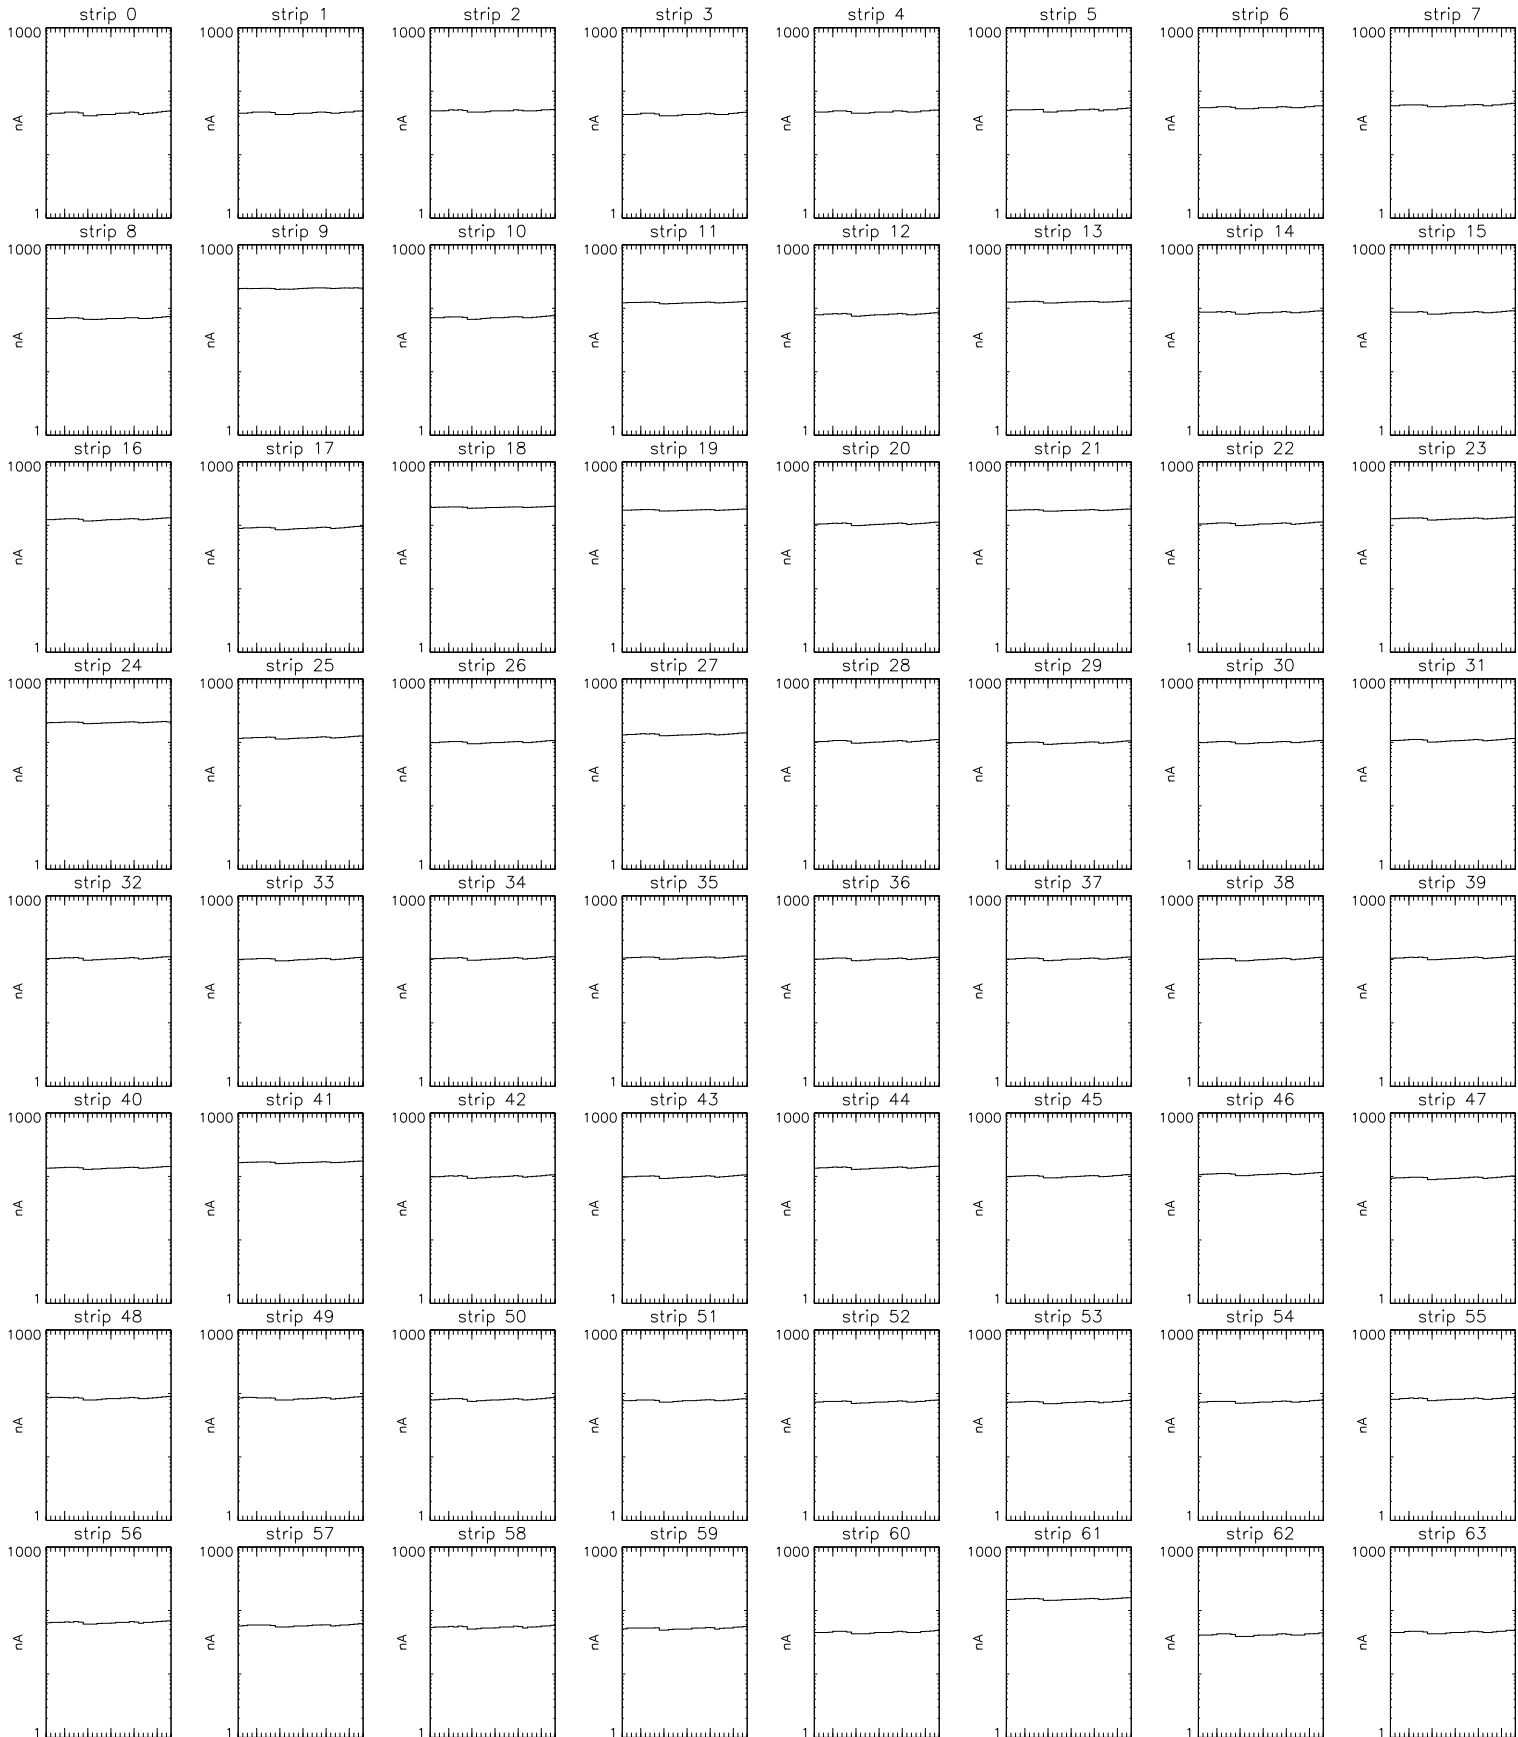

Bartels Rotation 2633 – Daily Averages
 Leakage Current – M2B – High Voltage Side
 (02-Sep-2026 thru 28-Sep-2026) (245/2026 thru 271/2026)

